



**Programme gestion durable des déchets
et de l'assainissement urbain**



Assainissement A06

**The potential fro the use of upflow
anaerobic sludge blanket (UASB) reactor
for the treatment of faecal sludges in
Ghana**

Rapport final – février 2003



MINISTÈRE DES AFFAIRES
ÉTRANGÈRES

Isaac A Doku
(BSc (Kumasi), MSc (Leeds), MASc (Toronto), PhD(Leeds))
Deputy MD and Head, Technical and Applied Research Unit
Training Research and Networking for Development Group
P. O. Box 6808
Kumasi, Ghana.

Table of Contents

1	INTRODUCTION.....	1
1.1	BACKGROUND	1
1.2	PROBLEM STATEMENT	7
1.3	CHOICE OF THE UASB REACTOR.....	8
2	LITERATURE REVIEW	8
2.1	INTRODUCTION.....	8
2.2	DEFINITIONS: NIGHTSOIL, TOILET SLUDGE, SEPTAGE AND FAECAL SLUDGE.....	9
2.2.1	<i>Introduction.....</i>	9
2.2.2	<i>Nightsoil.....</i>	9
2.2.3	<i>Toilet Sludge</i>	9
2.2.4	<i>Septage.....</i>	10
2.2.5	<i>Faecal Sludge.....</i>	10
2.3	QUANTITIES, CHARACTERISTICS AND CLASSIFICATION OF FAECAL SLUDGES	10
2.3.1	<i>Per Capita Quantities of Faecal Sludges.....</i>	10
2.3.2	<i>Characteristics of Faecal Sludges</i>	11
2.3.3	<i>Classification of Faecal Sludges.....</i>	15
3	COLLECTION AND TREATMENT OF NIGHTSOIL AND FAECAL SLUDGE	16
3.1	COLLECTION.....	16
3.1.1	<i>Nightsoil.....</i>	16
3.1.2	<i>Toilet Sludge and Septage.....</i>	16
3.2	TREATMENT	16
4	ANAEROBIC DIGESTION PROCESS	22
4.1	INTRODUCTION.....	22
4.2	BASIC CONCEPTS	22
4.3	CONVERSION PROCESSES IN ANAEROBIC DIGESTION	24
4.3.1	<i>Hydrolysis</i>	24
4.3.2	<i>Acidogenesis</i>	24
4.3.3	<i>Acetogenesis.....</i>	24
4.4	ORGANIC NITROGEN TRANSFORMATIONS	26
4.5	STABILITY OF THE CONVERSION PROCESSES.....	26
4.5.1	<i>Temperature</i>	26
4.5.2	<i>pH.....</i>	28
4.5.3	<i>Toxic Substances.....</i>	28
4.6	APPLICABILITY OF ANAEROBIC DIGESTION PROCESS FOR THE TREATMENT OF NIGHTSOIL AND TOILET SLUDGES	31
4.7	ANAEROBIC TREATMENT SYSTEMS	31
5	THE UPFLOW ANAEROBIC SLUDGE BLANKET REACTOR	34
5.1	INTRODUCTION.....	34
5.2	THE UASB REACTOR CONCEPT AND PROCESS DESIGN CONSIDERATIONS	34
5.3	DESIGN CRITERIA.....	36
5.3.1	<i>Loading Rates</i>	36
5.3.2	<i>Physical Design considerations.....</i>	37
5.4	START-UP OF UASB REACTOR TREATING DOMESTIC WASTEWATER	37
5.5	STEADY-STATE BEHAVIOUR IN THE UASB REACTOR	39
5.6	MASS BALANCE EQUATION	40

5.7	BIOGAS PRODUCTION.....	40
5.8	APPLICABILITY AND PRESENT USE OF THE UASB PROCESS	42
6	RESULTS AND DISCUSSION OF RECENT EXPERIMENTAL WORK.....	46
6.1	INTRODUCTION.....	46
6.2	PHYSICAL AND CHEMICAL CHARACTERISTICS OF FAECAL SLUDGES	46
6.3	AMBIENT TEMPERATURE MEASUREMENTS	47
6.4	CHEMICAL OXYGEN DEMAND	47
6.5	TOTAL SOLIDS.....	49
6.6	TOTAL VOLATILE SOLIDS	50
6.7	RATIO OF TOTAL VOLATILE SOLIDS (TVS) TO TOTAL SOLIDS (TS) FOR FAECAL SLUDGE.....	51
6.7.1	<i>Organic Nitrogen</i>	51
6.7.2	<i>Organic loading rate (OLR) and percent removal efficiencies of COD, TS and TVS for faecal sludge.</i>	52
6.7.3	<i>Methane Production for Faecal Sludge</i>	53
6.8	PERFORMANCE OF THE UASB REACTORS	56
6.8.1	<i>COD removal</i>	56
6.8.2	<i>Total Solids removal</i>	56
6.8.3	<i>Total Volatile Solids (TVS)</i>	57
6.8.4	<i>Nitrogen removal efficiencies</i>	57
6.8.5	<i>Biogas Production</i>	57
6.9	COMPARISON OF FSTP AND UASB REACTOR.....	58
6.9.1	<i>Land Area Requirements</i>	58
6.9.2	<i>Detention Time and Effluent Quality</i>	58
6.9.3	<i>Methane Production</i>	59
7	CONCLUSIONS	59
8	SUGGESTIONS FOR FURTHER WORK.....	60

List of Tables

Table 1-1	Characteristics of Faecal Sludges from On-site Sanitation Systems in Accra, Ghana	8
Table 2-1	Daily Per Capita BOD, TS, TKN Quantities of Different Types of Faecal Sludges	10
Table 2-2	Typical characteristics of septage	12
Table 2-3	Estimated effect of temperature on anaerobic treatment.....	12
Table 2-4	Characteristics of nightsoil/toilet sludge.....	13
Table 2-5	Important Characteristics and Classification of Faecal Sludges	15
Table 3-1	Examples of Faecal Sludge Treatment Systems	18
Table 5-1	Types of wastewaters treated in UASB reactors.....	43
Table 5-2	Application of upflow anaerobic reactors to sewage treatment	44
Table 6-1	Characteristics of nightsoil/toilet sludge in Kumasi, Ghana	46
Table 6-2	Comparison of the characteristic of faecal sludges from Kumasi to that reported in the literature and for Accra.	47
Table 6-3	Summary of COD values for influent/effluent samples from the UASB reactor using faecal sludge	49
Table 6-4	Summary of TS values for influent/effluent samples from the UASB reactor using faecal sludge	49
Table 6-5	Summary of TVS values for influent/effluent samples from the UASB reactor using faecal sludge	50
Table 6-6	Summary of organic nitrogen values for influent/effluent samples from the UASB reactor using faecal sludge.....	52
Table 6-7	Summary of CH ₄ production values for faecal sludge.....	53

List of Figures

Figure 1-1	Schematic diagram of the Achimota Faecal Sludge Treatment Plant.....	7
Figure 3-1	Schematic diagram of current situation showing sources, types, collection, transportation, treatment and disposal of nightsoil and faecal sludges in Ghana.	17
Figure 3-2	Treatment Flowpath for high-strength faecal sludge in Ghana incorporating unheated anaerobic digestion process	21
Figure 4-1	Reaction sequence for the anaerobic digestion of particulate organic material	25
Figure 4-2	Influence of temperature on the rate of anaerobic digestion in the mesophilic range.....	27
Figure 4-3	Influence of temperature on the extent and rate of anaerobic digestion of primary sludge.....	28
Figure 4-4	Effect of pH on hydrogen sulphide-sulphide equilibrium (10^{-3} molar solution, 32 mg H_2S/l).....	29
Figure 4-5	NH_4-N and NH_3-N as a function of pH and temperature	30
Figure 4-6	Anaerobic treatment systems	32
Figure 4-7	Schematic representation of different high rate anaerobic processes	33
Figure 5-1	Schematic diagram of UASB reactor.....	35
Figure 5-2	BOD and COD removal efficiencies in the Pedegral UASB reactor during the first 30 weeks of operation.....	38
Figure 5-3	Settleable solids and TSS removal efficiencies in the Pedegral UASB reactor during the first 30 weeks of operation.....	39
Figure 6-1	Temperature values over the experimental period	48
Figure 6-2	COD values and % removal efficiency with time for faecal sludge	48
Figure 6-3	TS values and % removal with time for faecal sludge.....	49
Figure 6-4	TVS values and % removal with time for faecal sludge.....	50
Figure 6-5	Ratio of TVS/TS with time for faecal sludge.....	51
Figure 6-6	Values of organic nitrogen and % removal efficiency with time for faecal sludge.	52
Figure 6-7	Percent removal efficiencies for COD, TS, TVS and the variation of OLR with time for faecal sludge.....	53
Figure 6-8	Calculated volume of CH_4 and COD equivalent of CH_4 in the collected biogas for faecal sludge	54
Figure 6-9	COD equivalent of CH_4 and the ratio of $COD_{CH_4}/COD_{total\ removed}$ for faecal sludge	54
Figure 6-10	Volume of $CH_4/COD_{total\ removed}$ and volume of $CH_4/TVS_{removed}$ for faecal sludge	55

List of Plates

Plate 1	A vacuum tanker discharging faecal sludge onto the ground to flow into a nearby stream	2
Plate 2	Discharged faecal sludge draining overland through bushes to nearby stream	2
Plate 3	Communal bucket latrine showing the openings into which buckets are placed...	3
Plate 4	Bucket filled with nightsoil and overflowing.....	3
Plate 5	A public toilet: non-flush aqua privy	4
Plate 6	Aqua privy – squat hole arrangement	4
Plate 7	Aqua privy – squat hole	5
Plate 8	A public toilet: multiple pit VIP latrine locally called the KVIP	5
Plate 9	Squat hole arrangement in the KVIP	6
Plate 10	A typical household septic tank at the end of the drive way with vent pipes showing	6

Abbreviations

BOD	Biochemical Oxygen Demand
COD	Chemical Oxygen Demand
EAWAG	Swiss Federal Institute for Environmental Science & Technology
FSTP	Faecal Sludge Treatment Plant
HRT	Hydraulic Retention Time
KNUST	Kwame Nkrumah University of Science and Technology
KVIP	Kumasi Ventilated Improved Pit
OLR	Organic Loading Rate
SANDEC	Department of Water and Sanitation in Developing Countries
TKN	Total Kjeldahl Nitrogen
TP	Total Phosphorus
TS	Total Solids
TSS	Total Suspended Solids
TVS	Total Volatile Solids
UASB	Upflow Anaerobic Sludge Blanket
VIP	Ventilated Improved Pit
VSS	Volatile Suspended Solids
WC	Water Closet
WRI	Water Research Institute
WRRRI	Water Resources Research Institute

1 Introduction

1.1 Background

In Ghana, one of the major environmental pollution problems faced is the indiscriminate disposal of a major percentage of nightsoil, toilet sludge and septage collected from urban cities and towns by vacuum tankers on to land and into water bodies (Plates 1 and 2). The nightsoil arises mainly from household and communal bucket latrines (Plates 3 and 4), whilst the toilet sludge is from household and public toilets, which may be non-flush aqua-privies (Plates 5, 6 and 7), single/multiple pit VIPs (Plates 8 and 9). The septage is from household and communal septic tanks connected to water closets (Plate 10).

Improper disposal of human excreta results in the contamination of water bodies, soil and food crops. This practice poses a serious health hazard because human excreta is the principal source of pathogenic organisms, which may be transmitted by direct contact, contaminated water and food, insects and other vectors. Human excreta *must* therefore be treated before its ultimate disposal into the environment or its use in agriculture in order to:

- a. reduce the spread of communicable diseases caused by excreted pathogenic organisms; and
- b. prevent the pollution of the environment, water sources and soil.

Recognising the environmental deficiencies that result from the indiscriminate disposal of nightsoil and faecal sludges, concerted efforts were put in to find treatment systems with technology suited to the socio-economic conditions of Ghana to treat and safely dispose of the faecal wastes. Research activities to find appropriate treatment options thus began in earnest in Accra, the capital city of Ghana, from 1986 under a waste management improvement project for the city.

In 1989/90, while these research activities were ongoing, a prototype faecal sludge treatment plant (FSTP) consisting of a solids-liquid separation step in settling/thickening tanks, followed by a series of four waste stabilisation ponds, a trickling stack, a “maturation pond” and a series of evaporation beds was built at Achimota, north of Accra to:

- i. reduce the incidence of unauthorised dumping and the cost of haulage from the north of Accra to the beach, and
- ii. obtain adequate operational data for system components of a prototype plant.

The solids separated in the settling/thickening tanks are used for composting while the liquid fraction is treated in the ponds following the settling/thickening tanks. A schematic diagram of the prototype FSTP is shown in Figure 1.1. The building of this plant made Ghana “one of the first countries to set up and operate plants for the separate treatment of sludges from septic tanks, bucket latrines and public toilets” (Heinss *et al.* 1998). Since then a number of other FSTPs have been constructed to test new conceptual designs in an attempt to improve upon operational performance. Under an ongoing urban environmental sanitation project, which is partly aimed at improving excreta management by providing facilities for the treatment of nightsoil and faecal sludge, new FSTPs are being planned for the country’s five major cities.

Between 1993 and 1997, the Achimota plant was monitored and evaluated under a collaborative research programme between the Water Research Institute (WRI) [formerly Water Resources Research Institute (WRRI)] of Ghana, and the Department of Water and Sanitation in Developing Countries (SANDEC) of the Swiss Federal Institute for Environmental Science & Technology (EAWAG). The purpose of the research programme was to provide additional and adequate data to enable the preparation of design and operational management guidelines for faecal sludge treatment. The field research results from the monitoring and evaluation of FSTPs in the tropics (Heinss *et al.* 1998) including the Achimota plant, while proposing preliminary design guidelines, also indicate that there are still some teething problems associated with the existing plant. Thus there is the need for more applied research to consolidate the results obtained to date and to explore other sustainable treatment options



Plate 1 A vacuum tanker discharging faecal sludge onto the ground to flow into a nearby stream



Plate 2 Discharged faecal sludge draining overland through bushes to nearby stream

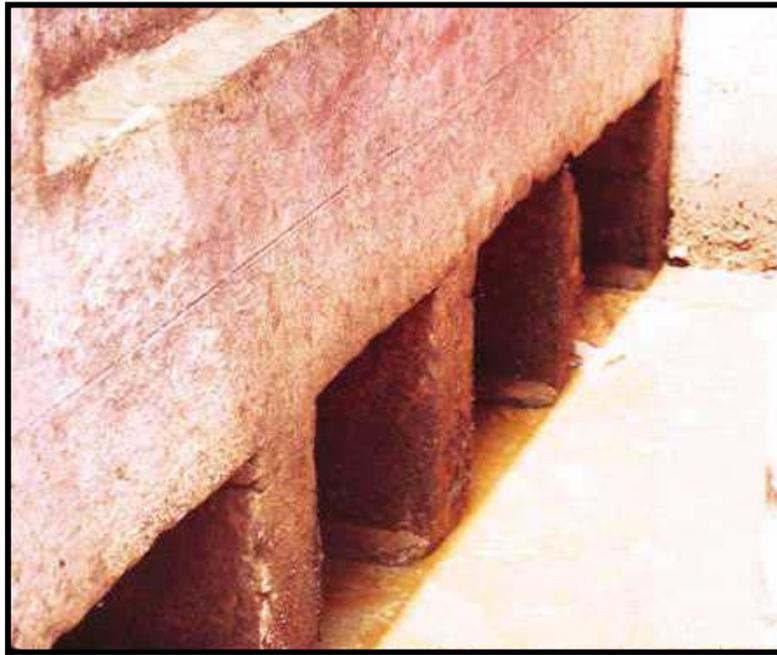


Plate 3 Communal bucket latrine showing the openings into which buckets are placed



Plate 4 Bucket filled with nightsoil and overflowing

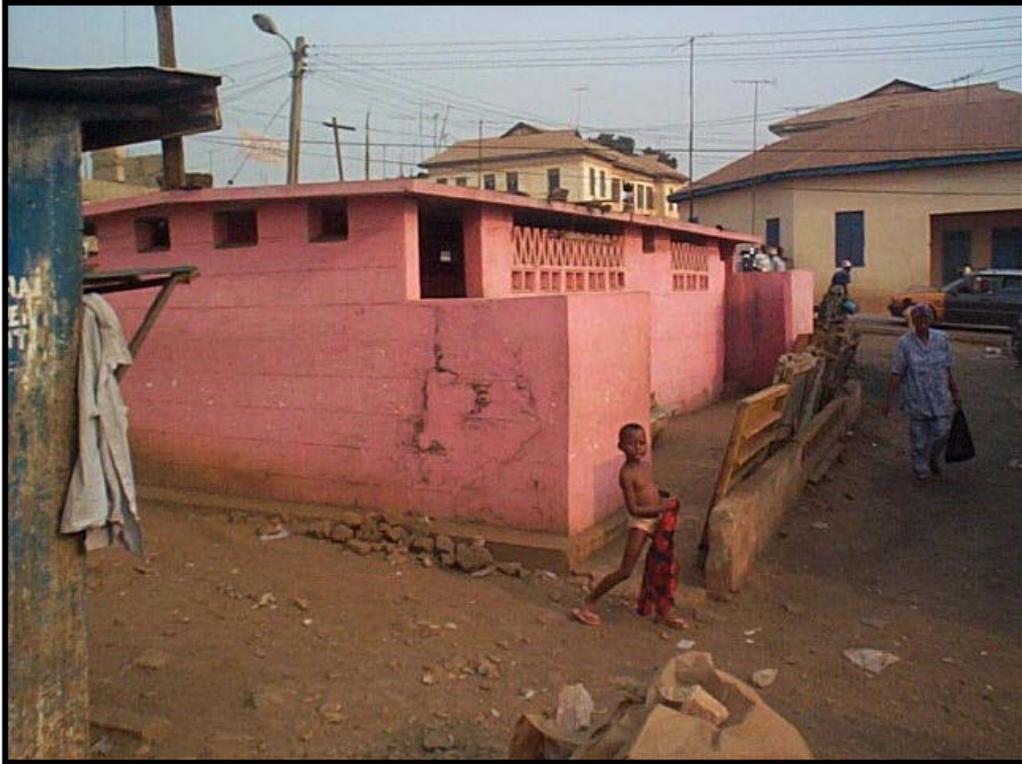


Plate 5 A public toilet: non-flush aqua privy



Plate 6 Aqua privy – squat hole arrangement



Plate 7 Aqua privy – squat hole



Plate 8 A public toilet: multiple pit VIP latrine locally called the KVIP



Plate 9 Squat hole arrangement in the KVIP



Plate 10 A typical household septic tank at the end of the drive way with vent pipes showing

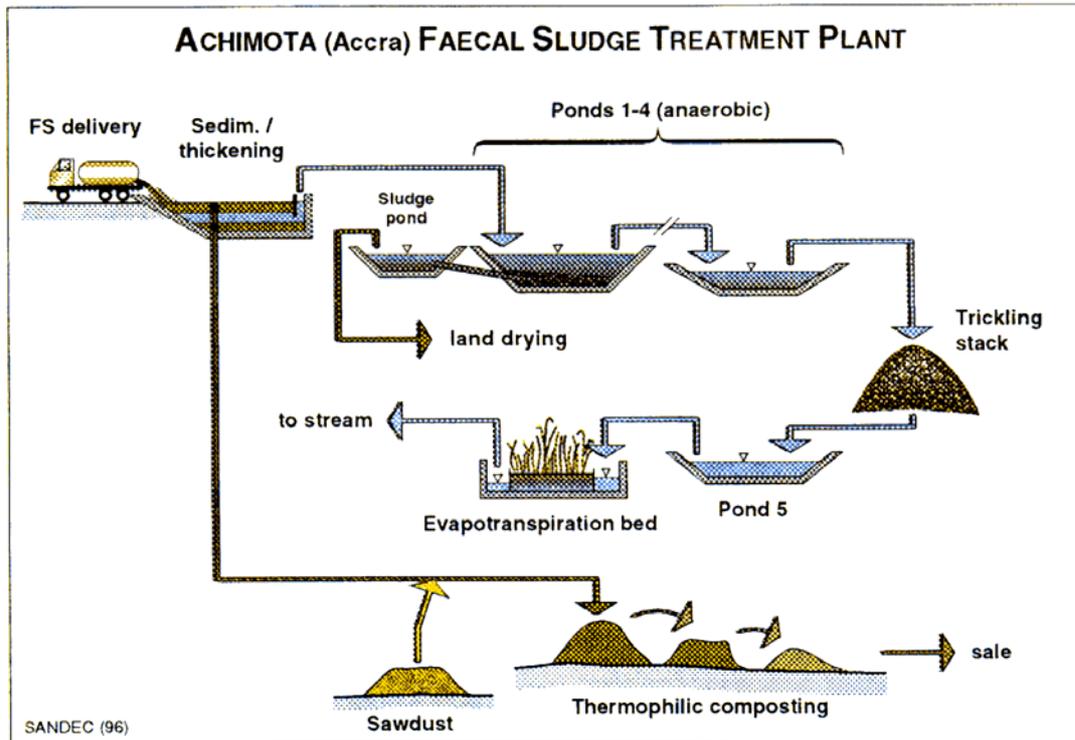


Figure 1-1 Schematic diagram of the Achimota Faecal Sludge Treatment Plant

Source: Heinss et al. (1998)

1.2 Problem Statement

The environmental deficiencies and health hazards that result from the indiscriminate disposal of human excreta or their use in agriculture are well documented. The practice, however, continues in Ghana and many other developing countries. This could be attributed to a number of factors, namely:

- i. the absence of tested and suitable technologies to treat faecal sludges in developing countries;
- ii. a lack of treatment plants and that fact that only a few have been built to date resulting in an overall shortage of treatment capacity to handle the volume of faecal wastes generated; and
- iii. poor operation and maintenance of existing treatment facilities leading to malfunctioning and eventually their breakdown.

In a developing country like Ghana, treatment facilities should:

- a. be technologically appropriate, i.e. low-cost both in capital and operating costs, simple to construct, operate and maintain (compatible with available expertise);
- b. need little or no imported equipment;
- c. not be energy-intensive; and
- d. be able to treat the wastes to at least secondary level, with emphasis on the removal of pathogens and helminth eggs.

As already stated, in Ghana, there are a number of FSTPs in operation and these satisfy the above criteria for treatment facilities in a developing country. However, as shown by the collaborative research results (Strauss *et al.* 1997; Heinss *et al.* 1998), the nature of the wastes (Table 1.1) is such that current FSTPs alone cannot be relied upon for their effective treatment.

The results from the monitoring and evaluation of the Achimota FSTP by WRI/SANDEC indicate that the current system could be effective in the treatment of the septage because the solids easily separate from the liquid in the settling/thickening tanks ensuring that only the liquid fraction flows

Table 1-1 Characteristics of Faecal Sludges from On-site Sanitation Systems in Accra, Ghana

Parameter	Public Toilet Sludge	Septage
BOD (mg/l)	8,800 (3,800 - 15,000)	630 (360 - 1,300)
COD (mg/l)	47,600 (10,400 - 97,000)	8,500 (820 - 52,000)
TS (%)	-	1.4 (0.3 - 11.4)
TVS (% of TS)	62	63
TSS (%)	6.4 (2 - 19)	0.7 (0.07 - 3.4)
VSS (% of TSS)	58	70
Helminth eggs (no./l)	29,000 (3,600 - 62,000)	4,300 (200 - 13,000)

Source: WRR/SANDEC, 1994

into the pond system for treatment. The FSTP can also, to some extent, treat mixtures of nightsoil/toilet sludge and septage (the mixtures containing higher proportions of septage) if operational and design guidelines are adhered to. With regards to the nightsoil/toilet sludges the results from the monitoring and evaluation of the Achimota FSTP indicate that the nightsoil/toilet sludges are hardly conducive to solids-liquid separation, the first step in the present FSTP design. This results in the faecal sludge flowing into the pond system and causing the system to fail from overloading due to high organic strength and high concentrations of ammonia. Heiness *et al.* (1998) attribute the lack of solids-liquid separation to the fact that the nightsoil/toilet sludges are mostly fresh i.e. undigested and highly concentrated compared with the septage. The solids-liquid separation can be improved by digesting the nightsoil/toilet sludges. The purpose of this paper is to discuss the possibility of using the Upflow Anaerobic Sludge Blanket (UASB) reactor as a treatment process to digest the high-strength nightsoil/toilet sludges prior to using the FSTP.

1.3 Choice of the UASB Reactor

The UASB reactor was selected for this technical paper after initial consultation on, and examination of the nature of the problem to be addressed. The selection was also influenced by the fact that an UASB reactor has been built as part of a new sewage treatment works (the Korle Lagoon Sewage Treatment Works) for Accra by Taylor Woodrow International under the Accra Waste Project financed by the Department for International Development (DFID).

Although the UASB reactor has been designed primarily to treat raw sewage, adequate provision has been made in the design for 40 m³/d (about five tanker loads) of faecal sludge to be added to the raw sewage. It is hoped that the findings from this technical review could result in the review of the design and the amount of faecal sludge that can be added to the raw sewage without the risk of overloading the treatment plant and also encourage further research investment in this area.

2 Literature Review

2.1 Introduction

In Ghana and most developing/newly industrialised countries, disposal of human excreta is through on-site sanitation systems and not by water-flush toilets connected to centralised sewerage systems. Whilst the treatment of wastewater from centralised sewerage systems by conventional treatment systems are well developed in the western and industrialised countries and hence the abundance of literature on them, the same cannot be said of the treatment of nightsoil and toilet sludge from on-site sanitation systems. Relatively, very little has been published to date on the treatment of nightsoil and toilet sludge, especially utilising low-cost technology appropriate to the needs of developing countries (Pescod, 1971; Heiness *et al.* 1998). It is thus desirable to carry out a review of the literature to gather the information available to date on the treatment of nightsoil and toilet sludge with the view of learning from what has been and is being done, and to serve as a basis for the present research.

2.2 Definitions: nightsoil, toilet sludge, septage and faecal sludge

2.2.1 Introduction

It is essential to define the terms “nightsoil”, “toilet sludge”, “septage” and “faecal sludges” as used in this literature review since they are the focus of the research. The definitions are also essential to establish consistency in the use of the terms throughout this literature review, eliminating any ambiguity in their use as it appears in the literature, especially with “nightsoil”. Furthermore, the definitions will be necessary to distinguish between the various terms as they are used in reference to human body wastes.

2.2.2 Nightsoil

In the literature, both terms “nightsoil” as one word and “night soil” as two words are used interchangeably. In this review, “nightsoil” will be used. This term is mostly used to represent, in general, a mixture of human faeces and urine. In certain instances, the term is also used to represent a mixture of human faeces and urine that has undergone some considerable putrefaction. Pradt (1971), Mara (1976), Satyanarayan *et al.* (1987) and Choi *et al.* (1997) all use the term for a mixture of human faeces and urine. Mara and Caincross (1989) use the term for “a mixture of human faeces and urine transported without flushing water”. Caincross and Feachem (1993) state that “nightsoil comprises only faeces and urine plus small volumes of water if it is used for anal cleansing and pour-flushing”. Stoll and Parameswaran (1996) refer to the contents from septic tanks/leaching pits which are connected to pour flush latrines in Bangkok as nightsoil. Choi *et al.* (1996) use the term for contents of cesspool and holding tanks/storage pits in Korea where it is stored for more than three months before being collected.

Some of the listed references indicate how loosely the term nightsoil is used by some authors. It is desirable to use the term consistently and in a specific manner in standard technical texts and literature. This would help in the search for and sharing of information from research findings. In this review, nightsoil is used for “a mixture of human faeces and urine that is mostly fresh”.

2.2.3 Toilet Sludge

In conventional wastewater treatment, the objectives are accomplished by concentrating the impurities into solid and semisolid residuals and then separating them from the bulk liquid. The concentration of the solid and semisolid residuals is referred to as sludge (Peavy *et al.* 1985; Metcalf & Eddy, Inc., 1991). The solid and semisolids residuals are removed from the bulk liquid after primary and/or secondary treatment. The sludge has thus undergone some measure of treatment, although it may be inadequate for its ultimate disposal.

In Ghana and developing countries, where conventional sewerage and treatment systems are mostly absent, various forms of on-site sanitation facilities are utilised. These on-site sanitation facilities could be either water dependent, e.g. pour flush, water closet and aqua privies, or non-water dependent e.g. bucket, ventilated improved pit (VIP) and vault latrines. The human body wastes may be stored in these on-site sanitation facilities for a couple of days to several years depending on the type of facility, its storage capacity, emptying frequency and the collection/ transportation system is use.

For the non-water dependent systems, when the mixture of faeces and urine is stored for a couple of days (up to 3 days) as in the case of bucket latrines, the contents may still be fresh and hence would be referred to nightsoil. However, when nightsoil is stored for longer periods as in the case of “dry” aqua-privies, watertight vented and non-vented toilets with no or low flush water, and holding tanks, the nightsoil undergoes some digestion (little or partial). This category of little or partially digested nightsoil, i.e., nightsoil that has undergone some measure of treatment, collected from the non-water dependent systems is referred to as “toilet sludge” throughout this document.

2.2.4 Septage

As mentioned in the previous section, some of the on-site sanitation facilities at homes, offices, commercial houses and institutions are water dependent. In the water dependent on-site sanitation facilities, the human excreta is flushed out using water. The resulting wastewater (mixture of flush water, faeces and urine) is discharged into septic tanks, where the solid fraction settles out and undergoes anaerobic digestion. The effluent from the tank is usually discharged into a subsurface-soil absorption system for final treatment and disposal. The combination of the sludge produced in the septic tank as a result of the anaerobic digestion of the settled solids, scum and liquid pumped from a septic tank is known as septage.

2.2.5 Faecal Sludge

The collection and transportation of nightsoil, toilet sludge and septage from their various sources to the final treatment/disposal sites is done by vacuum trucks. Depending on their capacities, haulage distances and socio-economic conditions, the vacuum trucks may carry loads of only toilet sludge, septage or mixtures of both. Most often, the contents of the trucks are mixtures of both toilet sludge and septage and hence difficult to distinguish between the wastes that arrive at the treatment/disposal sites. It is thus appropriate to have a term that would include all types of faecal wastes coming from the on-site sanitation systems that have undergone some measure of digestion. The term faecal sludge, as used by Strauss *et al.* (1997) and Heinss *et al.* (1998), is used in this review for “all sludges (little or partially digested) collected and transported from on-site sanitation systems by vacuum trucks”.

2.3 Quantities, Characteristics and Classification of Faecal Sludges

2.3.1 Per Capita Quantities of Faecal Sludges

As with wastewater, determining the quantities of faecal sludges is an essential and fundamental step in the planning and design of collection, treatment and disposal facilities. Reliable data on faecal sludge quantities are needed if the facilities are to be designed properly with adequate capacities. As reported by Martin *et al.* (1997), the per capita quantities reported in the literature vary widely for both nightsoil and faecal sludges. Table 2.1 shows the overall averages of the daily per capita volumes and constituent contributions in nightsoil and faecal sludges in Accra, Ghana.

The daily per capita volume for septage in Table 2.1 (1 l/cap. day) is rather low considering that, on a per capita basis, more water is used in flushing water closets than in public toilets and bucket latrines. Heinss *et al.* (1998) do not offer any explanation for this rather low figure.

Table 2-1 Daily Per Capita BOD, TS, TKN Quantities of Different Types of Faecal Sludges

Parameter	Septage ¹	Public toilet and bucket latrine sludge ¹	Fresh excreta
BOD g/cap. day	1	16	45
TS g/cap. day	14	100	110
TKN g/cap. day	0.8	8	10
l/cap. day	1	2 (includes water for toilet cleansing)	1.5 (faeces and urine)

Source: Heinss *et al.* (1998).

¹ Estimates are based on faecal sludge collection survey conducted in Accra, Ghana.

TS (total solids = residue after evaporation at 103 °C)

2.3.2 Characteristics of Faecal Sludges

An understanding of the nature of faecal sludges is essential in the design and operation of collection, treatment and disposal facilities. Characterisation of the physical, chemical and biological composition of faecal sludges is a major step in understanding their nature. However, compared with wastewater and sludges generated in the western and industrialised countries, very little has been done to date to characterise faecal sludges from on-site sanitation systems in developing countries. This is mainly due to the fact that in developing countries, analytical techniques for the assessment of the characteristics of wastes and waste treatment plants are not routinely applied as pertains in western and industrialised countries. There are no selected variables on which to base the assessment and also a lack of standard methods of analysis suited for developing countries.

As noted by Pescod (1971), Pradt (1971), Um and Kim (1986), Guo *et al.* (1991) and Strauss *et al.* (1997), the characteristics of collected faecal sludges vary greatly. The characteristics depend, among others, on the season, type of the on-site sanitation system (e.g. water closet/septic tank system, “dry” aqua privy, watertight vented pit latrines), the emptying frequency (i.e. is the retention time in the facility), the extent of stormwater or groundwater infiltration into the sanitation facility, and on user habits. This section presents and discusses the characteristics of faecal sludges as contained in the literature to date.

2.3.2.1 Septage

As with all faecal sludges, and noted by Metcalf & Eddy, Inc. (1991), the actual quantities and constituents of septage vary widely, the greatest variation being found in communities that do not regulate the collection and disposal of septage. Undoubtedly, this is the situation which occurs in a developing country like Ghana. In the industrialised countries, where the collection and disposal of septage is well regulated, septage is well characterised compared to developing countries. Furthermore very few data exist on the characteristics of septage in developing countries. Typical constituents found in septage in industrialised countries and Accra, Ghana, are given Tables 2-2.

Table 2.2 shows a wide range of variation of the constituents. The typical values for Accra with tropical climate are, however, much lower than the typical values reported by Metcalf & Eddy, Inc. (1991), mostly for industrialised countries located in temperate climates. For example the BOD₅ reported by Metcalf & Eddy, Inc. ranges from 2,000 – 30,000 mg/l with a mean value of 6,000 mg/l while that reported by Strauss and Heinss (1995) range from 360 – 1,300 mg/l with a mean value of 630 mg/l. The lower values for Accra could be partly attributed to:

1. the higher degree of mineralisation in the tropical septage due to higher temperature conditions associated with tropical climates among others.
2. when desludging septic tanks, vacuum tanker operators have the tendency of pumping only the top clarified liquid portion.

It is established that the rate of anaerobic digestion, which could be measured by the rate methane fermentation, is higher at high temperatures (Table 2.3). Unheated anaerobic treatment systems would therefore perform better in tropical climates than temperate climates because ambient temperatures are much higher. Table 2.3 shows that the rate of methane fermentation at 25°C or more is at least twice the rate which occurs when the temperature 15°C or less, the temperature being the temperature at which the fermentation is taking place.

The high degree of mineralisation of tropical septage influences the characteristics of septage and ultimately affect the type of treatment/disposal facilities that could be utilised. Mara *et al.* (1992) for instance argue that “anaerobic ponds are of no purpose as septage is already highly mineralised”, while Strauss *et al.* (1997) are of the view that “a first anaerobic stage might offer advantages even at moderate BOD and TVS reduction efficiencies, and may result in smaller land requirements than by directly feeding the septage into a facultative pond”.

Table 2-2 Typical characteristics of septage

Constituent	Concentration, mg/l			
	Metcalf & Eddy, Inc. (1991)		Strauss and Heinss (1995) (Accra, Ghana)	
	Range	Typical	Range	Typical
TS	5,000 - 100,000	40,000	3,000 - 114,000	14,000
TSS	4,000 - 100,000	15,000	700 - 34,000	7,000
VSS	1,200 - 14,000	7,000	490 - 23,800	4,900
BOD ₅	2,000 - 30,000	6,000	360 - 1,300	630
COD	5,000 - 80,000	30,000	820 - 52,000	8,500
TKN as N	100 - 1,600	700	-	-
NH ₃ as N	100 - 800	400	-	-
TP as P	50 - 800	250	-	-
Heavy metals ^a	100 - 1,000	300	-	-
Helminth eggs, (no./l)	-	-	200 - 13,000	4,300

^a Primarily iron (Fe), zinc (Zn), and aluminium (Al);

Table 2-3 Estimated effect of temperature on anaerobic treatment

Temperature (°C)	Rate of methane fermentation relative to that at 35°C
5	0.1
15	0.4
25	0.8
35	1.0

Source: McCarthy (1966) [Cited by Mara and Sinnatamby, 1986]

2.3.2.2 Nightsoil and Toilet Sludge

The characteristics of both nightsoil and toilet sludge (mainly from unsewered toilets) are presented in this section. The two have been merged because the literature hardly distinguishes between the characteristics of nightsoil and toilet sludge.

Generally, nightsoil and toilet sludge are more concentrated than septage because in majority of cases no flushing water is used. Even in cases where water is used (e.g. pour-flush latrines) the quantities are small compared to conventional water closet toilets. Table 2-4 shows reported analysis of collected nightsoil and toilet sludges in the literature. It is evident from the table there is no uniformity with respect to the constituents reported. Various authors report on parameters relevant to their particular research.

Almost all the data reported in the literature originate from Asia and tropical developing countries. The majority of the reported data are from Japan and South Korea. Values reported in Table 2.4 show nightsoil/toilet sludge contains very high concentrations of solids, with over 30% being suspended solids. The total volatile solids and volatile suspended solids constitute over 50% of total solids and over 60% of suspended solids respectively. This indicates a high organic content of the nightsoil/toilet sludge. The COD to BOD ratios range from 1.5:1 to 5:1. Thus of the organic content a considerable portion is biodegradable. The reported pH values in Table 2.4 ranges from 7.2 to 8.8 and the ammonium (NH₄-N) concentrations are high ($\geq 2,000$ mg/l). The number of helminth eggs is also high in the three reported cases (ranges from 3,600 – 360,000 eggs./L) indicating the unsafe nature of untreated nightsoil/toilet sludge.

Table 2-4 Characteristics of nightsoil/toilet sludge

Country	Japan	Japan	Korea	Korea	Korea	Korea
	Concentration (mg/l except pH and Helminth eggs)					
Parameter	1	2	3	4	5	6 (average of 10 samples)
pH	8.5	-	7.2	7.2 - 7.9	8.2 - 8.8	-
BOD ₅	10,190	12,900	22,100	12,600 - 19,200	16,800 - 22,900	13,400 - 19,000 (16,000)
COD _(Mn)	-	-	-	10,600 - 15,400	-	-
COD _(Cr)	-	36,700	64,700	-	38,600 - 44,600	34,700 - 63,900 (50,200)
TS	30,100	31,400	45,100	32,000 - 44,600	20,500 - 38,400	-
TVS	17,600	20,400	-	-	-	-
TSS	12,000	-	35,400	14,000 - 26,700	7,100 - 10,600	7,000 - 15,300 (11,300)
VSS	-	-	-	-	-	6,500 - 13,000 (9,800)
TKN	-	-	4,300	-	-	-
NH ₄ -N	3,471	-	-	-	-	-
Cl ⁻	4,671	-	4,100	3,800 - 5,600	-	-
PO ₄ ³⁻ - P	-	-	650	1,050 - 1,600	-	-

1. Iwai *et al.* (1962). The figures represent an average of analyses of ten samples of collected nightsoil
2. Ikeda (1965, 1966, 1968). Figures represent the average daily analyses for a seven day run at a test nightsoil processing plant at Yokohama.
3. Choi (1985).
4. Um and Lee (1982). Values measured from nightsoil comminuted into 5 mm particles and filtered.
5. Um and Choi (1984). Values measured from nightsoil comminuted into 5 mm particles and filtered.
6. Kim and Lee (1986). Values calculated from values of diluted samples used in experiment.

Table 2.4 Characteristics of nightsoil/toilet sludge (continued)

Country	Japan	Japan	Japan	Japan	Ghana	China
	Concentration (mg/l except pH and Helm. eggs)					
Parameter	7	8	9 (average)	10	11	12
pH (units)	7.61	8.48	-	-	-	-
BOD ₅	8,034	8,551	10,500 - 12,900 (11,600)	12,000	3,800 - 15,000 (8,800)	15,000 - 18,000
COD _(Mn)	4,966	6,356	3,340 - 8,200 (5,080)	5,900	-	-
COD _(Cr)	25, 118	-	-	26,000	10,400 - 97,000 (47,600)	26,000 - 33,000
TS	18,150	26,574	-	-	-	12,000 - 30,000
TVS	10,107	-	-	-	62% of TS	-
TSS	7,140	14,417	-	13,000	20,000 - 190,000 (64,000)	-
VSS	5,812	-	-	-	11,600 - 110,000 (37,000)	-
TKN	-	4,413	-	3,700	-	5,000 - 6,000
NH ₄ -N	2,430	2,979	2,100 - 3,140 (2,550)	3,010	-	-
NO ₂ -N	-	500	-	-	-	-
NO ₃ -N	-	132	-	-	-	-
Cl ⁻	-	4,386	2,300 - 3,800 (2,870)	-	-	-
PO ₄ ³⁻ - P	-	810	-	-	-	-
Hem. Eggs (no./l)	-	-	-	-	3,600 - 62,000 (29,000)	18,000 - 360,000

7. Noike and Matsumoto (1986)
8. Murata *et al.* (1986)
9. Suzuki and Tohya (1986)
10. Murakami *et al.* (1986)
11. Strauss and Heinss (1995)
12. Shiru and Bo (1991)

Table 2.4 Characteristics of nightsoil/toilet sludge (continued)

Country	Korea	Korea	Japan	Japan	Tropical Countries
	Concentration (mg/l except pH and Helm. eggs)				
Parameter	13	14	15	16	17
pH (units)	-	7.9	8.0 – 8.6	8.2	-
BOD ₅	-	19,000	11,000 – 14,000	12,130	COD:BOD 2:1 - 5:1
COD _(Mn)	-	-	-	4,305	-
COD _(Cr)	45,800	48,000	-	-	20,000 - 50,000
TS	-	-	-	26,120	≥35,000
TVS	-	-	-	11,880	-
TSS	33,500	25,000	14,000 – 20,000	-	-
VSS	26,700	21,000	-	-	-
TKN	4,480	6,000	4,200 – 5,200	4,335	-
NH ₄ -N	3,260	4,800	-	3,626	2,000 - 5,000
Cl ⁻	-	-	3,200 – 4,200	-	-
T-P	810	1,000	480 – 680	-	-
PO ₄ ³⁻ - P	630	600	-	-	-
Hem. Eggs (no./l)	-	-	-	-	20,000 - 60,000

13. Choi *et al.* (1996).

14. Choi *et al.* (1997).

15. Misaki and Matsui (1996) – the characteristic is dependent on the quality of human waste, the higher the percentage of collected human waste, the higher the characteristic.

16. Iwai *et al.* (1964).

17. Heinss *et al.* (1998)

2.3.3 Classification of Faecal Sludges

Faecal sludges, just as wastewater, can be classified depending on the concentrations of the constituents. However, throughout the literature, very little has been done on the classification. Most authors rather stress the fact that characteristics of faecal sludges differ greatly from municipal wastewater collected in centralised sewerage systems. As is evident from Tables 2.2 and Table 2.4, faecal sludges could be 10 to over 100 times more concentrated than municipal wastewater. Strauss *et al.* (1997) have classified faecal sludges into two broad categories: high-strength and low-strength (Table 2.5).

Table 2-5 Important Characteristics and Classification of Faecal Sludges

Item	High-strength	Low-strength	Sewage (for comparison)
Example	Public toilet or bucket latrine sludge	Septage	Tropical Sewage
Characterisation	Highly concentrated, mostly fresh FS, stored for days or weeks only	FS of low concentration; usually stored for several years; more stabilised	
COD mg/l	20,000 - 50,000	< 10,000	500 - 2,500
COD:BOD	2:1 - 5:1	5:1 - 10:1	2:1
NH₄-N mg/l	2,000 - 5,000	< 1,000	30 - 70
TS	≥ 3.5%	< 3%	< 1%
TSS mg/l	≥ 30,000	≈ 7,000	200 - 700
Helminth eggs /l	20,000 - 60,000	≤ 4,000	300 - 2,000

The classification is based on the concentrations of organics, ammonium, solids, and the degree of putrefaction. Thus the high-strength faecal sludges, as described in Table 2.5, are rather fresh and exhibit high concentrations of organics, ammonium and solids. These originate from on-site sanitation systems consisting mainly of bucket latrines, aqua privies, KVIPs and pour flush toilets. The low-strength faecal sludges are relatively weak, older and have undergone considerable digestion. Septage falls into this category.

3 Collection and Treatment of Nightsoil and Faecal sludge

3.1 Collection

3.1.1 Nightsoil

Traditionally, nightsoil is collected from buckets or nightsoil vaults situated immediately below the toilet by conservancy labourers. In Ghana, nightsoil is collected from both household or communal bucket latrines. The nightsoil collected by conservancy labourers is dumped either at authorised sites which may be holding tanks at designated sanitary sites or at unauthorised sites such as open drains, open refuse dumps and nearby bushes. This mode of collection has become increasingly unpopular because of the health hazards posed to both the conservancy labourers and the general public, and nuisance resulting from such dreadful collection practices. In Ghana, bucket latrines are now being converted into other low-cost on-site sanitation systems which eliminates the need for manual collection as described above. Nightsoil holding tanks, depending on their storage capacity and whether they are permanent or temporary structures, are emptied daily, after several weeks or even months by vacuum trucks and taken to final treatment/disposal sites.

3.1.2 Toilet Sludge and Septage

Both toilet sludge and septage from on-site sanitation facilities are collected by truck tankers fitted with vacuum pumps. In Japan, Pradt (1971) and Misaki and Matsui (1996) report that nightsoil accumulates in concrete vaults in individual houses in unsewered parts of the country. The toilet sludge is then collected every 3 - 4 weeks by a "vacuum car", which is small tank truck with a capacity of 2-4 m³ and equipped with a long 100 mm hose and a vacuum pump. Similar systems are used in most countries where toilet sludge and septage have to be collected from either individual houses or public on-site sanitation facilities. This system of collection, which is more hygienic, avoids the hazards from spillage and direct contact with human excreta. Figure 3-1 shows the flow of nightsoil, toilet sludge and septage in Ghanaian towns and cities.

3.2 Treatment

Various methods/processes used for the treatment faecal sludges from on-site sanitation facilities have been mentioned in the literature. Countries in Asia appear to be at the forefront in the development of treatment methods for faecal sludges, with Japan taking a leading role (Pradt, (1971); Misaki and Matsui, (1996)). The treatment methods that have been and are being used have been dictated by the treatment goals and objectives. Examples of the treatment methods in use are presented in Table 3.1.

Table 3.1 shows that technologies for the treatment of sewage sludge in industrialised countries have been modified and further developed, and used successfully in Southeast Asia, with Japan being at the forefront. As evident from Table 3.1, information from the Western World with regards to nightsoil treatment is lacking compared to information on conventional treatment methods. This has been attributed to the influence of the conquering Roman Legions who brought with them the technology of waterborne sewerage to the far reaches of their Empire (Pradt, 1971). In fact Pradt (1971) notes that "the Japanese are exclusively responsible for the development of a sophisticated body of night soil treatment technology." Both Japan and Korea have design manuals for nightsoil treatment systems. Most of the treatment plants are equipped with conventional anaerobic or aerobic digestion for

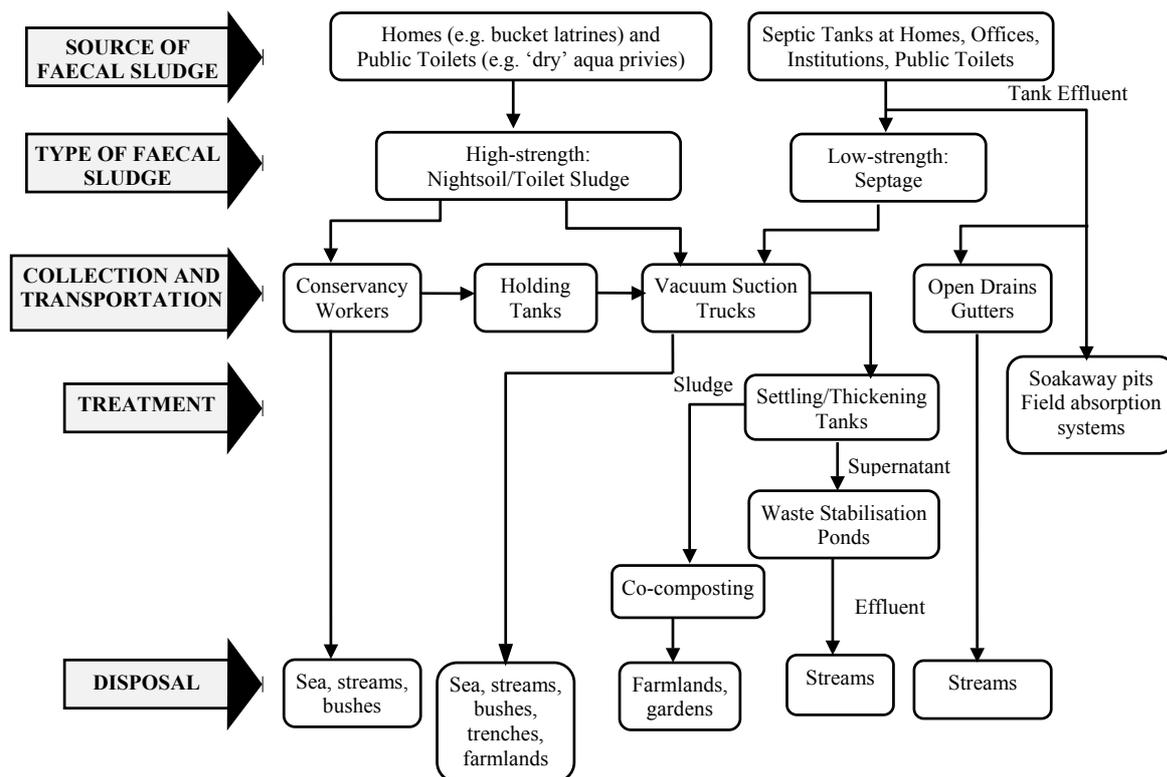


Figure 3-1 Schematic diagram of current situation showing sources, types, collection, transportation, treatment and disposal of nightsoil and faecal sludges in Ghana.

primary treatment. These involve high capital investment for equipment, use of energy intensive mechanical equipment, high costs of operation, and the need for skilled operators.

Despite this remarkable progress, the costs and sophistication of the technologies precludes their use in developing countries like Ghana, unless with further modifications to make them simpler in the application. Heiness *et al.* (1998) stress the fact that methods for treatment of faecal sludges in developing and newly industrialising countries should be relatively low-cost, i.e., low in capital and operating costs, and also compatible with the expertise available in the particular country. This cannot be said about the conventional anaerobic or aerobic digestion, and the nitrification and denitrification treatment coupled with advanced treatment systems as used in Japan and elsewhere.

Development of low-cost technology for the treatment of nightsoil and faecal sludge really lacks behind that of the conventional technologies. As evident from Table 3-1, the simple and low-cost technologies in use are waste stabilisation ponds or lagoons for the treatment of the supernatant after primary treatment. When lagoons are used solely they have their shortfalls as outlined by Heiness *et al.* (1998) which must be addressed to make them more effective. One major area that has to be addressed is the need for a pre-treatment system to reduce significantly the strength of the waste before using the pond system. As seen from Table 3-1, in most of the easier and simpler systems that can be adapted to suit conditions in developing countries, the reduction is achieved by using either conventional aerobic or anaerobic digestion followed by the addition of dilution water. In an integrated treatment system, the dilution water could be provided by recycling the final effluent from the treatment system.

Table 3-1 Examples of Faecal Sludge Treatment Systems

Country: Japan		
Type of Process	Reference	Remarks
<p>Conventional digestion process</p> <ul style="list-style-type: none"> • Conventional digesters used for sewage sludge digestion, however many of the digesters being unheated with holding periods of up to 90 days. • Aerobic treatment, usually trickling filters and the activated sludge process, are provided for the digester supernatant, after diluting it 20-40 times with fresh water. • The digested residue is dewatered by filter press, vacuum filter, centrifuge or sand bed • Cake is hauled away for fill or fertiliser, or sometimes incinerated 	Pradt (1971)	High installation cost
<p>Chemical treatment process</p> <ol style="list-style-type: none"> i. Chemical, including calcium hydroxide, alum, ferric chloride and ferrous sulphate, are added to precipitate and coagulate the solubilised solids ii. Supernatant and sludge from a thickener are treated as described for the conventional digestion process. iii. Considerable sludge is produced in this method compared to conventional digestion process. 	Pradt (1971)	Supernatant is more easily treated by aerobic methods than digester supernatant. Cost less to install, but highest operating costs. Used only as temporary facilities.
<p>Bio-oxidation treatment process</p> <ol style="list-style-type: none"> i. Pre-treatment by screening, settling or centrifugation ii. Dilution water is added to the centrate and then treated by conventional activated sludge process. iii. The solids slurry is first treated by chemical flocculation and dewatered by sand bed or mechanical filter 	Pradt (1971)	Installation cost less than that of a digester; operating cost about same level as a digester.
<p>Wet-air oxidation heat treatment system</p> <ol style="list-style-type: none"> i. Involves heating of faecal sludge for short periods of time under pressure ii. Water scrubber is used to clean gas released before being discharged into the atmosphere iii. Gravity settling is used to remove the residual solids. iv. Supernatant liquor is diluted with fresh water and treated by conventional activated sludge process. 	Pradt (1971)	Plant more expensive to install and operate. Discontinued in South Korea due to high power consumption, poor durability of equipment and facilities, and operational difficulties (Um and Kim, 1986)
Two-stage anaerobic digestion processes	Noike and Matsumoto (1986)	Gas production is almost completed in the first reactor; main role of second reactor is to separate supernatant from digested sludge by physical sedimentation.
Nitrified Liquor Recycling Process	Suzuki and Tohya (1986)	Over 100 plants; High removal rate for BOD and Nitrogen; some of the plants have been re-constructed from two stage anaerobic digesters

Table 3.1 Examples of Faecal Sludge Treatment Systems (continued).

Country: Japan continued		
Type of Process	Reference	Remarks
Low dilution: two-stage biological denitrification treatment + advanced treatment	Misaki and Matsui (1996)	Low dilution, two-stage biological denitrification involving a 10-times dilution. Used from latter half the 1970s
Advanced treatment: This is a combination of coagulation, sedimentation, ozone oxidation, sand filtration, and activated carbon absorption	Misaki and Matsui (1996)	Used from latter half the 1970s.
High-load denitrification treatment + advanced treatment.	Misaki and Matsui (1996)	System does not require additional water for dilution. Used from the early 1980s
High-load denitrification membrane separation treatment + advanced treatment.	Misaki and Matsui (1996)	System used ultrafiltration (UF) membranes and was put in operation in 1987. Over 50 constructed by 1994
Country: Korea		
Type of Process	Reference	Remarks
Extended aeration process (similar to aerobic digestion process) i. Pre-treatment (receiving, screening & holding) ii. Non-diluted aeration (15 days) iii. Supernatant treated by activated sludge process	Um and Kim (1986)	Rural ¹ type process. The aerobic process is effective in achieving a good level of effluent quality and has simpler operation and maintenance
Anaerobic digestion process ² i. Pre-treatment (receiving, screening & holding) ii. Conventional anaerobic digestion (30 days) iii. Diluted 10 times and treated by oxidation ditch process	Um and Kim (1986)	Rural type process.
Unheated digestion process (non-diluted) i. Pre-treatment (receiving, screening & holding) ii. anaerobic digestion (90 days) followed by oxidation pond process	Um and Kim (1986)	Rural type process
Anaerobic digestion process i. Pre-treatment (receiving, screening & holding) ii. Primary treatment of anaerobic digestion iii. Secondary treatment: 20 times dilution with water and then treated by activated sludge process iv. Effluent is disinfected and discharged	Um and Kim (1986)	Urban ² type process
Aerobic digestion process i. Pre-treatment (receiving, screening & holding) ii. Primary treatment: Non-diluted aeration process iii. Secondary treatment: 20 times dilution with water and then treated by activated sludge process	Um and Kim (1986)	Urban type process. The aerobic process is effective in achieving a good level of effluent quality.

¹Two main treatment systems are defined in the Design Manual for Korea - urban and rural types. In recent years, lagoons and RBC processes have also been constructed to treat supernatant as additional processes in rural type plants. Urban type plant include sludge treatment and deodorization processes

² Number of plants using anaerobic digestion process is continuously increasing, especially for the urban type; increase is attributed to the possibility of energy recycling and lower running costs

Table 3.1 Examples of Faecal Sludge Treatment Systems (continued).

Country: Korea		
Type of Process	Reference	Remarks
Two-stage activated sludge process i. Pre-treatment (receiving, screening & holding) ii. Primary treatment: diluted aeration process (20 times dilution) iii. Secondary treatment: 20 times dilution with water and then treated by activated sludge process	Um and Kim (1986)	Urban type process. No new plants since 1981 and existing plants are being modified; situation seems to be the result of excessive power costs and technical problems in operation and maintenance.
Single Stage Sequencing Batch Reactor	Choi <i>et al.</i> (1997)	Converted from an existing 2 stage ASP nightsoil treatment plant for nutrient removal
Country: China		
Anaerobic digestion for sludge treatment; Trickling filter for supernatant; Drying beds used in dewatering the digested sludge, which is used as fertiliser in the countryside	Guo <i>et al.</i> (1991)	Plant had to be modified after commissioning because the primary investigation on the characteristics of nightsoil was insufficient.
Country: India		
Either burial in the ground alone or with town refuse	Satyanarayan <i>et al.</i> (1987)	Creates fly and odour nuisance along with contamination of ground water by percolation and leaching
Composting of nightsoil along with town refuse	Satyanarayan <i>et al.</i> (1987)	Practice not well designed and hence results in breeding of flies, odour nuisance and incidence of helminth infections
Anaerobic digestion	Mara (1976)	Digested sludge is used as fertiliser; applied in liquid form
Country: Thailand		
Extended aeration followed by ponds, drying beds for separated sludge	Strauss and Heinss (1995)	
Country: Indonesia		
Type of Process	Reference	Remarks
Extended aeration followed by unplanned dumping of sludge generated at disposal sites	Stoll and Parameswaran (1996)	Priority options have been identified for sludge management and these are: 1. Mono-incineration after on-site dewatering 2. Direct agricultural use after on-site dewatering 3. Composting after on-site dewatering for agricultural use or land reclamation
Country: Ghana		
Batch-operated settling/thickening tanks followed by ponds, separated solids are windrow-composted with sawdust	Strauss and Heinss (1995)	Ponds operate in anaerobic regime, inhibition of algal growth from ammonia toxicity
Country: Nigeria		
Collected nightsoil is screened, diluted with make-up water, macerated and treated in aerated lagoons	Mara (1976)	
Country: Tanzania		
Co-treatment at central sewerage treatment facilities using waste stabilisation ponds	Strauss and Heinss (1995) Mgana (1997)	Faecal sludge mostly from urban areas; pre-treated in anaerobic ponds

In rural Korea, the reduction in the strength of the waste is achieved using unheated anaerobic digestion process for primary treatment of the undiluted nightsoil and lagoons or ponds to treat the supernatant from the digestion process (Um and Kim, 1986). Judging from the socio-economic and climatic conditions of Ghana and most developing countries, this approach may be the most favourably provided the unheated anaerobic digestion process could be adapted. The unheated anaerobic digestion system could fit well into the present faecal sludge treatment plants (FSTP) in operation in Accra and other cities/towns in Ghana. Figure 3-2 shows a treatment flowpath if the unheated anaerobic digestion process is incorporated into the current FSTPs.

Unheated anaerobic digestion should pose no problems in developing countries since ambient temperatures in tropical countries will be near the upper end of the optimal temperature range (16°C to 38°C) required by the mesophilic bacteria. Unheated anaerobic digestion studies carried out by Suchint (1967) [cited by Pescod (1971)] on sludge settled from fresh nightsoil indicated that anaerobic digestion was a suitable method for treating nightsoil sludge. Lagoons or ponds systems are well developed and are already in use in Ghana and other developing countries. They could be used in the treatment of the supernatant resulting from the unheated digestion process, after separation of the digested sludge.

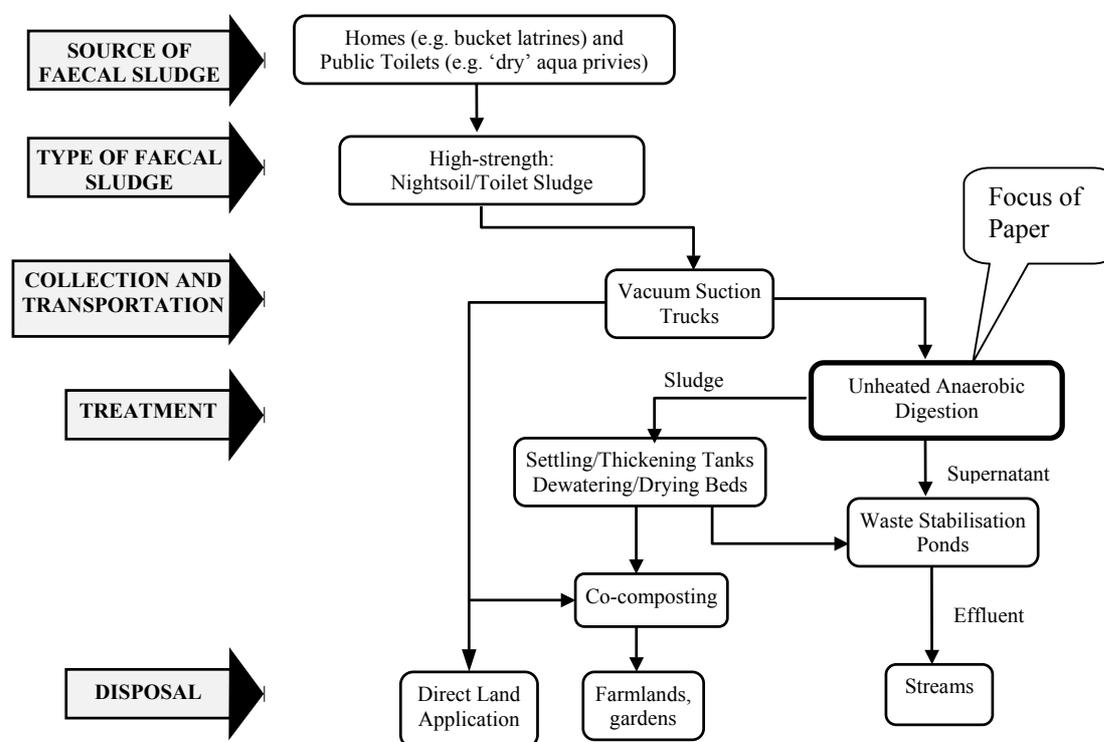


Figure 3-2 Treatment Flowpath for high-strength faecal sludge in Ghana incorporating unheated anaerobic digestion process

4 Anaerobic Digestion Process


4.1 Introduction

In today's world, the role played by treatment of wastes in the abatement of environmental pollution is well recognised by all countries, both developed and developing. In the field of human wastes treatment, conventional aerobic treatment systems have been well developed and used in the industrialised countries while their application in developing countries have been dismal. These aerobic treatment systems are energy intensive, use a lot of mechanical equipment and require trained and skilled personnel for smooth operation. With the steep rise in the costs of energy from the 1970's it has become imperative to develop alternate processes with lower energy consumption compared to energy required for aerobic processes. This is especially true for developing countries if waste treatment systems are to play any meaningful role in the fight against environmental pollution resulting from human wastes. The result of years of intensified research efforts is the development of alternate treatment systems that utilise anaerobic digestion instead of aerobic metabolism for the removal of organic material from human wastes. Anaerobic digestion has become increasingly popular because of the following advantages relative to aerobic methods (Pretorius, 1983; Mudrack and Kunst, 1986; Sterritt and Lester, 1988; Malina, 1992; van Haandel *et al.*, 1996):

- i. anaerobic digestion process requires considerably less energy and dispenses with the need for mechanical aeration, an essential requirement for aerobic processes;
- ii. useful energy may be recovered from methane, one of the end products;
- iii. relatively less sludge is produced and hence a resulting lower costs of disposal of the organic residues;
- iv. well-designed anaerobic processes have far greater treatment capacity than aerobic processes and therefore require a much smaller reactor volume; and
- v. many substances which are not degradable under aerobic conditions can be decomposed anaerobically.

4.2 Basic Concepts


Basically, anaerobic digestion is a bacterial fermentation process by which organic material is broken down in the absence of dissolved oxygen to produce stable end-products, mainly methane and carbon dioxide (McCarty, 1982; van Haandel *et al.*, 1996). van Haandel and Lettinga (1994) referred to the process as the ultimate fermentative process because it is characterised by the production of methane, which is the most reduced organic compound. For an organic matter $C_xH_yO_z$, the process of anaerobic digestion can be written as:



During the process of anaerobic digestion, only a minor fraction of the chemical energy in the organic matter is released, the major part remaining as chemical energy in the methane produced. McNerney *et al.* (1980) calculate that about 90% of the available energy in the organic matter is retained in the methane produced as illustrated in the following example using acetic acid (van Haandel and Lettinga, 1994): during the oxidation of acetic acid with oxygen, the free energy released is equal to 207 kcal mol⁻¹ in the reaction



Similarly, during the oxidation of methane with oxygen, the free energy released is equal to 191 kcal mol⁻¹ in the reaction



Acetic acid is digested to methane and carbon dioxide according to the following reaction



where E_{dig} is the free energy released.

The combination of equations 4.3 and 4.4 results in equation 4.2. Hence the free energy released from equations 4.3 and 4.4 must be equal to that released in equation 4.2.

$$E_{\text{dig}} + 191 = 207, \quad \text{hence } E_{\text{dig}} = 16 \text{ kcal mol}^{-1}$$

This shows that free energy released during the anaerobic digestion of acetic acid is only a fraction of $16/207 = 8$ percent of the free energy released during the aerobic oxidation of the same compound, the rest of the energy (92%) being retained in the methane. Furthermore, with the relatively large release of chemical energy very little energy is locked up in the new microbial cells produced during the process, and thus the relative amount of new microbial cells formed as surplus sludge is also small (Mosey, 1981).

The fact that dissolved oxygen is not needed for the process, that methane as a combustible gas has commercial value, and that the biomass production is relatively small makes the anaerobic digestion process ideal for the stabilisation of organic sludges, the treatment of concentrated organic industrial wastes and the production of methane gas from agricultural and domestic wastes (Pretorius, 1983).

Despite the advantages highlighted previously, the general acceptance and applicability of anaerobic digestion is only now beginning to rise within the last decade. The lack of general acceptance and applicability in the past (over a decade and half ago), have been attributed the following disadvantages (Pretorius, 1983; Mudrack and Kunst, 1986; Sterritt and Lester, 1988; Malina, 1992) which may no longer hold due to the advances in the knowledge of anaerobic digestion process and treatment technology:

- i. the lower rates of treatment attainable in anaerobic systems result in the treated effluent being fairly heavily polluted, and hence requiring further treatment before it can be discharged into receiving environment;
- ii. bacteriologically speaking it was a very complex system which was not fully understood making it difficult to rectify problems cropping up during the process;
- iii. the growth rate of certain members of the 'key' physiological groups responsible for the production of methane is very low at ambient temperatures so that the process becomes economically attractive only for wastes with temperatures at 25°C or above; and
- iv. long hydraulic detention times are required to develop and maintain a population of methane-producing bacteria.

Accepting that anaerobic digestion generally cannot provide a complete treatment, Lettinga (1995) dismisses the previously mentioned drawbacks based on the present state of knowledge of the anaerobic digestion process:

- i. with regard to the bacteriological complexity of the anaerobic systems, significantly more is known about the system today and gradually a better insight is being gained in the countermeasures that can be taken if problems arise in the operation of the system;
- ii. growth rates for the 'key' physiological groups responsible for the production of methane will be optimal when the anaerobic digestion process is applied in tropical climates where the ambient temperatures are within the mesophilic range.
- iii. the presumed low stability could be attributed to a lack of knowledge about the basic principles of the anaerobic treatment process. As a matter of fact, the anaerobic digestion process is highly stable provided the system is operated in the proper way;

- iv. much more is understood of the growth conditions of anaerobic organisms, and gradually large quantities of highly active anaerobic sludge from existing full-scale installations are becoming available, so that start-up of new systems can be made within a few weeks, sometimes even a few days.

4.3 Conversion Processes in Anaerobic Digestion

The process of anaerobic digestion of organic matter involves a number of transformations of the macromolecules present by several micro-organisms. Six distinct conversion processes have been identified in the degradation of particulate organic material to methane by Gujer and Zehnder (1983). These six processes are:

1. Hydrolysis of particulate organic material (biopolymers).
 - a. Hydrolysis of proteins
 - b. Hydrolysis of carbohydrates
 - c. Hydrolysis of lipids
2. Fermentation of amino acids and sugars.
3. Anaerobic oxidation of long chain fatty acids and alcohols.
4. Anaerobic oxidation of intermediary products such as volatile acids (with the exception of acetate).
5. Conversion of acetate to methane
6. Conversion of hydrogen to methane.

Gujer and Zehnder (1983), Sterritt and Lester (1988) and van Haandel and Lettinga (1994) place these six distinct reactions in the conversion processes into four phases which are illustrated in Figure 4.1.

4.3.1 Hydrolysis

In general bacteria are not able to take up particulate organic material since it first has to be broken down into soluble polymers or monomers. Thus hydrolysis or liquefaction is the first step required for microbial utilisation of the complex biopolymers. In the hydrolysis process the particulate organic matter is converted into dissolved compounds of a lower molecular weight. Proteins are degraded to amino acids, carbohydrates are transformed into soluble sugars (mono- and disaccharides) and lipids are converted to long chain fatty acids and glycerine. Exo-enzymes, excreted by fermentative bacteria, are required for this process (van Haandel and Lettinga (1994) and Sterritt and Lester (1988)).

4.3.2 Acidogenesis

Once the particulate organic material has been converted into soluble compounds as a result of hydrolysis, the fermentative bacteria takes up the dissolved compounds. In this acid-forming phase, various short-chain organic acids (e.g. butyric acid, propionic acid, acetic acid) are formed, together with alcohols, and mineral compounds such as carbon dioxide, hydrogen, ammonia and hydrogen sulphide gas. This phase is carried out by a diverse group of bacteria, most of which are obligate anaerobes. However, Mudrack and Kunst (1986) and van Haandel and Lettinga (1994) state that some facultative bacteria are also involved and metabolise organic matter via the oxidative pathway. In this way, the little dissolved oxygen that might otherwise become toxic to the obligate anaerobic organisms is utilised.

4.3.3 Acetogenesis

Among the products formed in the acidogenesis stage, only acetic acid (acetate), hydrogen and carbon dioxide can be converted by the methane bacteria directly into methane. Hence in this acetogenic phase, the other products of acidogenesis are transformed into acetate, hydrogen and carbon dioxide, the final products for methane production. As indicated in Figure 4.1, a larger percentage (approximately 70%) of the COD originally present is converted into methane via the acetate route. The production of acetate is generally accompanied by the formation of both hydrogen and carbon

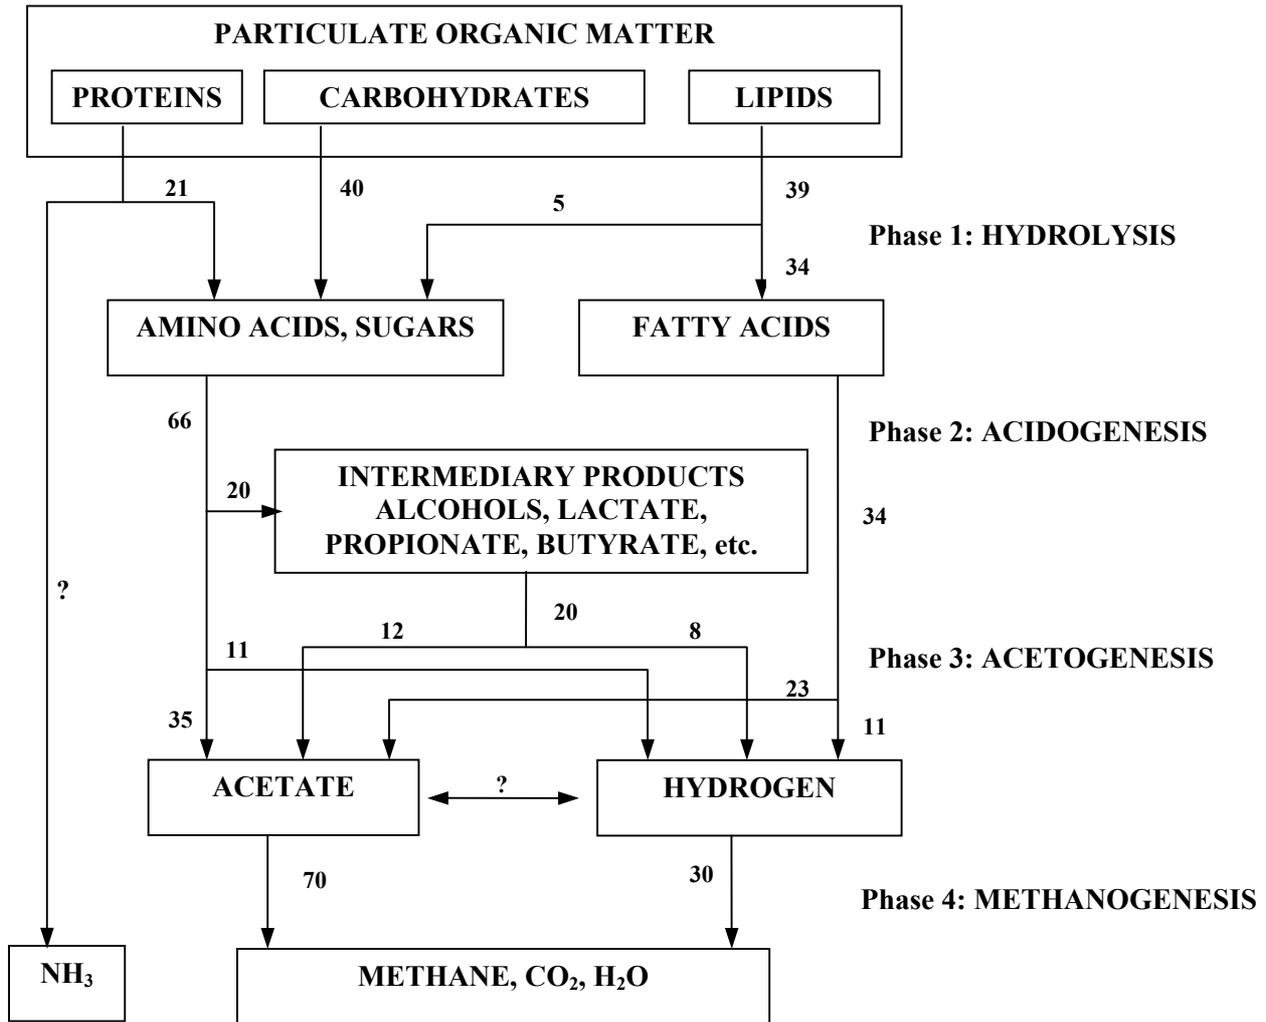


Figure 4-1 Reaction sequence for the anaerobic digestion of particulate organic material

(Numbers refer to percentages expressed as COD)

Source: Adapted from Gujer and Zehnder (1983), Sterritt and Lester (1988) and van Haandel and Lettinga (1994).

dioxide, with hydrogen being more than the carbon dioxide. Collectively, the related organisms responsible for the production of acetate and hydrogen in this phase are known as the obligatory hydrogen-producing acetogenic (OHPA) bacteria.

4.3.3.1 Methanogenesis

In this last and final phase, methane is produced from acetate or from the reduction of carbon dioxide by hydrogen using acetotrophic (Equation 4.5) and hydrogenotrophic (Equation 4.6) bacteria respectively.

Acetotrophic methanogenesis:



Hydrogenotrophic methanogenesis:

Methanogenesis is the final stage of the anaerobic digestion process and is of vital importance for the whole process. In particular, Henze and Harremoes (1983) state that the bacteria responsible for hydrogenotrophic methanogenesis grow faster than the bacteria which utilise acetate, and so the acetotrophic methanogenesis is the rate limiting step with respect to the transformation of particulate organic material to methane.

4.4 Organic nitrogen transformations

Total nitrogen is comprised of organic nitrogen, ammonia nitrogen, nitrite and nitrate. In faecal sludge the nitrogen is present principally as organic nitrogen and ammonia nitrogen and with only small amounts of nitrite and nitrate. In aqueous solution, ammonia nitrogen exists as either the ammonium ion or ammonia depending on the pH of the solution in accordance with the following equilibrium reaction:



Organic nitrogen is found in complex nitrogenous compounds such as proteins and urea. As shown in Figure 4.1, during the first phase of anaerobic digestion, the hydrolysis or liquefaction process degrades the proteins to amino acids and the subsequent deamination of these amino acids results in the release of ammonia nitrogen. The conversion of soluble organic nitrogen into ammonia nitrogen as bacteria consume soluble organic matter containing nitrogen is referred to as ammonification. Leslie Grady Jr. (1999) states that it is difficult to measure the true rate of ammonification because the ammonia nitrogen is being consumed by the bacteria as they grow, and the only measurable event is the net accumulation or loss of ammonia in the medium. There is accumulation of ammonia in the medium if the amount of nitrogen available exceeds the need. On the other hand there is a decrease in the concentration of ammonia in the medium if the amount of nitrogen is available is less than the need.

4.5 Stability of the Conversion Processes

Since the conversion processes in an anaerobic digestion depend on the interactions of several bacteria, maintaining the ecological balance and favourable environmental conditions are vital in preventing failure of the process. Important environmental factors of primary importance to the anaerobic digestion processes are temperature, pH, the presence of essential nutrients, and toxic or inhibitory substances. In nightsoil and toilet sludges, nutrients (both macronutrients -nitrogen and phosphorus, and micronutrients) are abundantly available and is therefore not considered.

4.5.1 Temperature

Anaerobic digestion processes, like other biological processes, strongly depend on temperature. The influence of temperature on the rate and extent of anaerobic digestion has been the subject of many investigations. With respect to the conversion rate of digestion processes, van Haandel and Lettinga (1994) state that there are maxima between 35 and 40°C for mesophilic range and at about 55°C for the thermophilic range. For an unheated anaerobic treatment, only the mesophilic digestion range is considered. Henze and Harremoes (1983) evaluated available data and Figure 4.2 shows a graphical representation of their analysis and of some recent data as reported by van Haandel and Lettinga (1994).

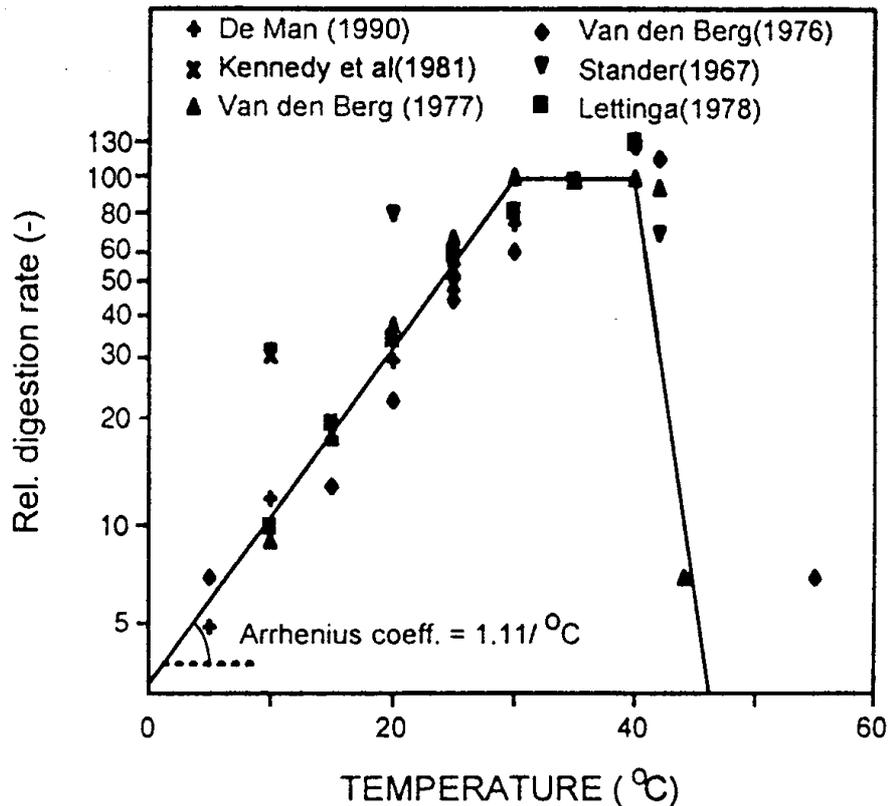


Figure 4-2 Influence of temperature on the rate of anaerobic digestion in the mesophilic range.

Source: van Haandel and Lettinga (1994)

From Figure 4.2, van Haandel and Lettinga (1994) drew the following conclusions:

1. that the optimum range is between 30 and 40°C, and
2. that for temperatures below the optimum range the digestion rate decreases by about 11 per cent for each °C temperature decrease, or according to the Arrhenius expression:

$$r_t = r_{30} (1.11)^{(t-30)} \quad (4.8)$$

where t = temperature in °C and r_t, r_{30} = digestion rate at temperature t and 30°C, respectively.

From their evaluation of available data, Henze and Harremoes (1983) reported that the anaerobic digestion processes can operate in the temperature range of 10-45°C without major changes to microbial ecosystem. For the various conversion processes described, Mudrack and Kunst (1986) state that the optimal conversion rates for the acid-forming bacteria (phases 1 to 3 in Figure 4.1) and the methanogenic organisms occur respectively at 30°C and 35-37°C. For temperatures below the optimum range, and in particular below 20°C, the conversion rate of lipids becomes very slow and hence the hydrolysis rate can be limiting for the overall rate of anaerobic digestion (van Haandel and Lettinga, 1994).

In addition to the influence of temperature on the rate of the anaerobic digestion process, the extent of the digestion is also affected as found by O'Rourke (1968) [cited by van Haandel and Lettinga (1994)] and Van der Last (1991). Figure 4.3 shows that for the same incubation time, the organic material

removal efficiency decreases as the temperature decreases. The decrease in the fraction of organic matter degraded is attributed to the low rate of hydrolysis at low temperatures.

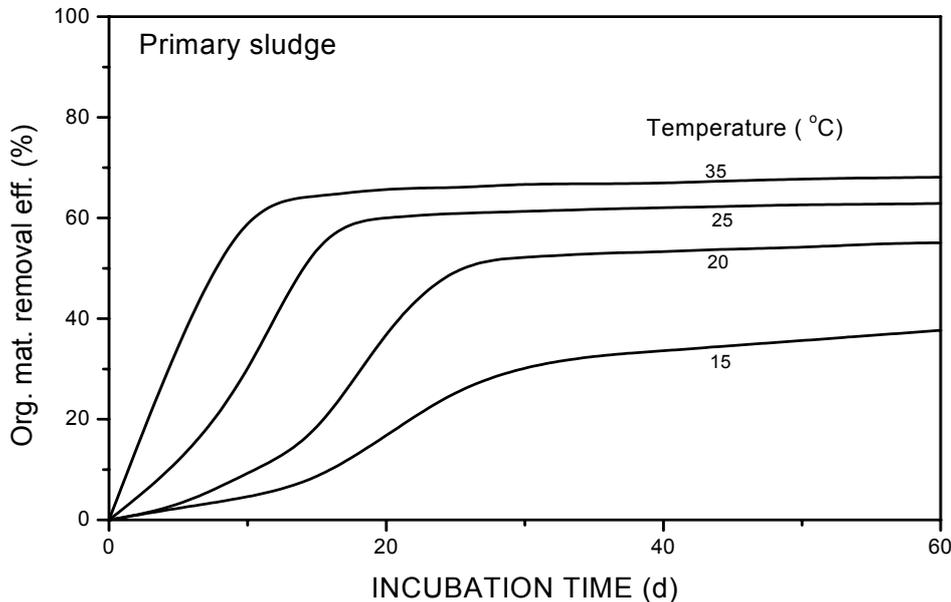


Figure 4-3 Influence of temperature on the extent and rate of anaerobic digestion of primary sludge.

Source: van Haandel and Lettinga (1994)

4.5.2 pH

Anaerobic digestion processes are dependent on pH. Hence it is very important that the value and stability of the optimal pH in an anaerobic reactor are maintained. Most anaerobic conversion processes operate best near neutral pH. The acid forming bacteria, acidogens, (responsible for phases 1 to 3 in Figure 4.1) have an optimum pH between 5 and 6 while the methane bacteria, methanogens, have pH-optimum in the range 6 and 8 (Zehnder *et al.*, 1981) for uninhibited methane formation. The methane forming bacteria are very sensitive to pH values outside the optimal range whereas the acid forming bacteria are significantly less sensitive to low or high pH values. The optimal pH conducive for the growth of bacterial populations in an anaerobic digester is in the range pH 6.4 to 7.6 beyond which a state of inhibition may occur resulting from the toxic effects of the hydrogen ions (Anderson and Yang, 1992). Specifically, at pH values lower than 6.3 or higher than 7.8 the rate of methanogenesis decreases (van Haandel and Lettinga, 1994). Because the formation of methane is the rate limiting step it is important to maintain the pH in the neutral range. However, in an anaerobic reactor, deviations from these optima do occur. These deviations, if not introduced with the influent, are usually the result of excess production and accumulation of acidic conversion products such as organic fatty acids (acidogens grow considerably faster than methanogens: Anderson and Yang, 1992), or basic conversion products such as ammonia.

4.5.3 Toxic Substances

Anaerobic digestion processes, like all other biological processes, can be affected by the presence of toxic substances. The toxicity or inhibition of the processes can be due to either introduction of the toxic substances with the influent or consequenced by the generation of intermediary products such as the volatile fatty acids. With respect to nightsoil and toilet sludge, the potentially toxic compounds that might be present apart from the hydrogen ion concentration are oxygen, sulphide (van Haandel and Lettinga, 1994) and ammonia (Henze and Harremoës, 1983).


Oxygen Toxicity

Some oxygen may be introduced in the influent, but this is used for oxidative metabolism in the acidogenesis process by facultative bacteria. Thus, practically, no dissolved oxygen will be present in the anaerobic reactor unless air is entrained together with the influent. In such circumstances, its introduction will be of no consequence for the performance of the reactor since it will be used for oxidative metabolism.

Sulphide Toxicity

Under anaerobic conditions, sulphite and sulphate are converted to sulphide, which has been implicated in exerting toxic effects on methanogenesis (Henze and Harremoes, 1983; Pohland, 1992; van Haandel and Lettinga, 1994). Thus of particular interest in the anaerobic digestion processes is the non-toxic sulphite and sulphate.

Sulphate is reduced to sulphide by sulphate-reducing bacteria (equation 4.9)



The toxicity of sulphide, which is normally present in solution as a weak acid, is closely related to free hydrogen sulphide concentration, which is pH dependent. At low pH (<6.5) the toxicity increases (Henze and Harremoes, 1983) since the percentage of free hydrogen sulphide is higher (Figure 4.4). Free hydrogen sulphide will inhibit at concentrations of approximately 100 mg S/l (Henze and Harremoes, 1983). Sulphide toxicity has been observed at concentrations ranging from 200 to 1500 mg/l (Stronach et al., 1986). However, according to results of Rinzema (1989) the sulphide concentration to be expected in anaerobic sewage treatment systems (up to 50 mg/l) is far lower than the minimum concentration of noticeable toxicity. Therefore sulphide toxicity may not be a problem in anaerobic sewage treatment systems.

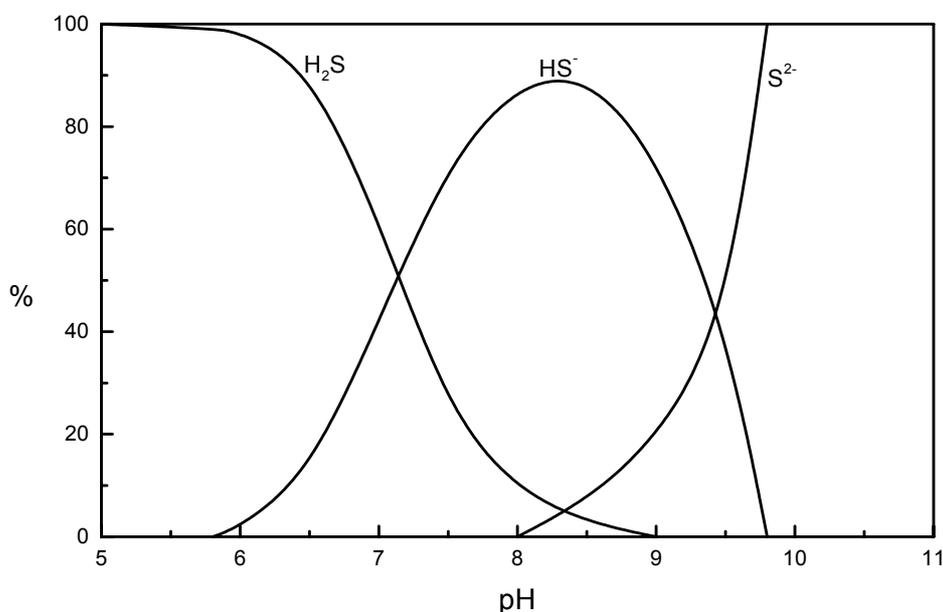


Figure 4-4 Effect of pH on hydrogen sulphide-sulphide equilibrium (10^{-3} molar solution, 32 mg H₂S/l)

Source: Sawyer and McCarty (1978)

At higher pH (>8) and in the presence of other cations, especially iron, ferrous sulphide is precipitated and this reduces the toxicity. In general, Henze and Harremoes (1983) state that sulphate-sulphur concentrations in the influent below 300 - 600 mg/l should be regarded as harmless, unless the pH and precipitation change the picture radically.

Ammonia Toxicity

Although ammonia nitrogen is a necessary nutrient for the growth of bacteria involved in the anaerobic process (McCarty, 1964; Mah et al., 1977; Angelidaki and Ahring, 1994), it becomes inhibitory to methanogenesis (Koster and Lettinga, 1984; McCarty, 1964) when the concentration exceeds a certain limit. This toxicity has been suggested to be due to free molecular ammonia (NH_3) (Sawyer and McCarty, 1978; Henze and Harremoes, 1983; Sprott et al., 1984; Zeeman et al., 1985; Koster and Koomen, 1988). Molecular ammonia exists in equilibrium with ammonium, the relationship being dependent on pH and temperature (Figure 4.5), the free ammonia concentration increasing with increasing pH and temperature. Methane fermentation of high ammonia containing wastes are more easily inhibited at thermophilic temperatures than at mesophilic temperatures (Braun et al., 1981; Parkin and Miller, 1983; Angelidaki and Ahring, 1994). Hashimoto et al. (1981) and Angelidaki and Ahring (1994) showed that temperature had no significant effect on methane fermentation for temperatures in the mesophilic range. For unadapted methanogenic cultures, free ammonia inhibition has been observed to commence at concentrations of 100-200 mg N/l (Braun et al., 1981; Henze and Harremoes, 1983; De Baere et al., 1984) and total ammonia + ammonium inhibition at concentrations of 1500-2500 mg N/l (Van Velsen, 1979; Hashimoto, 1986). However, by adaptation of the methane fermentation process to ammonia, tolerance to 4000 mg N/l of total ammonia + ammonium (Hashimoto, 1986; Angelidaki and Ahring, 1993) and tolerance of up to 700 mg N/l of free ammonia (Angelidaki and Ahring, 1993) has been demonstrated if the pH of the reaction medium is low. As seen from Figure 4.5, at pH values close to the neutral range, the percentage of molecular ammonia is almost zero.

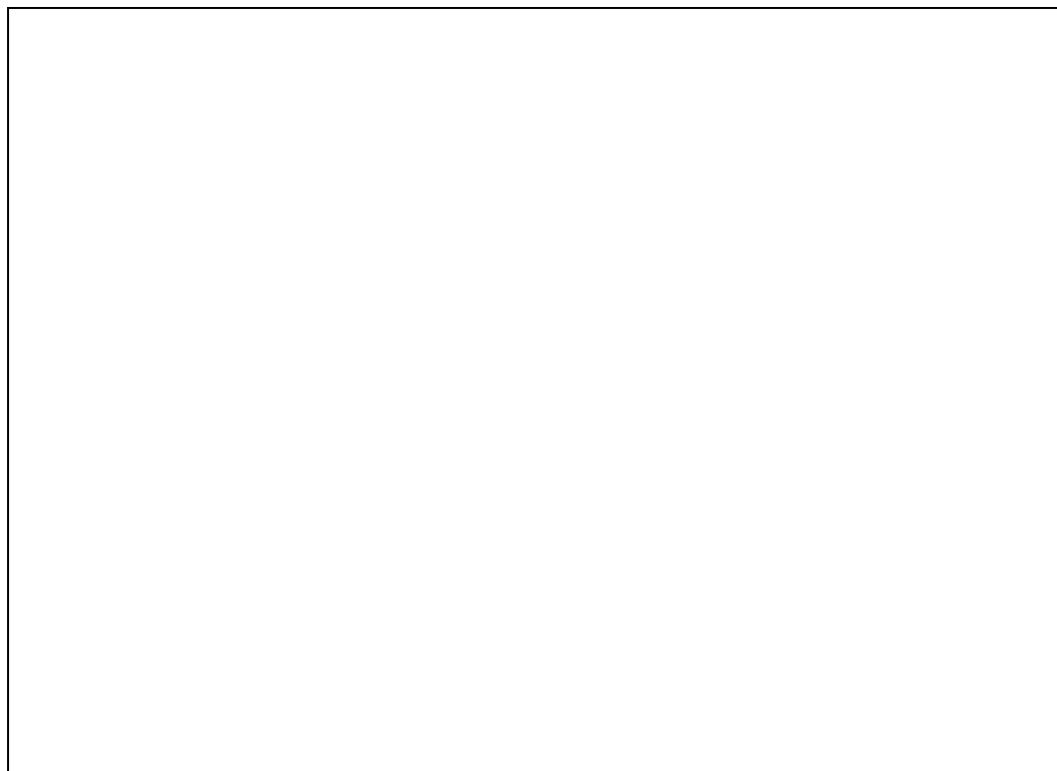


Figure 4-5 $\text{NH}_4\text{-N}$ and $\text{NH}_3\text{-N}$ as a function of pH and temperature

Source: Heinss *et al.*, 1998

4.6 Applicability of Anaerobic Digestion Process for the Treatment of Nightsoil and Toilet Sludges

Although literature on the direct use of anaerobic digestions processes for the treatment of nightsoil and toilet sludges is sparse, published work indicates that it is feasible to use anaerobic digestion process for the treatment of nightsoil and toilet sludge. The main task is getting the right environmental conditions and applying the treatment process suited to the socio-economic needs of a developing country like Ghana.

As described in the previous sections, anaerobic digestion processes can proceed under optimal conditions for all the bacterial groups involved if the following environmental conditions can be realised:

- i. For *temperature*, the most common range for conversion rate of the anaerobic digestion processes is reported to be 30-40°C, with the acid-forming bacteria and methanogenic organisms having optimal conversion rates at 30°C and 35-37°C respectively.
- ii. For *pH*, the more sensitive methanogenic organisms have an optimal conversion rate in the range 6.3 - 7.8, with values closer to the lower end of the range being favourably also to the acid forming bacteria.
- iii. With regards to toxic substances
 - a. sulphide toxicity can be prevented provided the sulphate-sulphur concentrations in the influent is below 300-600 mg/l and the pH is kept well above 6.5 but within the optimal range for methanogenic organisms
 - b. ammonia toxicity can also be prevented if pH values are in the neutral range, the influent total ammonia + ammonium concentration is up to 4000 mg N/l, and the concentration of free ammonia kept well below 100 mg/l.

As discussed in section 2.3, the main characteristics of nightsoil and toilet sludge from the literature are:

- i. high organic concentration with a considerable portion being biodegradable (COD>20,000);
- ii. pH values slightly above the neutral value;
- iii. the ammonium-nitrogen concentrations ranging from 2,000 - 5,000 mg/l; and
- iv. high solids concentration with considerable volatile portions.

Anaerobic processes are specially suited to the treatment of heavily contaminated organic wastes with COD greater than 5000 mg/l (Mudrack and Kunst, 1986). Thus with the characteristics of nightsoil and toilet sludges being within or close to the ranges optimal for the anaerobic digestion conversion process, it should be possible to stabilise nightsoil and toilet sludges by anaerobic treatment process as evidenced by the use of the process technology throughout the available literature.

4.7 Anaerobic Treatment Systems

Anaerobic treatment systems are based on the anaerobic digestion processes. Basically, there are two types of anaerobic treatment systems based on the rate of the digestion process:

1. **Low rate systems** in which the removal of organic matter is based on the settling of suspended organic solids with anaerobic digestion processes taking place in the accumulated sludge at the bottom. To this category belong the Imhoff tank, septic tank and anaerobic ponds.
2. **High rate systems** in which the removal of organic is based on intense contact between the influent organic matter and the large and active bacterial mass retained in the reactor. In this category belong the 'modern' anaerobic treatment systems e.g. upflow or downflow anaerobic filter, sludge bed reactors, conventional contact process, upflow anaerobic sludge blanket (UASB) and expanded granular sludge blanket (EGSB).

The high rate systems are further characterised by the mechanism of sludge retention in the anaerobic reactor. Basically two methods of sludge retention have found wide application in practice:

1. **Systems based on immobilisation of the sludge.** These are fixed film processes in which the anaerobic organisms form a thin sludge layer on a solid carried material which may be composed of granular material like sand which acts as a fluid bed (Jeris, 1982); or expanded bed reactors of macroscopic bodies like stones (Jewell, 1982); or an artificial medium forming a packed bed known as an anaerobic filter (Young and McCarty, 1969).
2. **Systems based on mobilisation of the sludge.** These are suspended growth processes which employ gravity settling to retain the anaerobic material mass in the treatment system. The gravity settler may be external, as for instance in the Contact Process (Coulter et al, 1957), or internal, as in the UASB (van Haandel *et al.*, 1996)

Figure 4.6 summarises the main anaerobic treatment systems and Figure 4.7 shows a schematic representation of the different high rate anaerobic reactors. Although low rate systems have been in use for the treatment of mainly domestic sewage for over a century, they were less popular than aerobic sewage treatment systems. This decreased application of earlier anaerobic treatment systems was principally due to the higher removal efficiency of organic matter achieved in aerobic systems (van Haandel and Lettinga, 1994). However, lately, anaerobic treatment systems are becoming popular because of the breakthrough in the design of 'modern' or high rate systems and their associated advantages.

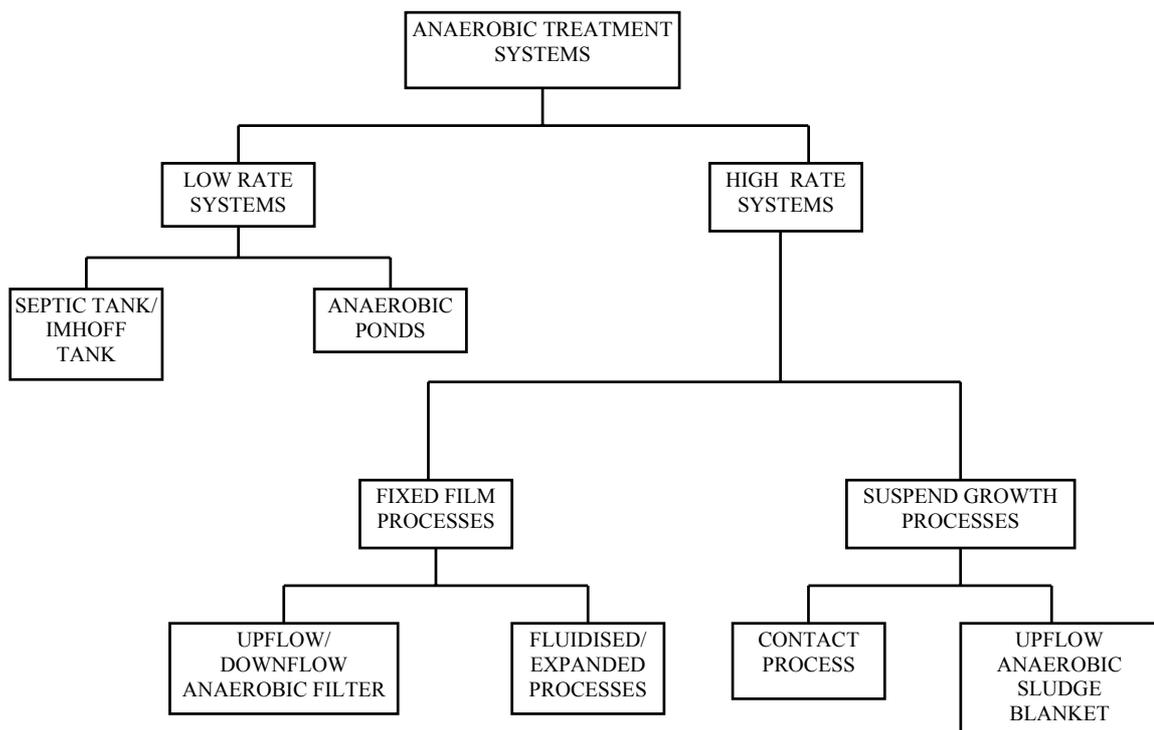


Figure 4-6 Anaerobic treatment systems

Although exceptions exist, Hall (1992) stated that in general suspended growth processes are advantageous for the treatment of sludges or wastewaters containing high proportions of particulate biodegradable organic material, while fixed film processes on the other hand are well suited to wastewaters that contain high proportions of soluble organic substrates. Thus suspended growth processes would be more suited to the treatment of nightsoil and toilet sludges since the wastes contain

high proportions of solids. Of the suspended growth processes, van Haandel and Lettinga (1994) report that the UASB has been applied far more than other modern anaerobic treatment systems due to its high efficiency of organic material removal for many kinds of wastewaters, its low construction cost and land requirements, and its extremely simple operation. For these reasons and others mentioned in section 1.4, only the UASB digester was considered for this research.

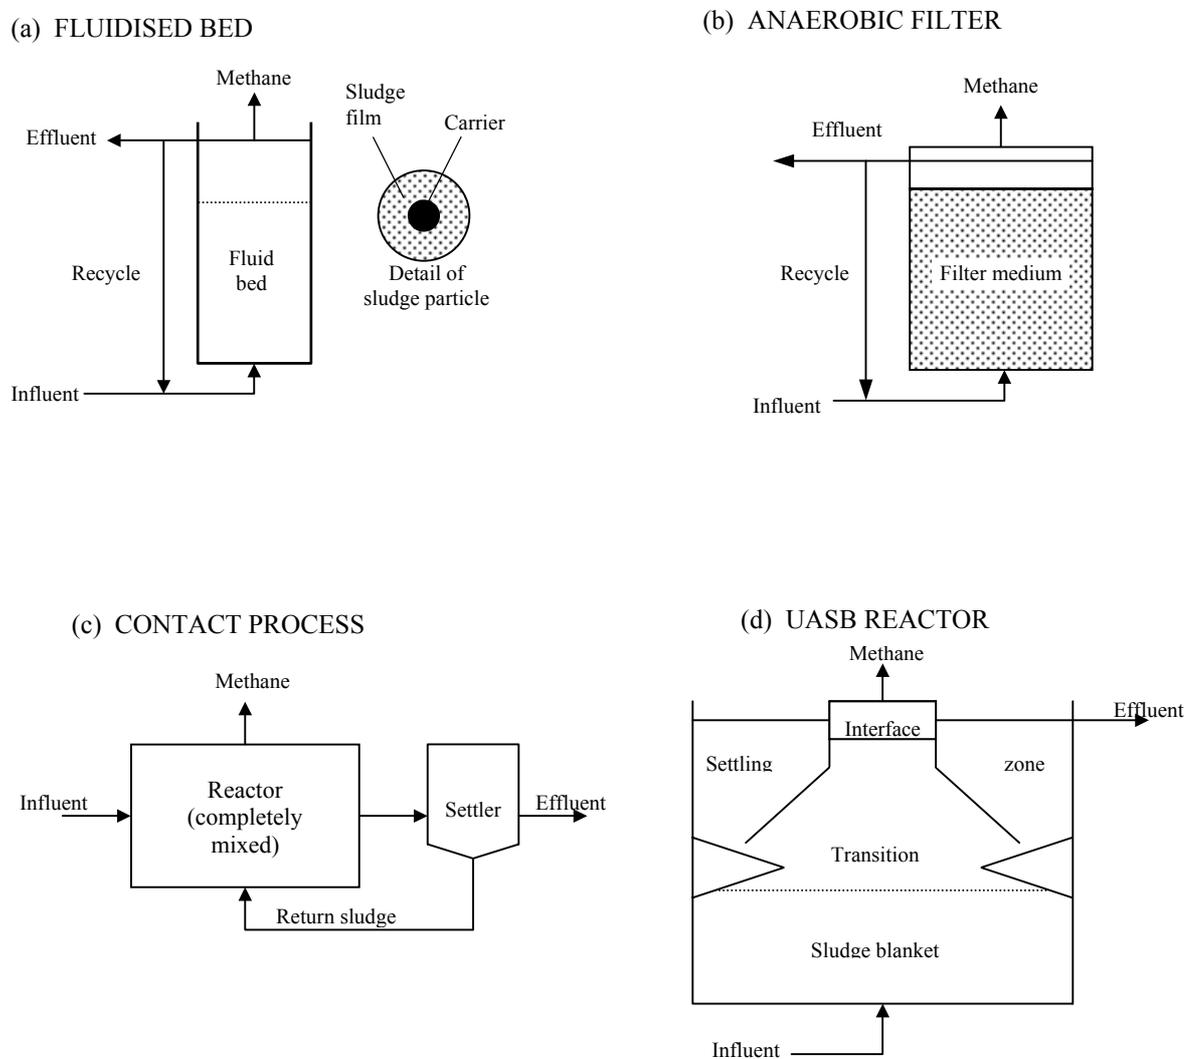


Figure 4-7 Schematic representation of different high rate anaerobic processes

Source: van Haandel *et al.* (1996)

5 The Upflow Anaerobic Sludge Blanket Reactor

5.1 Introduction

In practice, the overwhelming majority of wastewater treatment plants in developed countries use aerobic metabolism for the removal of organic material. The search for alternate treatment systems due to the high capital, operational and maintenance costs associated with aerobic systems resulted in the development of treatment systems that utilise anaerobic digestion for the removal of organic material from human wastes.

Although anaerobic treatment of wastewater is not a new technology and can be traced from the very beginnings of wastewater treatment, its lack of acceptability as an alternative wastewater treatment system has been due, principally, to the higher removal efficiency of organic matter achieved in aerobic systems (van Haandel and Lettinga, 1994). The lack of fundamental understanding of the anaerobic process was the primary obstacle to its broad implementation. This was rightly pointed out by McCarthy (1964) in his review articles. Correctly operating aerobic systems would remove 90-95 per cent of biodegradable organic matter from raw sewage while early anaerobic systems had removal efficiencies of 30-50 per cent of biodegradable matter. Later anaerobic systems like anaerobic ponds tended to have relatively high removal efficiencies (50-70%) but this was attributed to long retention times of one to five days.

The removal efficiency of the early anaerobic systems depended on the nature of sewage and settling efficiency of the system in use. Removal was based on settling of suspended organic matter. Consequently, there is little, if any contact between the anaerobic micro-organisms in the system and the non-settleable part of the organic matter in the sewage. The result being that the main part of the dissolved or hydrolysed organic matter is not metabolised and leaves the treatment system. This was a fundamental design failure. The importance of a sufficient contact between influent organic matter and the anaerobic bacterial population was not recognised at the time.

Today, the redirection of research efforts towards energy-saving alternatives like anaerobic treatment has resulted in more knowledge and understanding of the anaerobic process. Properly designed modern or high rate anaerobic treatment systems can now attain a high removal efficiency for biodegradable organic matter, even at very short retention times. These high removal efficiencies are being attributed to the presence of a high concentration of active bacterial mass within the anaerobic reactor and the intense interaction between the influent and the active bacterial mass. The upflow anaerobic sludge blanket reactor is one such modern or high rate anaerobic treatment system.

5.2 The UASB Reactor Concept and Process Design Considerations

Lettinga and his group at the University of Wageningen in the Netherlands developed the upflow anaerobic sludge blanket (UASB) reactor in the 1970's (Lettinga *et al*, 1980). Their UASB process resembled other USB processes described much earlier in the literature (Stander *et al*, 1967; Cillie *et al*, 1969; and Pretorius, 1971) except that:

- a) sludge re-circulation and/or mechanical agitation are kept to a minimum or even completely omitted, and that, in particular,
- b) the reactor is equipped in the upper part with a proper system for gas-solids separation.

A schematic diagram of an UASB reactor is shown in Figure 5.1. Lettinga *et al* (1980) state basic ideas underlying the process as:

- a) The anaerobic sludge develops and maintains superior settling characteristics if chemical and physical conditions favourable to sludge flocculation and to the maintenance of a well flocculated sludge are provided.
- b) A sludge blanket (bed) may be considered as a separate - more or less - fluid phase with its own specific characteristics. A well-established sludge blanket frequently forms a rather stable phase, capable of withstanding relatively high mixing forces. The redispersion of the sludge in the liquid phase therefore may require a significant amount of mixing energy.

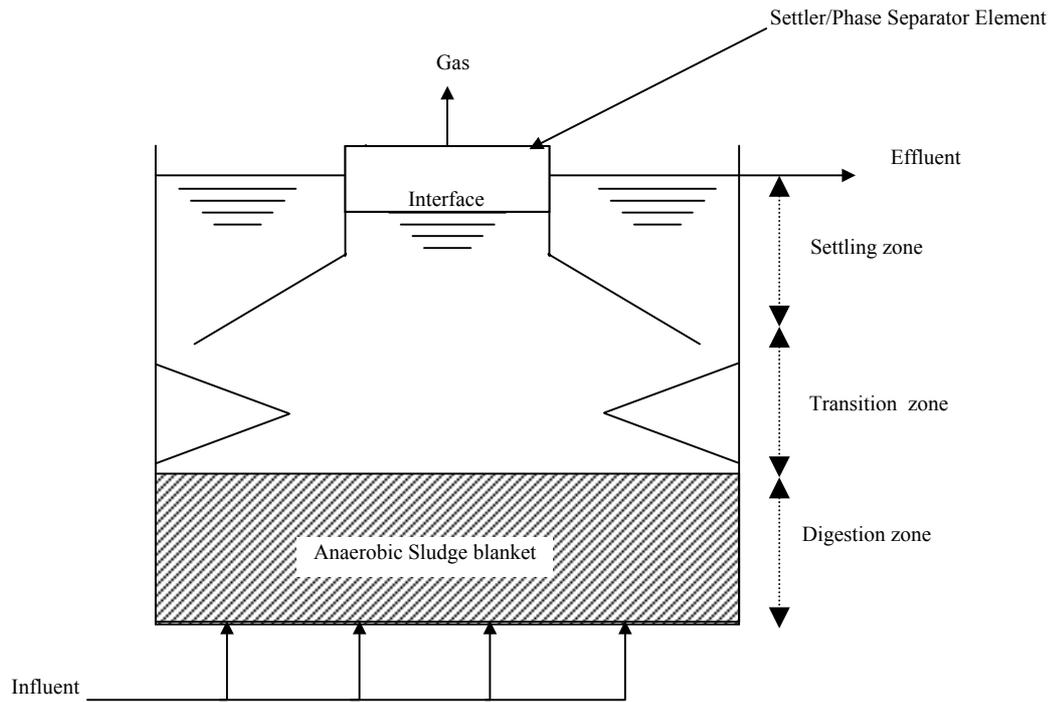


Figure 5-1 Schematic diagram of UASB reactor

Source: Adapted from van Haandel *et al* (1996)

- c) The washout of discrete sludge particles (flocs) released from the sludge blanket can be minimised by creating a quiescent zone within the reactor, enabling the sludge particles to flocculate, settle, and/or be entrapped in a secondary sludge blanket (present in the settler compartment).

These ideas are incorporated into the process design of the UASB to meet the basic requirements for a high rate anaerobic wastewater treatment system in the following ways (van Haandel *et al*, 1996):

- (a) For the conversion of organic influent material the UASB relies on the formation of well settleable, flocculent or granular type of anaerobic sludge forming a blanket in the bottom section of the reactor, known as the digestion zone. The influent is uniformly distributed over the reactor bottom and follows an upward path to the level of effluent abstraction at the top of the reactor. As the influent passes through the sludge blanket, the organic material is taken up and metabolised by the sludge and to a large extent transformed into biogas.
- (b) For the required intense contact between the influent organic material and the bacteria in the sludge, the system relies on agitation caused by the rising biogas bubbles and the kinetic energy of the influent when it enters the reactor. Under most circumstances the natural agitation will be sufficient for good contact between the organic material and the bacteria, so that mechanical mixing is not applied.
- (c) A large mass of well-settleable sludge can be retained in the reactor by installing a separator to separate the three phases in the reactor: gas, G (biogas); liquid, L (the effluent); and solid, S (the sludge) in the top part of the reactor

The GLS phase separator is the most characteristic device of the UASB reactor. It divides the reactor into two parts: an upper settling and a lower digestion zone. The phase separator captures the biogas production so that the settling zone is tranquil and sludge particles eventually carried by the liquid flow can settle out and accumulate on the separator elements. Due to the inclined surface of the separator, the settled sludge end up sliding back into the digestion zone of the reactor and once again take part in the degradation of the influent organic material.

5.3 Design Criteria

At present, there is no design criteria for UASB treating faecal sludges. The design criteria described in the literature apply to UASB reactors treating sewage and some industrial wastewater. These criteria have been assumed to be applicable to faecal sludges and are used in this research.

5.3.1 Loading Rates

The load on a UASB reactor is limited to either the organic or the hydraulic load depending on the nature of the wastewater.

Hydraulic Load

Hydraulic load can be defined as the volume of influent material per unit time. The hydraulic load is thus numerically equal to the average influent flow flowrate. Hydraulic load is used in the design when the wastewater is of a relatively low strength such as domestic sewage. The maximum hydraulic load is limited by the constraint that the upflow velocity in the reactor must not cause excessive sludge wash-out. This upflow velocity usually should not exceed 1 m/h in the UASB reactor and its is calculated as follows:

$$v_i = \frac{Q_i}{A} = \frac{V_r}{A.(HRT)} = \frac{H}{(HRT)} \quad (5.1)$$

where:

- v_i = liquid upward velocity (m/h);
- Q_i = average wastewater flow (m³/h);
- A = surface area of the UASB reactor (m²);
- V_r = volume of the reactor (m³);
- (HRT) = hydraulic retention time (h); and
- H = height of the UASB reactor (m).

Equation 5.1 further shows the relationship between the upflow velocity, the height of the UASB reactor and the hydraulic retention time. van Haandel and Lettinga (1994) state that from available experimental results, an average retention time of six hours is sufficient in tropical and subtropical regions ($T > 18$ °C) to achieve a satisfactory treatment efficiency in one compartment UASB reactors.

Organic Load

For concentrated wastewaters, the organic load rather than the hydraulic load becomes the determining factor in the design of the reactor. The organic load (L_o) is defined as the mass of influent organic material per unit time and the specific organic load (l_o) is the mass of influent organic materials per unit time and per unit of reactor volume. The specific organic load is expressed as kilograms COD (applied) per unit reactor volume and per unit time. The specific organic load is calculated as follows:

$$l_o = \frac{L_o}{V_r} = \frac{Q_i S_{ti}}{V_r} = \frac{S_{ti}}{(HRT)} \quad (5.2)$$

where

- l_o = applied specific COD load (kg COD m⁻³ d⁻¹)
- L_o = organic (COD) load (kg COD d⁻¹)
- V_r = volume of the reactor (m³);
- Q_i = average wastewater flow (m³/d);
- S_{ti} = influent organic material (COD) concentration (kg/m³)
- (HRT) = hydraulic retention time (d)

van Haandel and Lettinga (1994) state maximum design organic load of organic material may be 20 kg COD/m³d for wastes containing a high concentration of dissolved organic material of vegetable origin to be digested at or near the optimal temperature for mesophilic digestion.

5.3.2 Physical Design considerations

Shape of reactor

UASB reactors are either circular or rectangular in cross section. Circular reactors have the advantage of higher structural stability but are more difficult to construct than a rectangular or square unit. For this reason large UASB reactors are generally constructed in a rectangular or square cross sections and small reactors are generally constructed in cylindrical shape. Furthermore, when more than one reactor unit is constructed, the rectangular shape is advantageous because sidewalls can be shared by different units.

Height (or depth) of reactor

In practice, the choice of the appropriate height (or depth) of the reactor depends on the required performance and economic considerations. A higher depth/volume ratio reduces the required area for the treatment and thereby increases the upflow velocity which results in increased turbulence in the system and hence better contact between biological sludge and incoming wastewater. High upflow velocities can result in excessive sludge washout. The greater the depth of the UASB reactor, the higher the static pressure. High static pressures causes an increase in the solubility of carbon dioxide which may result in a depression of pH. If the pH assumes a lower than optimum value the anaerobic digestion can be jeopardised. Most UASB reactors have a height (or depth) between 4 and 6 m. This range has proved to be the economic optimum and to be adequate from the process point of view (van Haandel and Lettinga, 1994).

5.4 Start-up of UASB Reactor Treating Domestic Wastewater

The start-up of an anaerobic treatment process is time consuming and sometimes rather difficult compared to an aerobic treatment process. This is due to the slow growth rate of anaerobic bacteria and adaptation of the bacterial mass to the particular characteristics of the wastewater to be treated. Domestic sewage however differs from other wastewaters of industrial origin in that it already contains the bacterial populations necessary for anaerobic digestion. Thus, a reactor for anaerobic treatment of domestic sewage can be started without the need for inoculation. The bacterial populations for acid and methanogenic digestion develop spontaneously. To cut down on the length of time required for the start-up, the reactor may be seeded.

Reporting on experimental results obtained from a 160 m³ full-scale UASB reactor treating sewage from the Pedregal township in Campina Grande, Brazil, van Haandel and Lettinga (1994) observed that during the start-up period:

1. **Organic matter removal** measured by BOD and COD removal efficiencies during the initial period of operation were low and even tended to decrease during the first 10 weeks of operation. However after this initial period, the performance of the reactor started to improve and after 20 weeks of operation high and almost constant BOD and COD removal efficiencies were established (Figure 5.2). They attributed the low and decreasing removal efficiency during the initial operation period to the absence of a sufficient quantity of proper bacterial sludge to carry out the anaerobic digestion of the organic material. The bacterial populations develop gradually and sequentially in the reactor, a logical consequence of the fact that the metabolic products of one step form the substrate for the next step. This explains the declining efficiency of organic material removal in the initial period. When the acidogenic, acetogenic and methanogenic bacterial populations are too small, the solubilised products cannot be sufficiently converted and tend to appear in the effluent.

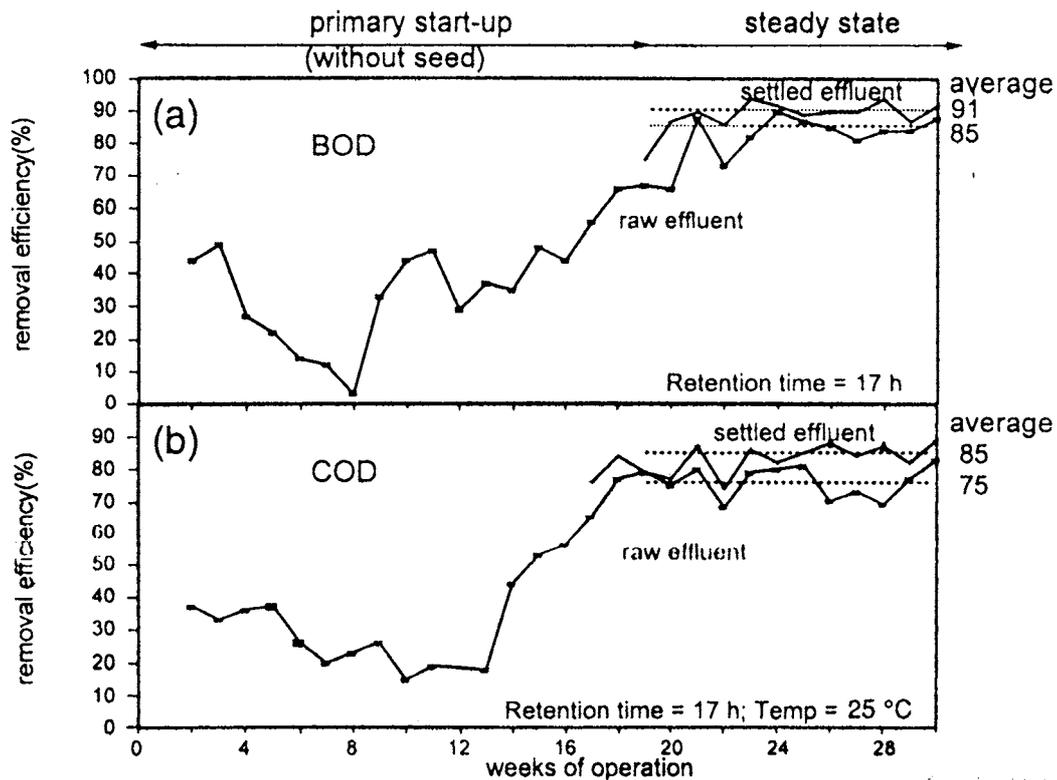


Figure 5-2 BOD and COD removal efficiencies in the Pedegral UASB reactor during the first 30 weeks of operation

Source: van Haandel and Lettinga (1994)

2. **Total suspended solids removal efficiency** increased with time during the initial period of operation (Figure 5.3(b)). This, as explained by van Haandel and Lettinga (1994), is due to the fact that the amount of sludge present in the reactor was small during the initial operation period, and therefore the likelihood of entrapping suspended solids was reduced. However, as the process proceeded, the amount of sludge mass grew and with it the improvement in the entrapment of the non-settleable suspended solids.
3. **pH value and stability:** The volatile fatty acid (VFA) concentrations in both the influent and effluent were small. During the initial period of operation when the amount of sludge in the reactor was small, the VFA concentration tended to increase, indicating that acid fermentation proceeded at a higher rate than methanogenesis. However, after an adequate amount of sludge accumulated in the reactor, the effluent VFA concentration became smaller than the influent concentration. Furthermore, the effluent pH showed little variation over the period of operation. There was a slight tendency for the pH to decrease during the first weeks of operation, when acid fermentation prevailed over methanogenesis. From their results, at no stage during the start-up was there any risk of souring the reactor and they conclude that, in general, souring of contents of a UASB reactor is not a problem in anaerobic sewage treatment and that there is no need for chemical pH adjustment.
4. **Nutrient removal:** the results of their determinations of nitrogen and phosphorus concentrations showed that the process resulted in an increase of the nutrient concentrations. The increase was attributed to the mineralisation of organic compounds containing organic nitrogen and phosphorus.

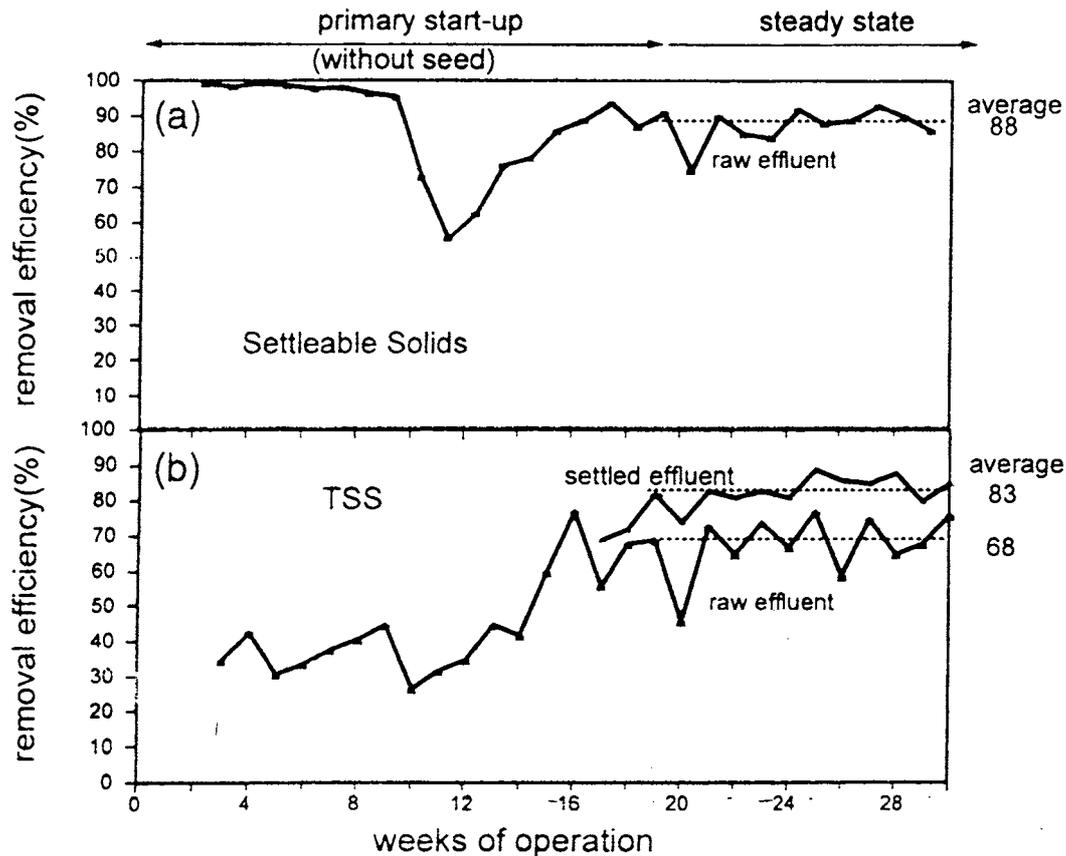


Figure 5-3 Settleable solids and TSS removal efficiencies in the Pedegral UASB reactor during the first 30 weeks of operation

Source: van Haandel and Lettinga (1994)

5.5 Steady-State Behaviour in the UASB Reactor

During the start-up period of the operation of the UASB reactor, the correct bacterial populations capable of converting organic material into methane develop and grow. Sludge mass begins to accumulate in the reactor and the extent of accumulation of this sludge is limited by the physical size of the UASB reactor. Some time after the beginning of the operation, the UASB reactor becomes filled up with sludge. When this condition is attained, there are two basic ways of dealing with the sludge production of the system (van Haandel and Lettinga, 1994). The first is to discharge the sludge periodically so that the concentration of settleable solids in the effluent remain as low as possible. The second option is to operate the reactor at maximum sludge hold-up, consequently accepting the wash-out of excess sludge. In this latter mode, the concentrations of settleable solids will be relatively high. In practice, the first option is adopted if the UASB reactor is the only biological treatment unit. This ensures that the effluent COD and TSS concentrations as low as possible. The second option is adopted in practice when some kind of post treatment, such as a waste stabilisation pond, is employed.

With respect to sludge build-up, the start-up period can be considered as being complete and steady state established when the sludge mass present in the reactor remains constant, both qualitatively and quantitatively and the effluent quality remains constant at the design load. After the establishment of a steady state, the total daily flux of settleable solids in the effluent is equal to the daily sludge production rate.

With regards to the organic material (COD) present in the waste, a steady state is established when organic matter does not accumulate in the treatment system. When this is attained, the daily mass of

influent COD is equal to the sum of the daily mass of COD leaving the system as methane in the excess sludge produced, in the effluent, and the daily amount of COD oxidised.

5.6 Mass Balance Equation

Within the UASB reactor (control volume) the mass balance for any given constituent takes the form:
(Net rate of accumulation in the control volume)

$$= \begin{aligned} & \{(\text{rate of flow into the control volume}) \\ & - (\text{rate of flow out of the control volume}) \\ & + (\text{net rate of generation in the control volume})\} \end{aligned}$$

or simply

$$\text{Accumulation} = \text{input} - \text{output} + \text{generation.}$$

Each term in the mass balance equation has the units of mass/time. The generation term represents the sum of all reactions in which the constituent of interest participates. If the generation term is positive, the constituent is being produced in the control volume; if it is negative, the constituent is being destroyed.

The organic material (COD) present in the influent, after having been exposed to anaerobic digestion in the UASB reactor will have one of the following forms: (1) sludge COD; (2) methane COD; (3) mineralised COD and (4) remaining COD in the effluent. At a steady-state when organic matter does not accumulate in the treatment system, the daily mass of influent COD is equal to the sum of: (i) the daily mass of COD leaving the system as methane, (ii) in the excess sludge produced, (iii) in the effluent, and (iv) the daily amount of COD oxidised.

$$MS_{ti} = MS_{te} + MS_{tx} + MS_{tm} + MS_{to} \quad (5.3)$$

where

- MS_{ti} = daily mass of influent COD
- MS_{te} = daily mass of effluent COD
- MS_{tx} = daily mass of COD in the discharged sludge
- MS_{tm} = daily mass of COD in produced methane
- MS_{to} = daily mass of oxidised COD

The COD recovery factor, B_o , is given by

$$B_o = \frac{MS_{te} + MS_{tx} + MS_{tm} + MS_{to}}{MS_{ti}} \quad (5.4)$$

Theoretically, the value of $B_o = 1.00$, but due to errors in the determination of various terms of equation 5.3 and to the fact that the treatment systems usually are not operated under rigorously steady state conditions, the experimental value of B_o deviates from its theoretical value. The magnitude of the deviation being an indication of the accuracy of the experimental procedures.

5.7 Biogas Production

The anaerobic digestion of organic material produces biogas, which consists mainly of methane and carbon dioxide. The biogas may also contain small amounts of nitrogen, hydrogen, hydrogen sulphide, and water vapour. The amount of biogas released can vary over a wide range and depends on the concentration of biodegradable organic material and the biological activity in the digester. Due to the high proportion of organic materials in sewage, the methane content in biogas from sewage digesters is always high. It is reported in the literature (van Haandel and Lettinga (1994); Speece (1996)) that, typically, biogas from sewage digesters contains about 65-80 percent methane by volume, and the remainder is made up of a mixture of carbon dioxide, nitrogen, water vapour and a small fraction of hydrogen sulphide. Due to the high proportion of biodegradable organic material in nightsoil and toilet sludge, the methane content in the biogas resulting from the anaerobic digestion would be expected to be high.

A considerable portion of the biogas produced remains dissolved in the liquid phase (particularly the case for carbon dioxide) and leaves the system in the effluent. In addition, methane may also be lost due to desorption at the liquid surface, the loss depending on the size of the surface and whether or not the reactor is covered. Owing to gas losses the mass of collected methane is usually much smaller than the amount produced, which can be calculated from stoichiometry. van Haandel and Lettinga (1994) reports that in practice, the losses may be between 20 and 50 percent of the produced biogas. In cases where the methane produced could have some commercial value it is essential to design a good gas collection system to minimise the losses.

Theoretically, the volume of methane produced can be calculated knowing the COD equivalence of methane. The COD equivalent of methane is as follows:



Knowing the atomic weights of H (1g/mol), C (12g/mol) and O (16g/mol), the above equation shows that for each mole of methane (16 g) consumed, two moles of oxygen equivalent (64 g) are destroyed. That is

$$\text{COD}_{\text{CH}_4} = \frac{64}{16} \text{ g COD/g CH}_4 = 4 \text{ g COD/g CH}_4 \quad (5.6)$$

Thus the digestion of 1 kg COD results in a mass of $\frac{1}{4}$ kg = 250 g of CH_4 . 1 mole (16 g) of CH_4 has a volume of $(22.4T)/273$ litres at atmospheric pressure (where T = temperature in K). Hence the volume of methane gas per 1 kg COD is calculated as:

$$= \left(\frac{250}{16} \right) * \left(\frac{22.4T}{273} \right) = 1.28T \text{ l CH}_4 / \text{kg COD} \quad (5.7)$$

If the partial pressure of methane is p_m and the fraction of collected methane is f_m , the volume of biogas produced, v_b , is given by

$$v_b = \left(f_m * \frac{1.28T}{p_m} \right) \text{ l CH}_4 / \text{kg COD digested} \quad (5.8)$$

The following example, after van Haandel and Lettinga (1994), illustrates how these equations are applied. Assuming a daily per capita contribution of 62.5 g COD and 75 l water from domestic sewage, a digestion efficiency of 80 per cent, a methane recovery fraction of $\frac{2}{3}$, and a methane partial pressure of 0.75 atm at 27 °C, the expected methane production from the UASB digester is calculated as follows:

Temperature in K, $T = 273 + 27 = 300$

Methane recovery fraction, $f_m = \frac{2}{3}$

Methane partial pressure, p_m (at 300 K) = 0.75

Biogas yield per kg COD, $v_b = \left(\frac{2}{3} * \frac{1.28 * 300}{0.75} \right) = 341 \text{ l/kg COD}$

Amount of COD digested per litre of sewage = $0.8 * \frac{62.5}{75} = 0.667 \text{ g/l} = 667 \text{ mg/l}$

Solubility of methane at atmospheric pressure = 20 mg/l

Solubility of methane in digester = $0.75 * 20 = 15 \text{ mg/l}$

From equation 4.3, COD in liquid phase due to methane = $4 * 15 \text{ mg/l}$

Maximum amount of COD associated with desorbed methane = $667 - 60 = 607 \text{ mg/l}$

Per capita COD mass corresponding to desorbed methane = $75 \frac{l}{d} * 0.607 \frac{g}{l} = 45.5 \text{ g/d}$

Biogas yield per capita = $341 \text{ l/kg COD} * 0.0455 \text{ kg COD/d} = 15.4 \text{ l/cap d.}$

Biogas yield per unit volume of influent = $\frac{15.4l}{75l} = 0.21 \text{ l biogas/l sewage.}$

The biogas produced can be used as fuel or flared off. Use of the gas as a source of fuel is only feasible when the biogas production is high. Biogas production from the anaerobic digestion of nightsoil and toilet sludge is expected to be high due to the high biodegradable organic content in the waste.

5.8 Applicability and present use of the UASB process

Although originally the UASB reactor was developed for treating medium strength (5,000 to 10,000 mg COD/L) types of industrial wastewaters with a low suspended solids concentration, the system has been shown to be quite applicable for other wastes. van Haandel *et al.* (1996) suggest that the influent characteristics that may limit the applicability of the UASB reactor for wastewater treatment are low temperature, a high concentration of suspended solids and presence of toxic compounds. They state that in practice an influent suspended solid concentration beyond 4,000 to 6,000 mg/L becomes non-applicable.

Table 5.1 shows the different wastes that have been successfully treated in full-scale UASB reactors or their variants while Table 5.2 shows in particular the application of UASB reactors for sewage treatment. The period column in Table 5.3 refers to the period for which either the experiment was conducted or the USAB plant was monitored. It is not very clear from the reference if the start-up period was included in the experimental or monitoring period. Tables 5.1 and 5.2 show that the UASB has not been used specifically in the treatment of faecal sludges.

Judging from the characteristics of faecal sludges, it should be possible to use the UASB process to treat faecal sludges after an initial physical pre-treatment to remove grit, large inorganic and non-digestible material from the faecal sludge followed by a significant amount of dilution.

Table 5-1 Types of wastewaters treated in UASB reactors

Wastewater	No.	Volume (m ³)
Alcohol	20	52 000
Bakers' yeast	5	9 900
Bakery	2	347
Brewery	30	6 600
Candy	2	350
Canneries	3	800
Chemical	2	600
Chocolate	1	285
Citric Acid	2	6 700
Coffee	2	1 300
Dairy and cheese	6	2 300
Distillery	8	24 000
Domestic Sewage	10	10 000
Fermentation	1	750
Fructose production	1	240
Fruit juice	3	4 600
Landfill leachate	6	2 500
Paper	28	67 200
Pharmaceutical	2	600
Potato processing	27	25 600
Rubber production	1	650
Slaughterhouse	3	950
Sludge liquor	1	1 000
Soft drinks	4	1 380
Starch (barley, corn, wheat)	16	33 500
Sugar processing	19	21 100
Vegetable and fruit	3	2 800
Yeast	4	8 550
Total	205	339 610

Source: van Haandel *et al.* (1996).

Table 5-2 Application of upflow anaerobic reactors to sewage treatment

Place	Vol. (m ³)	Temp. (°C)	Influent concentrations (mg/L)			Inoculum
			COD	BOD (COD _{sol})	TSS	
South Africa	0.008	20	500	(148)	NP	Activated sludge
Netherlands	0.030	21	520-590	(73-75)	NP	Digested sewage sludge
Netherlands	0.120	12-18	420-920	(55-95)	NP	Digested sewage sludge
Netherlands	0.120	18-20	248-581	(163-376)	NP	Granular sludge
Netherlands	0.120	7-18	100-900	53-474	10-700*	Granular sludge
Netherlands	6	10-18	100-900	53-474	10-700*	Granular sludge
Netherlands	20	11-19	100-900	53-474	10-700*	Granular sludge
			150-5500	43-157	50-400*	
Colombia	64	25	267	95	NP	Digested cow manure
Netherlands	0.120	12-20	190-1180	(80-300)	NP	Granular sludge
Netherlands	0.116	12-20	150-600	(70-250)	NP	Granular sludge
Mexico	0.110	12-18	465	NP	154	Adapted aerobic sludge
Brazil	0.120	19-28	627	357	376	None
Italy	336	7-27	205-326	55-153	100-250	None
India	1200	20-30	563	214	418	None
Netherlands	120	>13	391	(291)	-	Granular sludge
Netherlands	205	16-19	391	(291)	-	Self cultivated on sand
Colombia	35	NP	NP	NP	NP	NP
Netherlands	1.2	13.8	976	454	641*	Digested sewage sludge
Netherlands	1.2	12.9	821	467	468*	
Netherlands	1.2	11.7	1716	640	1201*	Granular sludge
Indonesia	0.86	NP	NP	NP	NP	NP
Indonesia	0.86	NP	NP	NP	NP	NP
Thailand	0.030	30	450-750	NP	NP	Different sludges
Brazil	120	18-28	188-459	104-255	67-236	Granular sludge
Colombia	3360	24	380	160	240	none
Brazil	67.5	16-23 ^a	402	515	379	Digested sludge
Netherlands	0.200	15.8	650	346	217	Digested sludge
Netherlands	0.120	15.8	397	254	33	Granular sludge
Puerto Rico	0.059	≅20	782	352	393	Digested sludge
India	12000	18-32	1183	484	1000	NP
India	6000	18-32	404	205	362	NP
Brazil	477	NP	600	NP	303	Non adapted sludge

NP: not provided; _{sol}: soluble; ^a: air temperature; *: expressed as COD

Source: Seghezzo *et al.*, (1998)

Table 5.2 Applications of upflow anaerobic reactors for sewage treatment (continued)

Place	HRT. (h)	Removal efficiencies in the reactor (%)			Start-up (months)	Period (months)
		COD	BOD (COD _{sol})	TSS		
South Africa	24	90	(49)	60-65	1	1
Netherlands	9	57-79	(50-60)	30-70	NP	1
Netherlands	32-40	48-70	(30-45)	90	NP	3
Netherlands	12	72	(62)	NP	NP	17
Netherlands	4-14	45-72	(38-59)	50-89	NP	12
Netherlands	9-16	46-60	(42-48)	55-75	NP	12
Netherlands	6.2-18	31-49	(23-46)	NP	NP	12
Colombia	6-8	75-82	75-93	70-80	6	9
Netherlands	7-8	30-75	(20-60)	NP	NP	NP
Netherlands	2-3	NP	(20-60)	NP	NP	NP
Mexico	12-18	65	NP	73	NP	>12
Brazil	4	74	78	72	4	9
Italy	12-42	31-56	40-70 ⁺	55-80 ⁺	NP	12
India	6	74	75	75	2.5	12
Netherlands	2-7	16-34	(20-51)	None	NP	35
Netherlands	1.5-5.8	≅ 30	(≅ 40)	None	NP	33
Colombia	5-19	66-72	79-80	69-70	NP	48
Netherlands	44.3	33	50	47.0*	NP	28
Netherlands	57.2	3.8	14.5	5.8*	NP	24
Netherlands	202.5	60	50	77.1*	NP	13
Indonesia	360	90-93	92-95	93-97	NP	60
Indonesia	34	67-77	Up to 82	74-81	NP	60
Thailand	3-12	90	NP	NP	>2	4
Brazil	5-15	60	70	70	>2	24
Colombia	5.0	45-60	64-78	≅ 60	>6	>36
Brazil	7.0	74	80	87	NP	14
Netherlands	3.0	37-38	26.6	83	None	5
Netherlands	2.0	27-48	(32-58)	NP	None	3
Puerto Rico	6-24	57.8	NP	76.9	≅ 4	16
India	8	51-63	53-69	46-64	5	13
India	8	62-72	65-71	70-78	5	11
Brazil	13	68	NP	76	2	>7

NP: not provided; _{sol}: soluble; ^a: air temperature; *: expressed as COD; ⁺: obtained at temperatures of 15-20°C, HRT of 12 h and V_{up} of 0.58 m/h

6 Results and Discussion of Recent Experimental Work

6.1 Introduction

This chapter presents and discusses the results of recent experimental work carried out in Kumasi, Ghana, as part of a postgraduate research. As revealed by the literature review the UASB reactor has not been used specifically for the treatment of faecal sludges. Its extensive usage in recent times has been for the treatment of domestic sewage and industrial wastewater. In the presentation and discussion, the results obtained have been compared to results obtained from USAB reactors treating domestic sewage. The potential of using the USAB for the treatment of faecal sludges, based on the experimental results, is presented.

6.2 Physical and Chemical Characteristics of Faecal Sludges

The results of the physical and chemical characteristics of faecal sludges is shown in Table 6.1 below.

Table 6-1 Characteristics of nightsoil/toilet sludge in Kumasi, Ghana

Parameter	Value	
	Average	Range
pH	-	8.1 - 8.5
BOD (mg/l)	23,300	14,200 - 52,000
COD (mg/l)	86,700	36,600 - 175,000
COD/BOD	4:1	2.4:1 - 7.2:1
TS (mg/l)	55,700	31,300 - 87,000
TVS (mg/l)	39,700	15,000 - 65,400
TVS/TS	71%	48% - 76%
TKN (mg/l)	2,400	700 - 4050

As shown in the table, the physical and chemical characteristics of faecal sludges exhibit extreme variations. These variations have also been observed in a number of earlier studies (Pescod, 1971; Pradt 1971; Um and Kim, 1986; Guo *et al.*, 1991; WRI/SANDEC, 1994; and Strauss *et al.*, 1997) and have been attributed to several of factors which included:

- i. origin of the sludge,
- ii. type of on on-site sanitation system,
- iii. amount of ageing that has taken place,
- iv. time of the year,
- v. extent of stormwater and groundwater infiltration, and
- vi. user habits.

The variation is highlighted in Table 6.2 where characteristics of toilet sludge from Accra, Ghana are compared to those obtained in Kumasi, Ghana during the said research. In Accra, the minimum BOD was 3,800 mg/l while the minimum for Kumasi was 14,250 mg/l; the minimum value for Kumasi was close to the maximum for Accra, which was 15,000 mg/l. The mean BOD for Kumasi (23,300 mg/l) was nearly three times the mean BOD reported for Accra (8,800 mg/l). With regards to COD, the minimum for Kumasi (36,600 mg/l) was over three times the minimum for Accra (10,400 mg/l) while the maximum value (175,000 mg/l) was almost twice that for Accra (97,000 mg/l). One major factor that could account for this extreme variation of the values in this study to that reported for Accra is the amount of water used at the on-site sanitation facility. Water may be used to flush the toilets in the case of WCs or used for cleaning the toilets in the case of KVIPs and aqua privies. Water used dilutes the faecal sludge and ultimately affects its concentration. Since the mid 1980's the local government authorities in the major cities in Ghana have banned the use of bucket latrines and privatised the management of public toilets. Schemes were put in place to assist homeowners to convert existing bucket latrines to other hygienically more acceptable sanitation systems. Public bucket latrines are also being converted to other systems such as WCs and aqua privies. The city of Accra, which is the

Table 6-2 Comparison of the characteristic of faecal sludges from Kumasi to that reported in the literature and for Accra.

Parameter	Origin		
	Kumasi, Ghana ¹	Accra, Ghana ²	Literature
pH	8.1 – 8.5	-	7.2 – 8.8
BOD (mg/l)	14,250 – 52,000 (23,300) ³	3,800 – 15,000 (8,800)	8,000 – 23,000
COD (mg/l)	36,600 – 175,000 (86,700)	10,400 – 97,000 (47,600)	10,000 – 97,000
COD:BOD	2.4:1 – 7.2:1 (3.7:1)	-	1.5:1 – 5:1
TS (mg/l)	31,300 – 87,000 (55,700)	-	12,000 – 45,100
TVS (% of TS)	48 – 76 (71)	62	≥ 50
SS (mg/l)	-	2,000 – 19,000 (6,400)	7,000 – 20,000
VSS (mg/l)	-	58 (% SS)	5,800 – 13,000
NH ₄ -N (mg/l)	700 – 4050 (2400)	-	2,100 – 6,000
Helminth eggs (no./l)	-	29,000 (3,600 - 62,000)	-

¹Source: Present study; ²Source: WRRRI/SANDEC, (1994); ³Values in brackets are means.

capital, is ahead of the other cities with these improvements and now has more water dependent on-site sanitation facilities than the other cities including Kumasi. It is therefore not surprising that the faecal sludges from public on-site sanitation facilities in Kumasi are more concentrated than that in Accra.

The characteristics of the faecal sludge from this study compare quite satisfactorily with the summary characteristics compiled from the literature (Table 6.1). In general, the values for Kumasi were higher than those reported in the literature. The physico-chemical characteristics indicate that the faecal sludge contains high concentrations of organic matter. Total volatile solids, expressed as a percentage of total solids, range from 48 to 76% and had a mean of 71%. The high percentage of organic material in the faecal sludge, coupled with the wide fluctuations of the physico-chemical characteristics make the anaerobic digestion process a preferred option for faecal sludge treatment.

6.3 Ambient temperature measurements

Figure 6.1 shows the ambient air temperatures recorded during the experiment. The UASB reactor was mounted in the open and hence the main source of external heating was solar radiation. No temperature measurements of the reactor contents were taken.

The maximum daily temperatures ranged from 26.0 to 37.2 °C with a mean maximum of 33.8 °C. The minimum daily temperature was never lower than 18.3 °C and was as high as 25.5°C. The average value for the minimum daily temperature was 22.4 °C. The mean daily temperature, calculated from the daily maximum and minimum temperatures ranged from 23.0 to 31.2 °C and it averaged 28.1 °C. The period from February to May does not include the hottest months of the year in Ghana, which is normally from November to January. With the mean daily temperature averaging 28.1 °C, the UASB reactor should not require conventional heating for its operation.

6.4 Chemical Oxygen Demand

The COD of the faecal sludge was measured for the influent into and the effluent from the UASB reactor and the results obtained are shown Figure 6-2 and Table 6-3.

The influent COD concentration ranged from 6400 to 10780 mg/l and it averaged 8610 mg/l with a standard deviation of 1040 mg/l. The effluent COD was never less than 1970 mg/l and was as high as 3270 mg/l. The effluent averaged 2480 mg/l and had a standard deviation of 340 mg/l. The graph shows a slightly downward trend in the effluent concentrations, an indication of improving effluent quality as the study progressed although the influent concentration was quite varied. The variation in

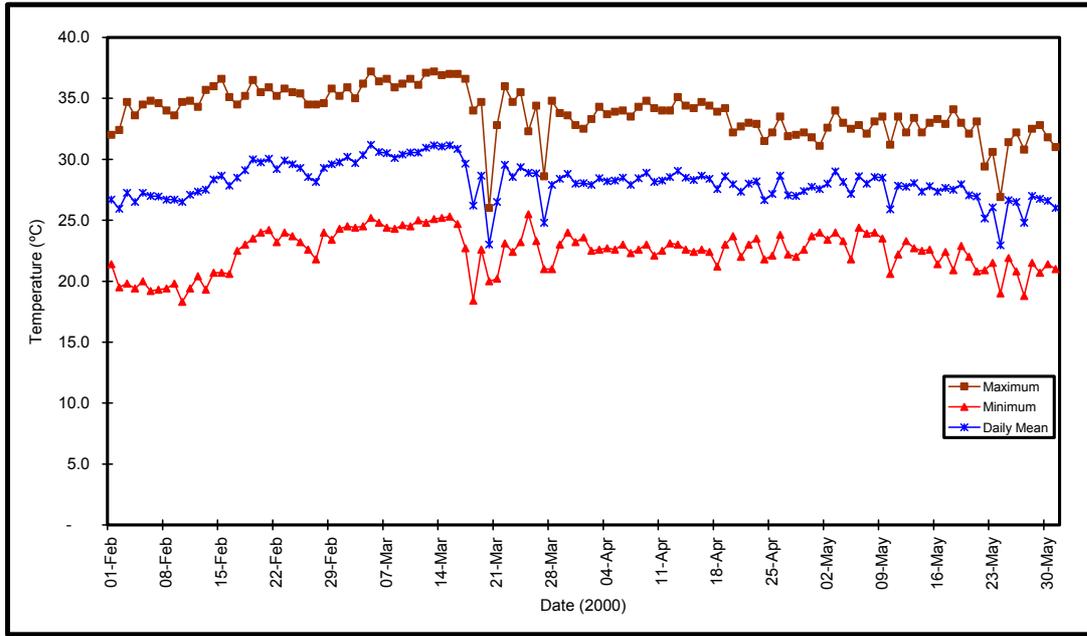


Figure 6-1 Temperature values over the experimental period

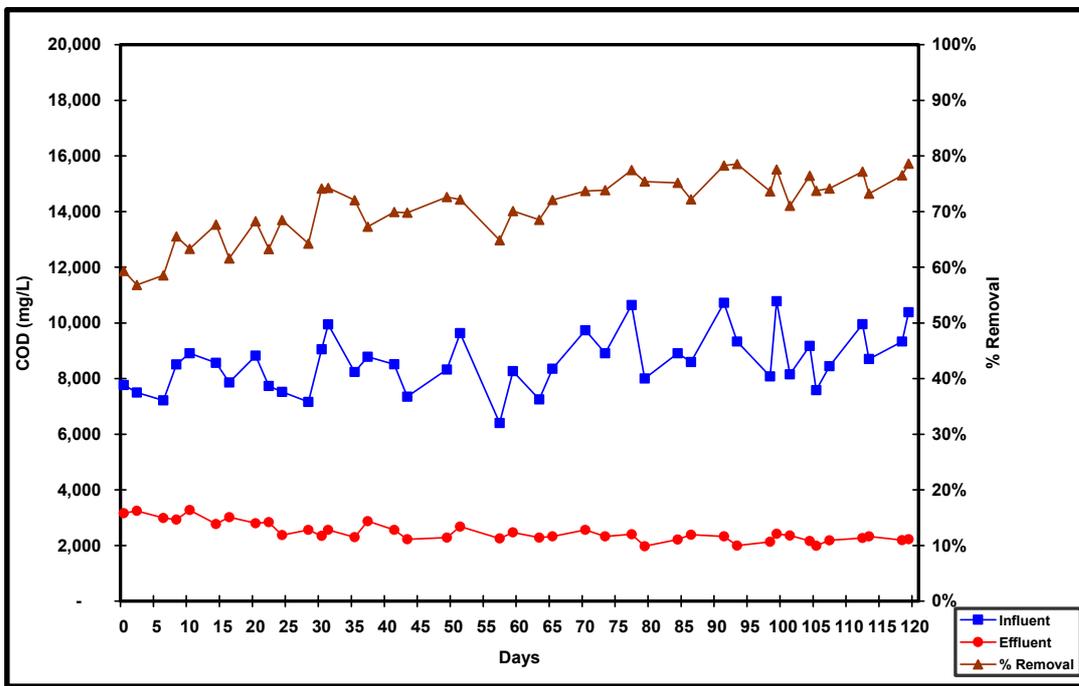


Figure 6-2 COD values and % removal efficiency with time for faecal sludge

Table 6-3 Summary of COD values for influent/effluent samples from the UASB reactor using faecal sludge

Parameter	Influent (mg/l)	Effluent (mg/l)	% Removal
Maximum	10780	3270	79
Minimum	6400	1970	57
Mean	8610	2480	71
Standard Deviation	1040	340	6

the influent concentration was due to the fact that the origin of faecal sludge varied much. The downward trend in the effluent concentration was reflected in the COD removal which showed an upward trend from start to end. The removal rate varied from 57% to 79% and it averaged 71% and a standard deviation of 6%.

6.5 Total Solids

The total solids of the faecal sludge was measured for the influent into and the effluent from the reactor and the values obtained from the determination are shown in Figure 6-3 and Table 6-4.

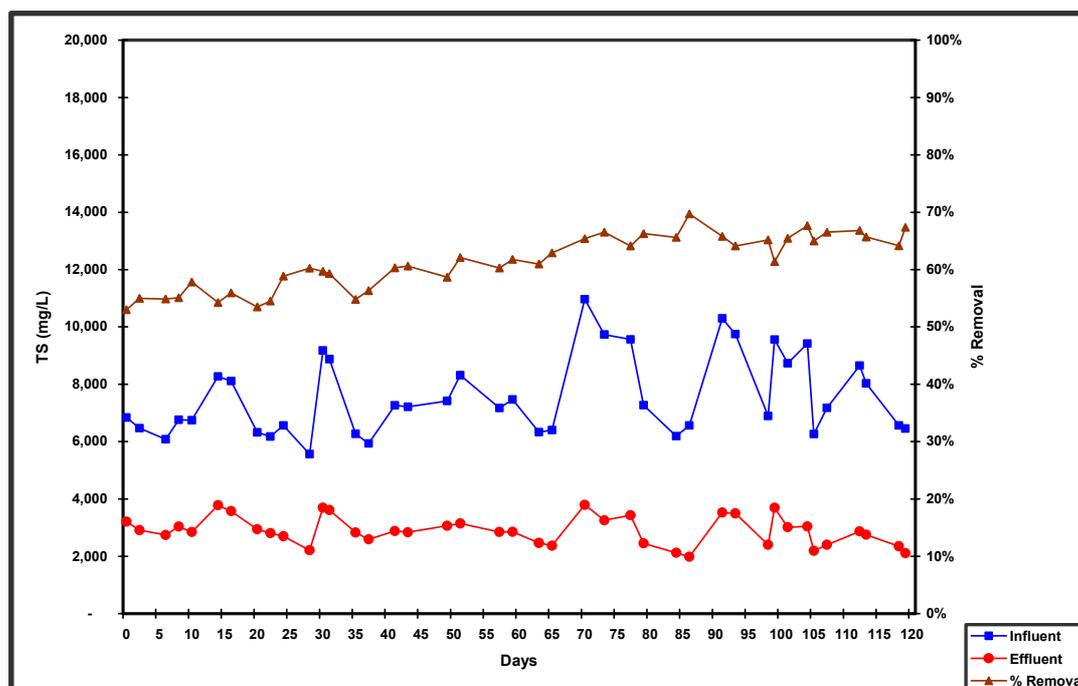


Figure 6-3 TS values and % removal with time for faecal sludge.

Table 6-4 Summary of TS values for influent/effluent samples from the UASB reactor using faecal sludge

Parameter	Influent (mg/l)	Effluent (mg/l)	% Removal
Maximum	10970	3800	70
Minimum	5560	1990	53
Mean	7560	2900	61
Standard Deviation	1390	500	6

The influent total solids concentrations were quite variable, ranging between 5560 and 10,970 mg/l. It averaged 7560 mg/l with a standard deviation of 1390 mg/l. As mentioned in earlier paragraphs, the variable nature of the influent is due to the varied sources of the faecal sludge. The effluent concentration was fairly variable compared to the influent. It was not less than 1990 mg/l and in some instances as high as 3800 mg/l. The mean effluent concentration was 2900 mg/l and had standard deviation of 500 mg/l. Total solids removal rate was quite good and comparable to that for the COD. The minimum removal efficiency was 53% while the maximum was 70%. The mean removal efficiency was 61% with a standard deviation of 6%. The graph shows an upward trend for the removal efficiency, a very good indication that as the study progressed, the removal efficiency was rising. The increasing trend from start to end is similar to that for the COD removal.

6.6 Total Volatile Solids

The total volatile solids content was measured for the influent into the reactor and effluent from the reactor to determine the organic fraction of total solids (Figure 6-4 and Table 6-5).

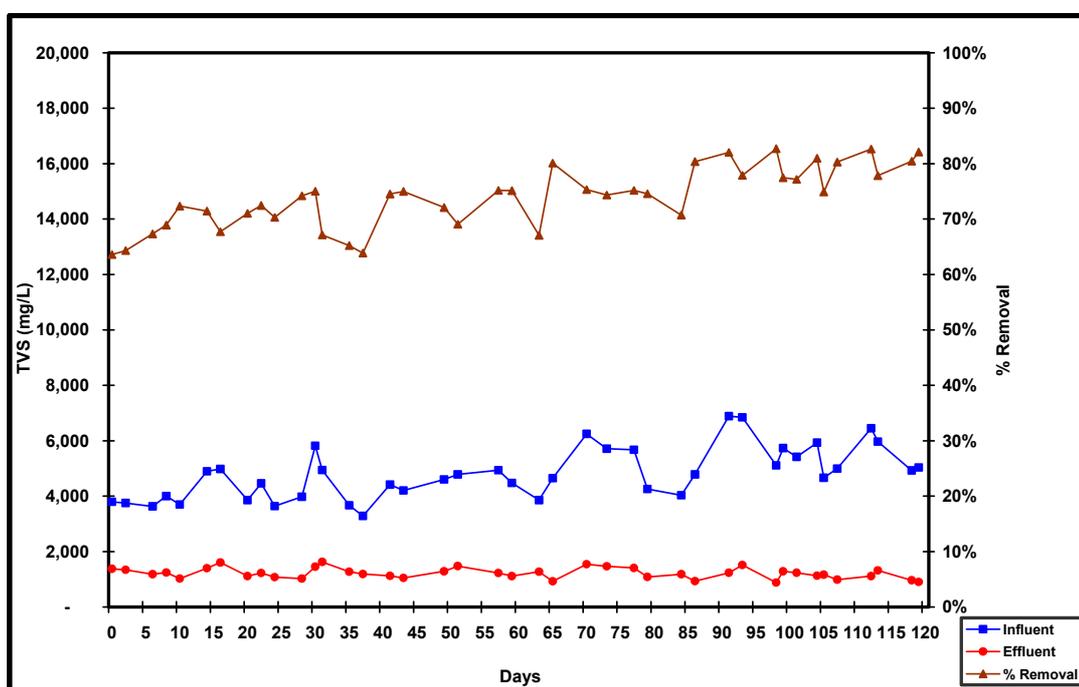


Figure 6-4 TVS values and % removal with time for faecal sludge.

Table 6-5 Summary of TVS values for influent/effluent samples from the UASB reactor using faecal sludge

Parameter	Influent (mg/l)	Effluent (mg/l)	% Removal
Maximum	6890	1630	83
Minimum	3290	880	64
Mean	4800	1220	74
Standard Deviation	930	200	6

The influent TVS ranged from 3290 to 6890 mg/l with an average of 4800 mg/l and a standard deviation of 930 mg/l. The influent was quite variable as indicated by the standard deviation. An unexplained upward trend is noticeable in the graph, which maybe due to better quality faecal sludge samples. The effluent quality was fairly stable (standard deviation was 200 mg/l). It varied between

880 and 1630 mg/l and had an average value of 1220 mg/l. The removal efficiency was very good and it showed an upward trend from start to finish. The minimum removal efficiency was 64% and the maximum 83%. The mean removal efficiency was 74% with a standard deviation of 6%. The mean removal efficiency is a very good indication of high uptake rate for the organic fraction of the total solids.

6.7 Ratio of total volatile solids (TVS) to total solids (TS) for faecal sludge

The ratio of TVS to TS for both influent and effluent was determined using the values obtained from the determination of TVS and TS (Figure 6.5). Comparison of the influent and effluent values gives an indication of the utilisation of the organic content in the reactor.

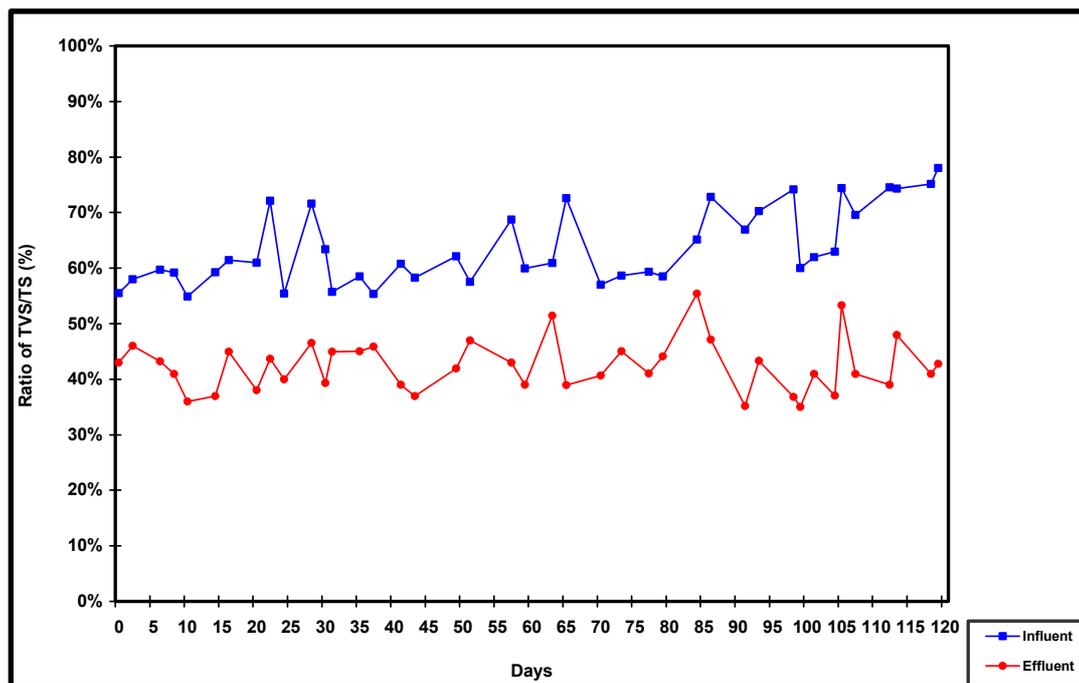


Figure 6-5 Ratio of TVS/TS with time for faecal sludge.

The influent TVS/TS ratio ranged between 55 to 78% with an average value of 64% while the effluent had a minimum value of 35% and a maximum value of 55%. The mean effluent ratio was 42%, a mean drop of 22% from the influent TVS/TS ratio. As indicated on the graph, the influent ratio was always higher than the effluent ratio, an indication of the utilisation of the organic fraction during the anaerobic digestion.

6.7.1 Organic Nitrogen

In the determination of organic the sample was first boiled to drive off ammonia and then digested. The measured values therefore represented the organic nitrogen in the samples analysed. Organic nitrogen was measured for the influent into and effluent from the UASB reactor and the values obtained are shown in Figure 6.6 and Table 6-6.

The influent organic nitrogen ranged from 205 to 520 mg/l and had a mean of 300 mg/l with a standard deviation of 85 mg/l. With regards to the effluent, the organic nitrogen varied between 130 and 325 mg/l. The mean effluent organic nitrogen was 185 mg/l and the standard deviation was 50 mg/l. The influent values are quite variable and the effluent values do not appear to follow any trend. From the graph it could be seen that the effluent variation was patterned after the influent concentrations, an indication of the influence of the influent concentration.

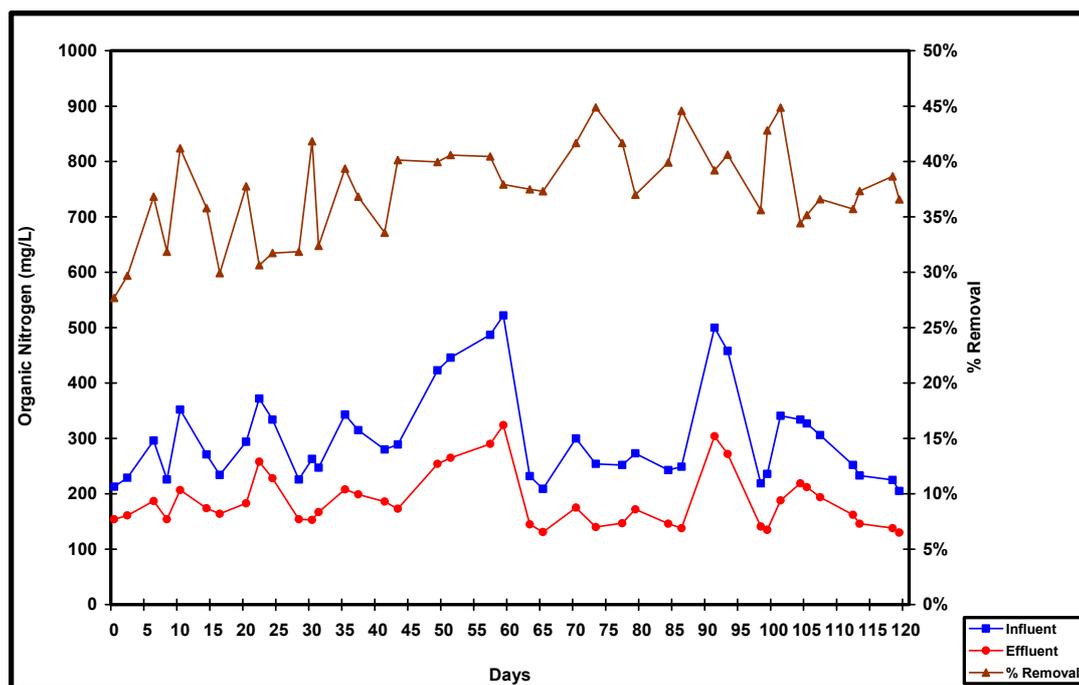


Figure 6-6 Values of organic nitrogen and % removal efficiency with time for faecal sludge.

Table 6-6 Summary of organic nitrogen values for influent/effluent samples from the UASB reactor using faecal sludge

Parameter	Influent (mg/l)	Effluent (mg/l)	% Removal
Maximum	520	325	45
Minimum	205	130	28
Mean	300	185	37
Standard Deviation	85	50	4

The anaerobic digestion process led to a decline in the organic nitrogen content. During anaerobic digestion soluble organic nitrogen is converted into ammonia nitrogen as bacteria consume organic matter containing nitrogen. The consumption of soluble organic matter containing nitrogen results in a decline in the organic nitrogen content. The organic nitrogen removal efficiency ranged from 28% to 45% with an average of 37% and a standard deviation of 4%.

6.7.2 Organic loading rate (OLR) and percent removal efficiencies of COD, TS and TVS for faecal sludge.

Figure 6-7 shows the applied organic loading rate and the percent removal efficiencies for COD, TS and TVS. The applied organic loading rate was calculated using the influent COD concentration and the measured hydraulic retention time. The applied organic loading rate varied between 12.5 and 21.5 kg COD/m³.d and it had a mean value of 17.1 kg COD/m³.d. The graph indicates that the OLR was quite variable. This was due mostly to the variable nature of the influent COD since the hydraulic retention remained fairly constant throughout the study period. The removal rate for COD, TS, and TVS all showed an upward trend from start to end of the study.

The retention time in the reactor ranged from 11.7 to 12.4 hours with a mean value of 12.1 hours (mean upflow velocity of 0.14 m/h). A dilution ratio in the range of 1:6 – 1:8 was applied to the faecal sludge throughout the experimental study.

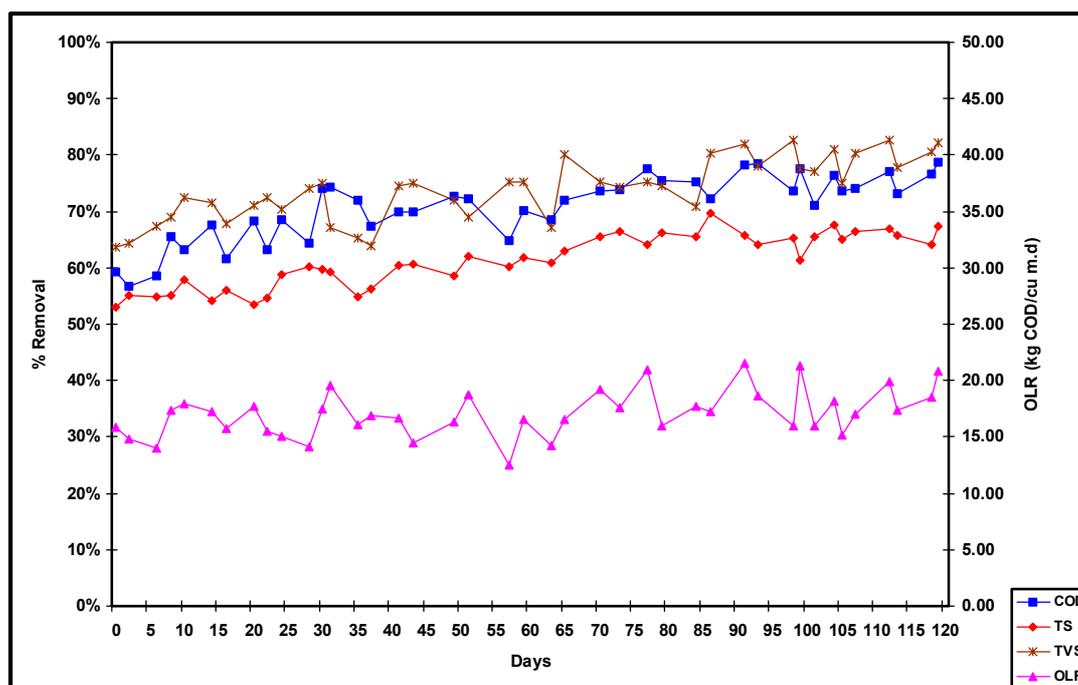


Figure 6-7 Percent removal efficiencies for COD, TS, TVS and the variation of OLR with time for faecal sludge

6.7.3 Methane Production for Faecal Sludge

The production of biogas was observed and volumes of the biogas collected were recorded throughout the duration of the experiment. Again the production of biogas was used mainly as an indication of the progress of the digestion process. The average air temperature over the experimental period was 28°C. The volume of methane in the biogas collected was then calculated using equations 5.5, 5.6, 5.7 and 5.8 (section 5.7) and assuming that the volume of methane in the collected gas was 70% (Figures 6-8, 6-9, 6-10 and Table 6-7).

Table 6-7 Summary of CH₄ production values for faecal sludge

Parameter	Cal. vol. of CH ₄ produced daily (ml)	COD equiv. of CH ₄ (g COD)	COD _{CH₄} /COD _{tot. rem.} %	Vol of CH ₄ /COD _{tot. rem.} l/kg	Vol of CH ₄ /TVS _{rem.} l/kg
Maximum	4000	105	20	7.6	16.0
Minimum	1900	50	11	4.1	6.8
Mean	3280	85	14	5.5	9.6
Standard Deviation	480	12	2	0.6	2.0

Volume of methane in the collected biogas produced daily was calculated and ranged between 1900 ml/d and 4000 ml/d. The mean volume of methane over the experimental duration was 3280 ml/d with a standard deviation of 480 ml/d. The calculated volume of methane in the biogas generally increased as the experiment proceeded (Figure 6-8). For the latter half of the experimental period (after the 7th week) the minimum calculated volume of methane was 3000 ml/d. The mean calculated volume of methane in the collected biogas for this latter half was 3560 ml/d with a standard deviation of 240 ml/d. Thus for the whole test period the degree of variation about the mean was 14%, while for the latter half this reduced to 6%. That is, the variation in the volume of biogas collected about the mean volume tended to decrease as the experiment progressed. Figure 6-8 also shows the COD equivalent of the calculated volume of methane in the biogas produced. The pattern of the graph is similar to that of calculated volume because the COD equivalence methane were calculated using the calculated

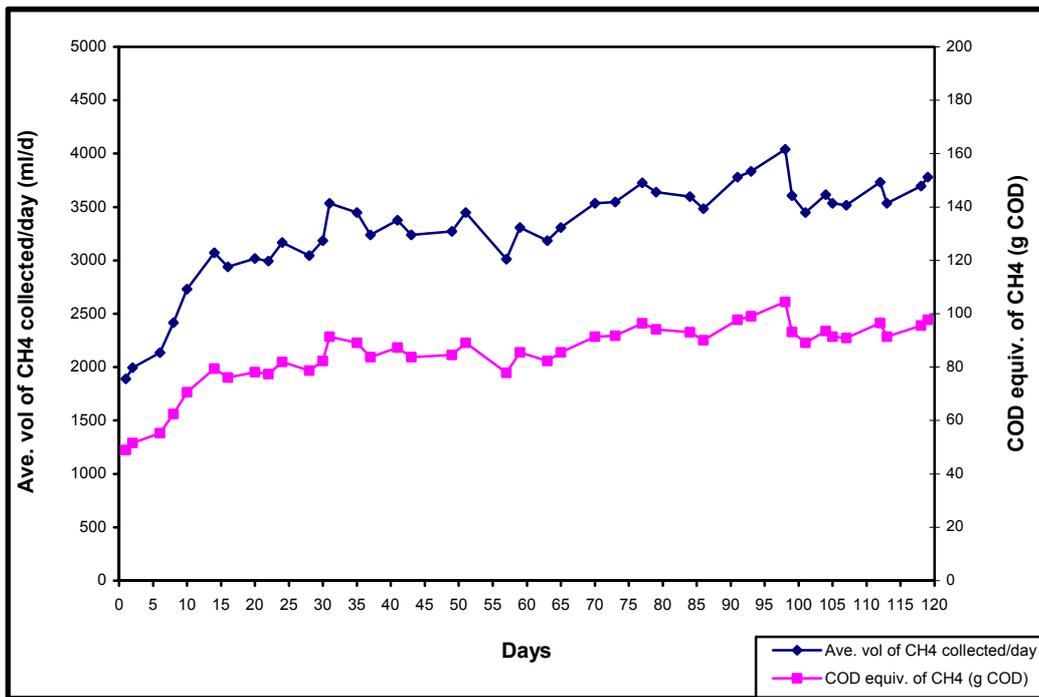


Figure 6-8 Calculated volume of CH₄ and COD equivalent of CH₄ in the collected biogas for faecal sludge

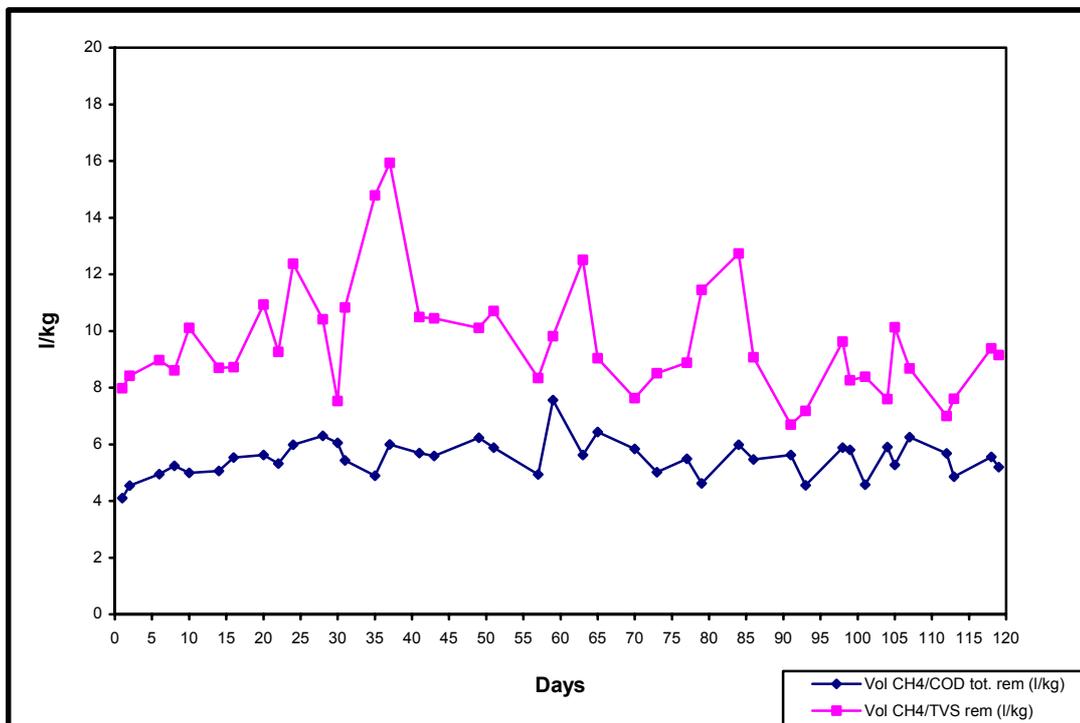


Figure 6-9 COD equivalent of CH₄ and the ratio of COD_{CH4}/COD_{total removed} for faecal sludge

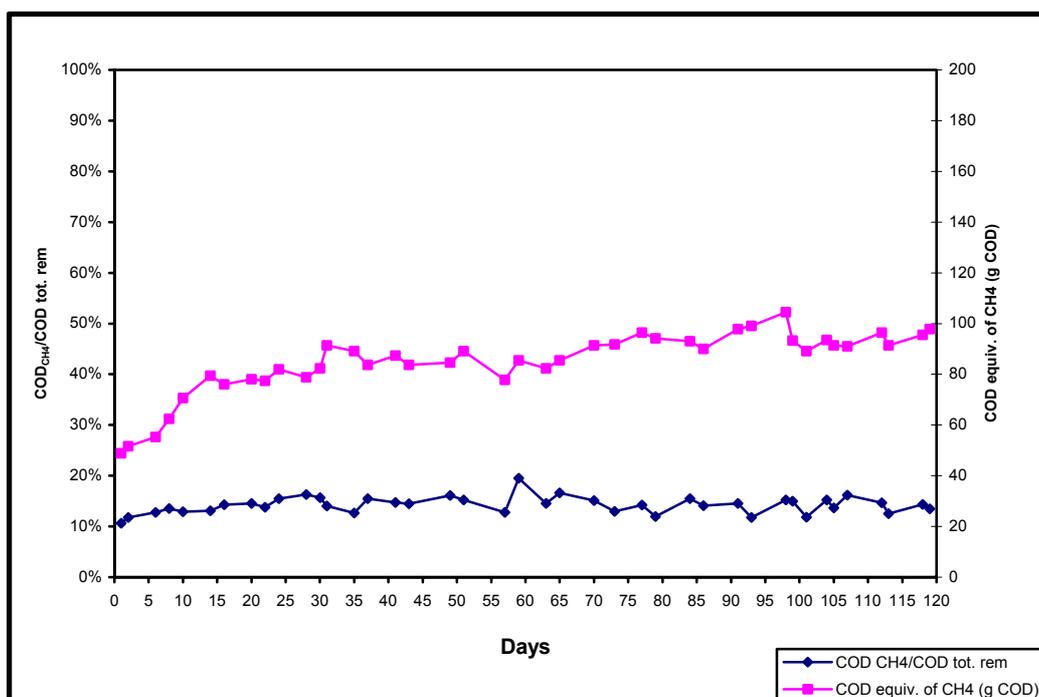


Figure 6-10 Volume of CH₄/COD_{total removed} and volume of CH₄/TVS_{removed} for faecal sludge

volumes of methane in the biogas produced. The minimum COD equivalence of methane was 50 g COD and the maximum was 105 g COD during the experimental period. The mean COD equivalence for the calculated volume of methane in the biogas collected was 85 g COD with a standard deviation of 12 g COD. During the latter same latter half of the period considered, the COD equivalent of the calculated volume of methane in the biogas collected ranged between 80 and 105 g COD with a mean of 90 g COD and a standard deviation of 6 g COD.

Figure 6-9 shows the ratio of COD of methane to the total COD removed in the UASB reactor during the experiment. There is no apparent trend in the graph as it is almost horizontal with some variations. This result is similar to the result obtained for primary sludge. The ratio ranged from 11% to 20% with a mean of 14% and a standard deviation of 2%. That is on the average, the calculated amount of methane in the biogas collected accounts for 14% of the total COD removed in the UASB reactor. This result is the same as that obtained for primary sludge. Again this value does not account for biogas losses, which could be between 20 to 50% of the collected biogas volume (van Haandel and Lettinga, 1994).

The ratio of the volume of methane produced per g of COD and TVS removed is shown in Figure 6-10. As in the case of primary sludge, the calculated volume of methane per g of TVS removed was always higher than that for the COD. The calculated volume of methane in the biogas produced per kg of COD removed ranged between 4.1 to 7.6 l/kg COD. It averaged 5.5 l/kg COD and had a standard deviation of 0.6 l/kg COD. With regards to TVS, the calculated volume of methane in the biogas produced per kg of TVS removed ranged between 6.8 to 16.0 l/kg TVS. It averaged 9.6 l/kg TVS and had a standard deviation of 2 l/kg TVS. These values compared with the expected values and discussed in section 6.8.5 of this paper.

There is no apparent trend in the graphs except to mention that the variations in the volumes associated with TVS removed were substantial compared to variations in volumes associated with total COD removed (the standard deviation about the mean for TVS values was 21% and that for the COD values was 11%).

6.8 Performance of the UASB reactors

6.8.1 COD removal

A considerable spread in removal efficiencies of COD in UASB reactors treating domestic sewage is generally observed (Seghezzo *et al.* 1998; van Haandel and Lettinga, 1994). The spread is due primarily to the different types of sewage being treated and the different operational conditions. In general the COD removal efficiencies for a UASB reactor operating in tropical and sub-tropical temperatures (temperatures above 18 °C) are higher than those operating in cold climatic conditions. The COD removal efficiencies are also affected by the hydraulic retention time. For reactors that operate in tropical and sub-tropical temperatures with retention times over 4 hours, the COD removal efficiencies ranged from 45 to 93%. The COD influent concentrations under these conditions also varied from 188 to 1183 mg/l.

For the whole duration of the experiment, influent COD concentrations ranged from 6400 to 10,780 mg/l with an average of 8610 mg/l. The COD removal efficiencies over the duration of the experiment were comparable to those reported in the literature, ranging from 57% to 79% with an average of 71%. From the 10th week till the end of the experiments, there was an improvement in the mean COD removal efficiency compared to the removal efficiency for the whole duration of the experiment. From the 10th week till the end of the experiment, the average COD removal efficiency was 75% with a standard deviation of 2%. The effluent COD concentration during this period ranged between 1970 and 2420 mg/l and averaged 2230 mg/l. As shown in Figure 6.2, a general upward trend in the COD removal efficiency with a corresponding improvement in the effluent quality was observed. Although the influent COD concentrations were quite variable as expected, the effluent COD concentrations remained fairly constant.

On the whole, the high removal efficiencies for COD are a good indication of the fact that the UASB, under proper operating conditions, could be used for the pre-treatment of faecal sludges before the conventional faecal sludge treatment plants (FSTPs) as used in Ghana. The pre-treatment would reduce the strength of the waste to acceptable levels that could be handled by the FSTPs without any adverse effects.

6.8.2 Total Solids removal

The removal efficiency of total solids for the experiment increased gradually over the course of the experiment. The efficiency for faecal sludge was never lower than 53% and was as high as 70%. The average total solids removal efficiency was 61%, which is nearly the same as that for the primary sludge. The total solids concentration in the influent was between 5560 and 10,970 mg/l with a mean of 7560 mg/l. With regards to the effluent, the total solids concentration varied between 1990 and 3800 mg/l and had a mean of 2900 mg/l.

From the 10th week till the end of the experiment, the influent total solids concentration in the diluted faecal sludge ranged from 6190 to 10300 mg/l and it averaged 8060 mg/l. During this period the effluent concentration ranged from 1990 to 3690 mg/l and it averaged 2770 mg/l. These values show that the average influent total solids concentration increased while the average effluent concentration decreased. A good indication of the improvement in the performance of the UASB reactor as the experiment progressed with time. The mean removal efficiency from the 10th week till the end of the experiment was 61%, and increase of 8% over the mean for the whole experimental period.

Figure 6-3 shows that the influent total solids concentration was very erratic and quite variable while the effluent varied very little from one point to the next. This clearly illustrates the ability of the UASB reactor to handle varying influent loads. Although the removal efficiency was very good for both experiments, the effluent concentrations are still high for direct discharge into the environment. It will be essential to have post-treatment of the effluent to improve the effluent quality.

6.8.3 Total Volatile Solids (TVS)

The removal efficiency of total volatile solids (TVS) were higher than the TS removal efficiency. The TVS removal efficiency for faecal sludge was never less than 64% and was as high as 83%. The mean TVS removal efficiency for faecal sludge was 74%. In terms of actual concentrations, the TVS concentration in the influent faecal sludge varied from 3290 to 6890 mg/l having an average of 4800 mg/l. The effluent TVS concentrations range from 880 to 1630 mg/l for the diluted faecal sludge and had an average of 1220 mg/l. The values clearly show that the TVS concentrations of the faecal sludge were higher than that of the primary sludge. This may be due in part to the different dilution ratios used. From the 10th week till the end of the experiment, the TVS removal efficiency averaged 78%, a 4% rise over the average for the whole duration of the experiment. During the period the mean TVS influent concentration increased significantly to 5440 mg/l while the mean effluent concentration decreased marginally compared to the respective mean values for the whole duration of the experiment.

The high TVS removal efficiencies indicate the effectiveness of the UASB reactor in digesting faecal sludges under anaerobic digestion when the operating conditions are right. Figures 6-4 show that the effluent concentrations of the total volatile solids was fairly constant although the influent concentrations varied considerable. This demonstrates the ability of the UASB reactor to handle quite well varying loads applied to the reactor. The fairly constant effluent quality would be beneficial in the design of any post-treatment facility to improve upon the effluent quality from the reactor.

The ratio of TVS to TS decreased as the waste passed through the UASB reactor. That is the volatile content of the total solids, which gives a measure of the organic component decreased during the anaerobic digestion in the UASB reactor. The mean influent TVS/TS ratios was 64% for the faecal sludges. In the effluent, TVS/TS ratios was 42%. Thus in the experiment, there was a drop of just over 20% in the TVS/TS ratio as a result of the anaerobic digestion in the UASB reactor.

6.8.4 Nitrogen removal efficiencies

Organic nitrogen was measured for the influent and effluent. The influent organic nitrogen concentrations ranged from 205 to 520 mg-N/l and had a mean of 300 N-mg/l while the effluent organic nitrogen concentration varied between 130 to 325 mg-N/l with a mean of 185 mg/l. The results indicated that organic concentration decreased as a result of the anaerobic treatment. This is to be expected as in anaerobic digestion, organic compounds containing organic nitrogen are consumed by bacteria and converted into ammonia and amino acids. Organic nitrogen removal during the anaerobic digestion in the UASB reactor ranged from 27% to 45% with an average of 37%. The ammonia nitrogen produced from the conversion of the organic nitrogen is consumed by bacteria as they grow (Leslie Grady Jr. 1999) and the only measurable event with regards to ammonia production is the net accumulation or loss of ammonia in the medium. The reduction in the concentration of organic nitrogen ranged between 60 and 195 N-mg/l. This is amount that would have been converted into ammonia, part of which would be used by growing bacteria and the rest released. These concentrations are well below the inhibitory levels and free ammonia concentrations should not pose any problems to the anaerobic digestion process.

6.8.5 Biogas Production

Anaerobic digestion of organic material produces biogas, which consists mainly of methane and carbon dioxide. The biogas is produced during methanogenesis which is the last stage of the anaerobic digestion process. The production of biogas can therefore be used to ascertain the progress of anaerobic digestion as was done in this research.

In the research, with the main focus being on determining the suitability of the UASB reactor in the treatment of faecal sludges, biogas production was observed and used as an indication of the progress of the digestion process. Volumes of biogas produced were noted. Due to the experimental design, although volumes of biogas collected were noted, the experimental set-ups were not checked for gas

leakages and also the biogas collected were not analysed for gas composition. Much more biogas could have been collected in the UASB reactors if they had been properly sealed to prevent any biogas leakages. Furthermore as highlighted in section 5-7, a considerable portion of the biogas produced remains dissolved in the liquid phase and leaves the system in the effluent.

The calculated volumes of methane in the collected biogas and its COD equivalence are shown in Figure 6-8 and Table 6-7. Figures 6-9 and 6-10 also show the ratio of COD equivalence of the methane to the total COD removed, the volume of methane produced per kg COD removed and the volume of methane produced per kg TVS removed. The calculated volume of methane in the collected biogas increased first sharply at the beginning and then gradually in the latter half of the experiment. Just as in the case for primary sludge the ratio of the COD equivalence of methane to total COD removed was fairly constant throughout the experimental period with the same mean and standard deviation. This suggests that the COD associated with the methane produced may be a fairly constant ratio to the total COD removed. In terms of the volume of methane per kg COD removed and volume of methane per kg TVS removed, it averaged 5.5 l with a standard deviation of 0.6 l and 9.6 l with a standard deviation of 2.0 l respectively. Once again the variation in the calculated volume of methane was higher for TVS than COD removed (Figure 6-10).

The calculated volume of methane in the biogas collected were substantially less than the expected values. As shown in the example in section 5.10, at a temperature of 23 °C, the methane yield per kg COD is about 340 l/kg COD. Practically, van Haandel and Lettinga (1994) reports that the losses could be up to 50%. In this experiment, gas leakages were not checked. Biogas lost due to leakages were very substantial if the calculated volume of methane in the biogas collected is compared to the expected value.

Although substantial amount of biogas produced was lost, with a properly built UASB biogas leakages can be eliminated. The potential of biogas production from the UASB reactor is presented in detail in the design of a typical UASB plant to treat the faecal sludge from the city of Kumasi. In Ghana, the use of liquid petroleum gas (LPG) by households and motorists is on the increase as people try to cut down their energy bills. There will therefore be a commercial market for the gas produced if faecal sludge treatment systems are chosen for their biogas production potential.

6.9 Comparison of FSTP and UASB Reactor

In the following sections FSTP is compared to the UASB in a typical design for the city of Kumasi for faecal sludge (detail designs of the two systems are presented in the Appendix 1). The design is based on the population of Kumasi from the census conducted in 2000.

6.9.1 Land Area Requirements

Excluding the land area required for either sludge drying or co-composting of sludge with suitable organic bulking material, the total area required for the FSTP is 12 hectares, while the land area required for the UASB system is 7 hectares. That is, if the UASB system is used, this could result in a land savings of 5 hectares (about 42%). In an urban setting where land is scarce and expensive, this could represent a substantial financial saving in capital expenditure.

6.9.2 Detention Time and Effluent Quality

The total detention time for the FSTP is 35 days and the BOD of the effluent is 127 mg/l. With regards to the treatment system using UASB, the total detention time is 10.5 days and it produces an effluent BOD concentration of 37 mg/l. The UASB system therefore achieves a much higher effluent quality (70% better) than the FSTP in a much shorter time.

6.9.3 Methane Production

In addition to the above advantages, the methane produced in the UASB reactor can be collected and this would have commercial value. In the design presented in the Annex, the daily production of methane is between 330 m³/d and 376 m³/d. These values are very conservative and substantially lower as they were calculated using the methane production per kg COD and TVS removed obtained in the Kumasi experiments respectively. As mentioned in section 6.8.5 these values are very low due to the loss of biogas from the UASB reactor used for the experiment. Thus in full-scale UASB where the collection of biogas is well designed the amount of biogas collected could be substantial.

7 Conclusions

The following conclusions are set based on the findings in the literature as well as the postgraduate experiments performed.

1. The study indicates that the UASB process can be used for the anaerobic treatment of primary and faecal sludges under tropical climatic conditions employing an organic loading rate of up to 21.5 kg COD/m³.d and hydraulic retention times of 10-12 hours with treatment efficiencies of over 70% on the basis of total COD reduction.
2. The data from the experimental study clearly show that a UASB reactor is able to handle varying influent loads and yet produce an effluent of fairly constant characteristics.
3. The removal efficiencies for total chemical oxygen demand (COD), total solids (TS) and total volatile solids (TVS) were high and are comparable with those reported in the literature for anaerobic treatment of sewage using the UASB reactor.
4. UASB reactors treating faecal sludges will reach steady state conditions much earlier than similar reactors treating domestic sewage due to the high influent solids concentration from the outset of the treatment.
5. In general, the trend of the treatment performance of UASB reactors treating faecal sludges increases steadily from the outset, unlike the reported experiences with UASB reactors treating domestic sewage in which the treatment efficiency first dipped before rising steadily due to the time required for the development of the sludge blanket.
6. Although the experimental study has demonstrated that high removal efficiencies of COD, TS, and TVS can be achieved at short retention times, the effluent quality was not good enough to allow direct discharge into receiving water bodies. It will be necessary to apply some form of post-treatment to the effluent from the UASB reactor.
7. The concentrated nature of untreated faecal sludges requires that it be diluted before the UASB can treat it effectively. In this experimental study a dilution ratio of 1:10 to 1:6 was found to be adequate.
8. Although ammonia and ammonium nitrogen concentrations are high in the raw faecal sludge, the concentrations decrease after dilution to levels that are not inhibitory to the performance of the UASB reactor in the anaerobic treatment of the faecal sludges.
9. From the design example presented in the Appendix 1, using the UASB followed by treatment ponds produces effluent of better quality in a much shorter time and using less land area than using solely the FSTP.
10. From the analysis of the gas data and the design example presented in Appendix 1, if the biogas losses are taken into account, then substantial volumes of methane can be produced from the UASB reactor and if properly harnessed, could represent a potential source of energy.
11. Some form of preliminary treatment is required before the anaerobic treatment of the faecal sludges using the UASB reactor. The preliminary treatment should include:
 - a) **Screening:** Initial screening to remove all coarse solids such as sticks, rags, carrier bags and other large objects. These solids are predominantly non-putrescible and would lead to a sludge built up with the reactor resulting in decrease in the effective volume of the UASB reactor.
 - b) **Equalisation and Storage Tank:** Due to the variability of the characteristics of faecal sludges and the manner of collection and transportation, an equalisation storage tank to equalise the

variations in the pollutorial strength of the faecal sludges and also ensure a continuous flow to the UASB reactor is essential.

- c) **Grit Removal:** The washing and cleaning of public toilets result in grit being deposited in the toilets, especially aqua-privies and KVIPs. In order to prevent grit accumulation in the reactor it is essential to have a grit removal system after the dilution process.

8 Suggestions for further work

The literature and the present study demonstrates that it is possible to use the UASB reactor to anaerobically treat faecal sludges when diluted appropriately. This holds an enormous potential for faecal wastes treatment in developing countries like Ghana where majority of sanitation facilities are on-site systems. However before the system can be adopted on a scale similar to its acceptance for the treatment of domestic sewage in tropical and sub-tropical climatic conditions, it will be essential to carry out more experimental studies. In this regard the following suggestions for further research work are made:

- i. Experiments similar to the one undertaken in this research should be undertaken over a much longer period to establish steady state conditions that will enable correct assessments of long-term treatment efficiencies, optimal loading rates, optimal hydraulic retention times, suitable dilution ratio, and gas production potentials among others.
- ii. During such an experiment, efforts should be made to minimised, if not completely eliminate, the loss of biogas due to leakages and also an analysis of the biogas produced must be carried out to determine the percentages of methane and carbon dioxide in the biogas.
- iii. Such long term experiments should provide the required information for developing design and operation/maintenance guidelines when using the UASB for the treatment of faecal sludges.
- iv. Research efforts to find improvements in the dewatering properties of faecal sludges when subjected to anaerobic treatment in the UASB should be undertaken.

References

- American Public Health Association, American Water Works Association and Water Environment Federation (1995). *Standard Methods for the Examination of Water and Wastewater* (19th Edition).
- Anderson, G. K. and Yang, G. (1992). Determination of bicarbonate and total volatile acid concentration in anaerobic digesters using a simple titration. *Water Environment Research*, Vol. 64, No. 1, pp.53-59.
- Angelidaki, I. and Ahring, B. K. (1993). Thermophilic anaerobic digestion of livestock waste: effect of ammonia. *Applied Microbiology Biotechnology*. Vol. 38, pp.560-564.
- Angelidaki, I. and Ahring, B. K. (1994). Anaerobic thermophilic digestion of manure at different ammonia loads: effects of temperature. *Water Research*. Vol. 28, No. 3, pp.727-731.
- Braun, R., Huber, P. and Meyrath J. (1981). Ammonia toxicity in liquid piggery manure digestion. *Biotechnology Letters*, Vol. 3, pp.159-164.
- Caincross, S. and Feachem, R. G. (1993). *Environmental. Health Engineering in the Tropics: An Introductory Text*. (2nd edition). John Wiley & Sons. Chichester, UK.
- Choi, E. S. (1985). Wastes disposal and resources. *Cheongmungag*, 196 (cited by Um and Kim, 1986).
- Choi, E., Lee, H. S., Lee, J. W. and Oa, S. W. (1996). Another carbon source for BNR system. *Water Science and Technology*, Vol. 34, No. 1-2, pp. 363-369.
- Choi, E., Oa, S. W. and Lee, J. J. (1997). Nightsoil treatment plant converted into sequencing batch reactor to improve removal of pollutants and nutrients. *Water Science and Technology*, Vol. 35, No. 1, pp. 233-240.
- Cillie, G. C., Henzen M. R., Stander, G. J., and Baillie, R. D. (1969). Anaerobic digestion – IV. The application of the process in waste purification. *Water Research*, Vol. 3, pp. 623-643.
- Coulter, J. B., Soneda, S. and Etinger, M. B. (1957). Anaerobic contact process for sewage disposal. *Sewage and Industrial Wastes*, Vol. 29, p.468 (cited by van Haandel *et al.*, 1996).
- De Baere L. A., Devocht, M. and van Assche, P. (1984). Influence of high NaCl and NH₄Cl salt levels on methanogenic associations. *Water Research*. Vol. 18, pp. 543-548.
- DeMan, A.W.A. (1990). Anaerobic purification of raw sewage with the aid of granular sludge in UASB reactors. *Report Agricultural University of Wageningen*, Department of Water Pollution Control (in Dutch). (cited by van Haandel and Lettinga (1994)).
- Frankin, R. J., Koevoets, W. A. A., van Gils, W. M. A., and van der Pas, A. (1991). Application of the BIOBED Upflow Fluidised Bed Process for Anaerobic Waste Water Treatment. Presented at 6th *International Symposium Anaerobic Digestion*. May 12-16, Sao Paulo, Brazil.
- Gujer, W. and Zehnder, A. J. B. (1983). Conversion processes in anaerobic digestion. *Water Science and Technology*, Vol. 15, Copenhagen, pp. 127-167.
- Guo, S. B., Chen, R. Z., Li, G. and Shoichi, H. Y. (1991). Approach to the reforms in nightsoil treatment process introduced abroad. *Water Science and Technology* Vol. 24, No. 5, pp. 189-196.
- Hall, E. R. (1992). Anaerobic treatment of wastewaters in suspended growth and fixed film processes. In *Design of Anaerobic Processes for the Treatment of Industrial and Municipal Wastes*. Water Quality Management Library - Volume 7. Edited by J. F. Malina, Jr. and F. G. Pohland. Technomic Publishing Company, Inc., Lancaster, Pennsylvania, U.S.A.
- Hashimoto, A. G., Varel V. H., and Chen, Y. R. (1981). Ultimate methane yield from beef cattle manure: effect of temperature. Ration constituents, antibiotics and manure age. *Agric. Waste*. Vol. 3, pp. 241–256.

- Hashimoto, G. (1986). Ammonia inhibition of methanogenesis from cattle wastes. *Agricultural Wastes*, Vol. 17, pp. 241-261.
- Heinss, U., Larmie, S. A., and Strauss, M. (1998). *Solids Separation and Pond Systems for the Treatment of Faecal Sludges in the Tropics: Lessons Learnt and Recommendations for Preliminary Design*. SANDEC Report No. 5/98. SANDEC/EAWAG, CH-8600, Dübendorf, Switzerland
- Henze, M. and Harremoes, P. (1983). Anaerobic treatment of waste water in fixed film reactors - a literature review. *Water Science and Technology*, Vol. 15, Copenhagen, pp. 1-101.
- Ikedo, I. (1965, 1966, 1968). *Experimental Studies on Wet Air Oxidation of Sewage Sludge and Night Soil*. Sewage Department, Yokohama City Office, Yokohama, Japan. Parts I, II, and III (cited by Pradt, 1971).
- Iwai, S., Honda, A. and Chang, C. -Y. (1962). Experimental studies on high rate digestion of night soil. *Memoirs of the Faculty of Engineering, Kyoto University*, Vol. XXIV, Part 3 (cited by Pradt, 1971).
- Iwai, S., Honda, A. and Chuang, C. -Y. (1964). Experimental Studies on high-rate digestion of nightsoil. In *Proceedings of the First International Conference on Water Pollution Research, London, 1962*. Paper 2-12. Pergamon Press, London. (cited by Matsumoto and Endo, 1965).
- Iza, J., (1991). Fluidised-bed reactors for anaerobic wastewater treatment. *Water Science and Technology*. Vol. 24, No. 8, pp. 109-132.
- Jeris, J. S. (1982). Industrial waste water treatment using anaerobic fluidised bed reactors. *IAWPRC Specialised Seminar on Anaerobic Treatment of Wastewater in Fixed Film Reactors*. Copenhagen. Denmark.
- Jewell, W. J. (1982). Development of the attached microbial film expanded bed process for anaerobic waste treatment. In: *Biological Fluidised Bed Treatment of Water and Waste Water*, Cooper, P. E. and Atkinson, B. (eds.), Ellis Horwood, Chichester, UK. (cited by van Haandel *et al.*, 1996)
- Kim, H. G. and Lee Y. D. (1986). Night Soil Treatment by Biological Fluidised Beds. *Water Science and Technology* Vol. 18, Tokyo, pp. 199-206.
- Koster, I. W. and Lettinga, G. (1984). The influence of ammonia-nitrogen on the specific activity of palletized methanogenic sludge. *Agricultural Wastes* Vol. 9, pp. 205-216.
- Koster, I. W. and Koomen, E. (1988). Ammonia inhibition of the maximum growth rate (μ_m) of the hydrogenotrophic methanogens at various pH-levels and temperatures. *Appl. Microbiol. Biotechnol.* Vol. 28, pp. 500-505.
- Leslie Grady Jr., C. P., Daigger, G. T. and Lim, H. C. (1999). *Biological Wastewater Treatment*. Second Edition, Revised and Expanded. Marcel Dekker, Inc., New York.
- Lettinga, G. (1995). Anaerobic digestion and wastewater treatment systems. *Antonie van Leeuwenhoek*, Vol. 67, pp. 3-28.
- Lettinga, G., van Velsen, A. F. M., Homba S. W., de Zeeuw W. and Klapwijk A. (1980). Use of the upflow sludge blanket (USB) reactor concept for biological wastewater treatment, especially for anaerobic treatment. *Biotechnology and Bioengineering*, Vol. 22, pp. 699-734
- Mah, R. A., Ward, D. M., Baresi, L., and Glass, T. L. (1977). Biogenesis of methane. *A. Rev. Microbiol.* Vol. 31, pp. 309-341.
- Malina Jr., J. F. (1992). Anaerobic Sludge Digestion. In *Design of Anaerobic Processes for the Treatment of Industrial and Municipal Wastes*. Water Quality Management Library - Volume 7. Edited by J. F. Malina, Jr. and F. G. Pohland. Technomic Publishing Company, Inc., Lancaster, Pennsylvania, U.S.A.
- Mara, D. D. (1976). *Sewage Treatment in Hot Climates*. John Wiley & Sons, Chichester, UK.

- Mara, D. D. and Caincross, S. (1989). *Guidelines for the safe use of wastewater and excreta in agriculture and aquaculture*. World Health Organisation, Geneva, Switzerland.
- Mara, D. D. and Sinnatamby, G. S. (1986). Rational design of septic tanks in warm climates. *The Public Health Engineer*, Vol. 14, No. 4, pp. 49-55.
- Mara, D. D., Alabaster, G. P., Pearson, H. W. and Mills, S. W. (1992). *Waste Stabilisation Ponds - A design Manual for Eastern Africa*. Leeds: Lagoon Technology International Limited.
- Matsumoto, J. and Endo, I. (1965). Anaerobic digestion of night soil. In *Advances in Water Pollution Research, Proceedings of the Second International Conference, Tokyo, 1964*. Vol. 2, pp. 17- 42. Pergamon Press Ltd, London.
- McCarthy, P. L. (1966). Kinetics of waste assimilation in anaerobic treatment. In *Developments in industrial microbiology*. American Institute of Biological Sciences Vol. 7 pp. 144-145. (cited by Mara and Sinnatamby, 1986)
- McCarty, P. L. (1964). Anaerobic waste treatment fundamentals. *Public Works*, September, pp 107-112, October, pp 123-126, November, pp 91-94, December, pp 95-99.
- McCarty, P. L. (1982). One hundred years of anaerobic treatment. In *Second International Symposium on Anaerobic Digestion* (6-11 September 1981, Travemünde, Germany), Edited by Hughes *et al.*. Elsevier Biomedical Press B. V., Amsterdam, The Netherlands.
- McInerney, M. J., Bryant, M. P., and Stafford, D. A. (1980). Metabolic stages and energetics of microbial anaerobic digestion. In *First International Symposium on Anaerobic Digestion*, Edited by D. A. Stafford, A. D. Scientific Press, Cardiff, Wales.
- Metcalf & Eddy, Inc. (1991). *Wastewater Engineering: Treatment, Disposal, and Reuse* (3rd edition). McGraw-Hill, Inc., New York
- Mgana, S. (1997). *Faecal sludge treatment in Tanzania*. Unpublished paper presented at “Workshop on the treatment of septage and faecal sludge”, Sogakope, Ghana. 4-5 December, 1997.
- Misaki, T. and Matsui, K. (1996). Night soil system equipped with ultrafiltration. *Desalination*, Vol. 106, pp 63-70.
- Mosey, F. E. (1981). Anaerobic biological treatment of food industry waste waters. *Water Pollution Control Federation*, Vol. 80, No. 2, p. 273.
- Mudrack, K. and Kunst, S. (1986). *Biology of Sewage Treatment and Water Pollution Control*. Ellis Horwood Ltd., Chichester, UK.
- Murakami, Y., Ishii, Y. and Kagi, S. (1986). Advanced night soil treatment by mechanical solids separation and biological process. *Water Science and Technology*, Vol. 18, Tokyo, pp. 347-354.
- Murata, K., Shimizu, K., Yamada, Y. and Kimura, S. (1986). Development of nitrogen removal technology in night soil treatment by circulated aeration type biological denitrification. *Water Science and Technology*, Vol. 18, Tokyo, pp. 327-338.
- Noike, T. and Matsumoto, J. (1986). Upgrading of anaerobic digestion processes for night soil. *Water Science and Technology*, Vol. 18, Tokyo, pp. 249-256.
- O'Rourke, J. T. (1968). Kinetics of anaerobic treatment at reduced temperature. *PhD Thesis*, Stanford University, Stanford. (cited by van Haandel and Lettinga (1994)).
- Parkin, G. F., and Miller, S. W. (1983). Response of methane fermentation to continuous addition of selected industrial toxicants. In *Proceedings of the 37th Industrial Waste Conference*. pp. 726 – 743.
- Peavy, H. S., Rowe, D. R. and Tchobanoglous, G. (1985). *Environmental Engineering*. McGraw-Hill, Inc., New York

- Pescod M. B. (1971). Sludge handling and disposal in tropical developing countries. *Water Pollution Control Federation*. Vol. 43, No. 4, pp. 555-570
- Phillip Harris (1996). Direct Ion method Sheet – Determination of Ammonium in Water.
- Pohland, F. G. (1992). Anaerobic Treatment: Fundamental Concepts, Applications and New Horizons. In *Design of Anaerobic Processes for the Treatment of Industrial and Municipal Wastes*. Water Quality Management Library - Volume 7. Edited by J. F. Malina, Jr. and F. G. Pohland. Technomic Publishing Company, Inc., Lancaster, Pennsylvania, U.S.A.
- Pradt, L. A. (1971). Some recent developments in night soil treatment. *Water Research*, Vol. 5, pp. 507-521.
- Pretorius, W. A. (1971). Anaerobic digestion of raw sewage. *Water Research*, Vol. 5, pp. 681-687
- Pretorius, W. A. (1983). An overview of digestion processes. *Water Science and Technology*, Vol. 15, Capetown, pp. 1-6.
- Rinzema, A. (1989). Anaerobic treatment of waste water with high concentrations of lipids or sulphate. *PhD Thesis*, University of Wageningen, Wageningen. (cited by van Haandel and Lettinga, 1994).
- Satyanarayan, S., Kaul, S. N., Badrinath, S. D. and Gadkari, S. K. (1987). Anaerobic treatment of human wastes. *Indian Journal of Environmental Protection*, Vol. 7, No. 1, pp. 5-10.
- Sawyer, C. N. and McCarty, P. L. (1978). *Chemistry for Environmental Engineering*, 3rd edition, McGraw-Hill, Inc., Singapore.
- Seghezze, L., Zeeman, G., van Lier, J. B., Hamelers, H. V. M., & Lettinga, G. (1998). A review: the anaerobic treatment of sewage in UASB and EGSB reactors. *Bioresource Technology*, Vol. 65 pp. 175-190.
- Shiru, N. and Bo, L. (1991). *Health Assessment of Nightsoil and Wastewater Reuse in Agriculture and Aquaculture*. Final Report. Chinese Academy of Preventive Medicine, Institute of Environmental Health and Engineering, Beijing (Technical Services Agreement WP71CP7RUD/001/RB/88-310, WHO Western Pacific Regional Centre for Promotion of Environmental Planning and Applied Studies, PEPAS). (cited by Strauss and Heinss, 1995).
- Speece, R. E. (1996). *Anaerobic Biotechnology for Industrial Wastewaters*. Archae Press, Nashville, Tennessee, USA.
- Speece, R. E. (1983). Anaerobic biotechnology for industrial wastewater treatment. *Environ. Sci. Technol.*, Vol.17, No. 9, pp.416A-427A.
- Sprott, G. D., Shaw, K. M., and Jarrell, K. F. (1984). Ammonia/potassium exchange in methanogenic bacteria. *J. boil. Chem.*, Vol. 259, pp. 12602-12608.
- Stander, G. J., Cillie, G. C., Ross, W. R., and Baillie, R. D. (1967). Treatment of wine distillery wastes by anaerobic digestion. In *Proceedings of the 22nd Industrial Waste Conference*. Purdue University Press, Lafayette, IN.
- Sterritt, R. M. and Lester, J. N. (1988). *Microbiology for Environmental and Public Health Engineers*. E. & F. N. Spon Ltd. London, UK.
- Stoll, U. and Parameswaran, K. (1996). Treatment and disposal of domestic sewage sludge and nightsoil sludge for Bangkok. *Water Science and Technology*, Vol. 34, No. 11, pp. 206-217.
- Strauss, M. and Heinss, U. (1995). Faecal Sludge Treatment. *SANDEC News* No. 1, May 1995, Duebendorf/Switzerland: EAWAG
- Strauss, M., Larmie, S. A. and Heinss, U. (1997). Treatment of sludges from on-site sanitation - low-cost options. *Water Science and Technology* Vol. 35, No. 6, pp. 126-136.
- Stronach, S. M., Rudd, T. and Lester, J. N. (1986). *Anaerobic Digestion Processes in Industrial Wastewater Treatment*, Springer-Verlag, pp. 21-38. (cited by Pohland, 1992)

- Suchint, P. (1967). Characteristics and Treatment of Bangkok Septic Tank Sludge. *M.S. thesis No. 174*. SEATO Graduate School of Engineering, Bangkok, Thailand. (cited by Pescod, 1971).
- Sutton, P. M. (1986). Suspended and Supported Growth Anaerobic Reactors: Pilot to Full-Scale Results. In *Anaerobic Treatment: A Grown-Up Technology, Proceedings EWPCA Conference on Anaerobic Treatment*. September, Amsterdam, the Netherlands. Pp. 259-268.
- Sutton, P. M., Li, A., Evans, R. R., and Korchin, S. (1983). Dorr-Oliver's Fixed Film and Suspended Growth Anaerobic Systems for Industrial Wastewater Treatment and Energy Recovery. In *Proceedings of the 37th Industrial Waste Conference, Purdue University*. Ann Arbor Science, pp. 667-675.
- Suzuki, T. and Tohya, Y. (1986). Night soil treatment by nitrified liquor recycling process. *Water Science and Technology*, Vol. 18, Tokyo, pp. 339-346.
- Um, W. T. and Choi, J. W. (1984). A study on management index of night soil treatment by aerobic digestion. *J. of Korea Soc. Env. Eng.*, Vol. 10, No. 2, pp. 72-82. (cited by Um and Kim, 1986).
- Um, W. T. and Kim, S. W. (1986). Night soil treatment in Korea. *Water Science and Technology* Vol. 18, Tokyo, pp. 13-22.
- Um, W. T. and Lee, T. S. (1982). An experimental study on the aerobic digestion of night soil. *Report, Institute of Industrial Technology, Yeungnam University*. Vol. 10, No. 1, pp. 9-18. (cited by Um and Kim, 1986).
- Van der Last, A. R. M. (1991). Anaerobic treatment of settled sewage with the EGSB and FB processes. *Report Agricultural University of Wageningen*, Department of Water Pollution Control (in Dutch). (cited by van Haandel and Lettinga (1994)).
- van Haandel, A. C. And Lettinga, G. (1994). *Anaerobic Sewage Treatment: A Practical Guide for Regions with a Hot Climate*. John Wiley & Sons, Chichester, UK.
- van Haandel, A., Catunda, P. F. C. and Lettinga, G. (1996). The UASB Reactor for Industrial and Domestic Waste Water Treatment. In *Environmental Waste Management: A European Perspective*. Edited by Nigel Horan. John Wiley & Sons, Chichester, UK.
- van Velsen, A. F. M. (1979). Adaptation of methanogenic sludge to high ammonia-nitrogen concentrations. *Water Research*. Vol. 13, pp.995-999.
- Wilkie, A., Reynolds, P. J., O'Kelly, N., and Colleran, E. (1984). Support matrix and packing effects in anaerobic filters. In *Proceedings 2nd International Conference Fixed-Film Biological Processes*. Arlington, Virginia, University of Pittsburgh. p. 274.
- Young, J. C. and Dahab, M. F. (1983). Effect of media design on performance of fixed bed anaerobic reactors. *Water Science & Technology*, Vol. 15, pp. 369-383.
- Young, J. C. and McCarty, P. L. (1969). The anaerobic filter for waste treatment. *J. Water Pollution Control Federation*, Vol. 40, R160.
- Zeeman, G., Wiegant W. M., Koster-Treffler, M. E. and Lettinga, G. (1985). The influence of total ammonia concentration on thermophilic digestion of cow manure. *Agric. Wastes*. Vol. 14, pp.19-35.
- Zehnder, A. J. B., Ingvorsen, K. and Marti, T. (1982). Microbiology of methane bacteria. In *Second International Symposium on Anaerobic Digestion (6-11 September 1981, Travemünde, Germany)*, Edited by Hughes et al.. Elsevier Biomedical

APPENDIX 1: DESIGN OF FAECAL SLUDGE TREATMENT PLANT AND UPFLOW ANAEROBIC SLUDGE BLANKET REACTOR

In this section, a faecal sludge treatment plant (FSTP) and an upflow anaerobic sludge blanket (UASB) reactor are designed for the city of Kumasi, Ghana, using the current population. The purpose of the design is to compare the systems and find the merits and demerits of the USAB reactor. The design of the FSTP is based on the recommendations for preliminary design guidelines proposed by Heinss *et al* (1998).

1. Design Assumptions and Requirements

Population ¹		1,020,000
Sanitation service coverage ²	%	Population
Public Toilets	38	387,600
Bucket Latrines	15	153,000
WCs with septic tanks	25	255,000
Sewerage	7	71,400
Pit latrines (KVIPs/Traditional pits)	7	71,400
“Free range” (no facility)	8	81,600
Per capita waste contribution ³		
Public toilet and bucket latrine sludge	2 l/cap.d	
Septage	1 l/cap.d	
COD		
Public toilet and bucket latrine sludge ⁴	86,700 mg/l	
Septage ⁵	8,500 mg/l	
Total Solids		
Public toilet and bucket latrine sludge ⁶	55,700 mg/l	
Septage ⁷	14,000 mg/l	
Mean minimum monthly temperature ⁸	25 °C	

2. Design Calculations for FSTP

Volumetric Load

Public toilet and bucket latrine sludge	=	population x per capita contribution
	=	(387,600 + 153,000) x 2 l/cap.d
	=	1,081,200 l/d
	=	1,081.2 m ³ /d, say 1,100 m³/d
Septage	=	255,000 x 1 l/cap.d
	=	255,000 l/d
	=	255 m ³ /d, say 260 m³/d

¹ Population of Kumasi - Year 2000 population census

² Kumasi Metropolitan Assembly development plan 1996 - 2000

³ Table 2.1

⁴ Table 6.2

⁵ Table 2.2

⁶ Table 6.2

⁷ Table 2.2

⁸ Temperature values of 30 year average (1961-1990) in Kumasi from Ghana Meteorological Services Department Regional Office, Kumasi.

$$V_{\text{load}} = 1,100 \text{ m}^3/\text{d} + 260 \text{ m}^3/\text{d}$$

$$= 1,360 \text{ m}^3/\text{d}$$

COD Load

$$\text{Public toilet and bucket latrine sludge} = \text{COD concentration} \times \text{volumetric load}$$

$$= 86,700 \text{ mg/l} \times 1,100 \text{ m}^3/\text{d}$$

$$= 86.7 \text{ kg/m}^3 \times 1,100 \text{ m}^3/\text{d}$$

$$= 95,370 \text{ kg COD/d}$$

$$\text{Septage} = 8,500 \text{ mg/l} \times 260 \text{ m}^3/\text{d}$$

$$= 8.5 \text{ kg/m}^3 \times 260 \text{ m}^3/\text{d}$$

$$= 2,210 \text{ kg COD/d}$$

$$\text{Total COD Load} = 95,370 \text{ kg COD/d} + 2,210 \text{ kg COD/d}$$

$$= 97,580 \text{ kg COD/d}$$

Total Solids Load

$$\text{Public toilet and bucket latrine sludge} = \text{TS concentration} \times \text{volumetric load}$$

$$= 55,700 \text{ mg/l} \times 1,100 \text{ m}^3/\text{d}$$

$$= 55.7 \text{ kg/m}^3 \times 1,100 \text{ m}^3/\text{d}$$

$$= 61,270 \text{ kg TS/d}$$


$$\text{Septage} = 14,000 \text{ mg/l} \times 260 \text{ m}^3/\text{d}$$

$$= 14 \text{ kg/m}^3 \times 260 \text{ m}^3/\text{d}$$

$$= 3,640 \text{ kg TS/d}$$

$$\text{TS Load} = 61,270 \text{ kg TS/d} + 3,640 \text{ kg TS/d}$$

$$= 64,910 \text{ kg TS/d}$$

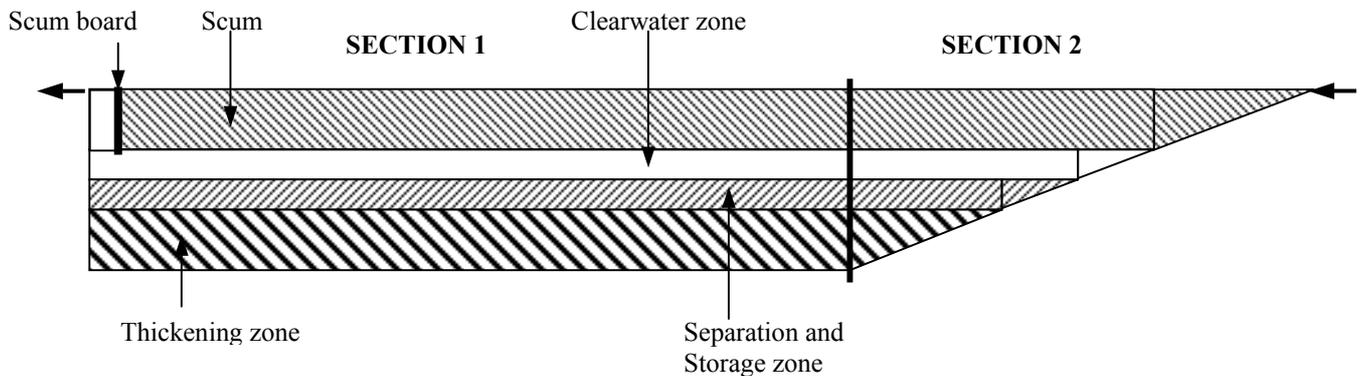Size of Sedimentation/Thickening Tanks (Figure I)**Figure I: Sedimentation/Thickening Tank with Four Distinct Layers of Separated Solids**(Source: Heiness *et al*, 1998)**Table I: Solids Concentration Attained in Full-Scale Settling/Thickening Tanks in Accra, Ghana (Source: Heiness *et al*, 1998)**

Zone	Depth from the surface (m)	Solids concentration (kg/m ³)
Scum	0 – 0.8	160
Clearwater zone	0.8 – 1.3	4
Separation and storage zone	1.3 – 1.8	60
Thickening zone	> 1.8	140

Assume minimal nominal liquid retention time	=	4 h
V_{load}	=	1,360 m ³ /d
Assume 2 tanks are to be built in parallel		
Hourly influent	=	(1,360/2) m ³ / 8 hours
	=	85 m ³ /h
Volume required for clearwater zone	=	85 m ³ /h x 4 h
	=	340 m ³
Assume tank width	=	10 m
Length of Clearwater zone (section 1)	=	340 m ³ / (10 m x 0.5 m)
	=	68 m say 70 m
Assume slope of ramp	=	20 °
Length of section 2	=	8.8 m, say 10 m.
Assume effective tank depth, d	=	4 m

Volume of section 1 of tank:

$$\begin{aligned} V_{S1} &= 70 \text{ m} \times 10 \text{ m} \times 4.0 \text{ m} \\ &= 2,800 \text{ m}^3 \end{aligned}$$

Volume of section 2 of tank:

$$V_{S2} = (10 \text{ m} \times 10 \text{ m} \times 4.0 \text{ m}) \times 0.5 = 200 \text{ m}^3$$

Volume of tank:

$$\begin{aligned} V &= 2,800 \text{ m}^3 + 200 \text{ m}^3 \\ &= 3,000 \text{ m}^3 \end{aligned}$$

V_{S1} accounts for 93% of the total volume of tank.

Sludge mass stored in section 1:

$$\begin{aligned} V_{S1} &= (\text{Sludge mass to stored/solids concentration per m}^2) \times \text{depth} \\ 2,800 \text{ m}^3 &= [(\text{Sludge mass stored}) \text{ kg} / (0.8 \text{ m} \times 160 \text{ kg/m}^3 + 0.5 \text{ m} \times 60 \text{ kg/m}^3 + \\ &\quad 2.2 \text{ m} \times 140 \text{ kg/m}^3)] \times 4.0 \text{ m} \end{aligned}$$

$$\begin{aligned} \text{Sludge mass stored} &= [2,800 \text{ m}^3 / 4.0 \text{ m}] \times (0.8 \text{ m} \times 160 \text{ kg/m}^3 + \\ &\quad 0.5 \text{ m} \times 60 \text{ kg/m}^3 + 2.2 \text{ m} \times 140 \text{ kg/m}^3) \\ &= 326,200 \text{ kg} \end{aligned}$$

$$\begin{aligned} \text{Total sludge mass} &= 326,200 \text{ kg} / 0.93 \\ &= 350,750 \text{ kg} \end{aligned}$$

$$\text{Assume solids removal} = 70\%$$

$$\begin{aligned} \text{Tank loading period} &= \text{Sludge mass stored} / (\text{percent removal} \times \text{TS load}) \\ &= 350,750 \text{ kg} / (0.7 \times 0.5 \times 64,910 \text{ kg/d}) \\ &= 15.4 \text{ days, say 14 days, i.e. 2 weeks} \end{aligned}$$

Heinss *et al.* (1998) recommends 4 weeks resting period before emptying tank of accumulated sludge and reloading. Thus operationally, 6 tanks would be constructed with two in use at the same time with a loading period of 14 days and a resting period of 28 days. Hence once every 4 weeks a volume of approximately 6,000 m³ of separated solids with TS \geq 14% must be removed and further treated. Currently this is done by co-composting with suitable organic bulking material such as domestic refuse, sawdust or woodchips.

Total land area required for sedimentation/thickening tanks:

$$A_{\text{total}} = (70 \text{ m} + 10 \text{ m}) \times 10 \text{ m} \times 6 = 4,800 \text{ m}^2$$

Anaerobic Ponds

$$\begin{aligned} \text{Assume COD removal in tank} &= 50\% \\ \text{COD load to anaerobic pond} &= 0.5 \times 97,580 \text{ kg COD/d} \\ &= 48,790 \text{ kg COD/d} \end{aligned}$$

$$\text{BOD}^9 \text{ load to anaerobic pond} = 13,186 \text{ kg BOD/d, say } \mathbf{13,200 \text{ kg BOD/d.}}$$

$$\text{Assume volumetric BOD loading rate} = 350 \text{ g BOD/m}^3 \cdot \text{d}$$

Check for Ammonia Toxicity

Ammonium nitrogen concentration¹⁰

$$\begin{aligned} \text{Septage} &= 200 \text{ mg/l} \\ \text{Public toilet and bucket latrine sludge} &= 2,500 \text{ mg/l} \end{aligned}$$

$$\begin{aligned} \text{Average influent concentration} &= \frac{\{(255,000 \text{ l/d} \times 200 \text{ mg/l}) + (1,081,200 \text{ l/d} \times 2,500 \text{ mg/l})\}}{(255,000 \text{ l/d} + 1,081,200 \text{ l/d})} \\ &= 2060 \text{ mg/l} \end{aligned}$$

$$\begin{aligned} \text{Assume ammonium nitrogen losses in tank} &= 5\% \\ \text{Ammonium nitrogen influent to pond system} &= 0.95 \times 2,060 \text{ mg/l} \\ &= 1,960 \text{ mg/l} \end{aligned}$$

Using Figure 2-14, for a maximum pH = 8.5 and average temperature = 25 °C

$$\begin{aligned} \text{Ammonia nitrogen concentration} &= 18\% \text{ of } 1,960 \text{ mg/l} \\ &= 353 \text{ mg/l.} \end{aligned}$$

This concentration is above the threshold for ammonia toxicity to anaerobic bacteria (100 mg/l). Hence the effluent from the pond is to be diluted 1:4 to ensure that the threshold concentration is not exceeded.

Sizing of anaerobic pond

Assume 5% loss in settling-thickening tank, thus volumetric load after dilution

$$\begin{aligned} V_{\text{load}}^* &= 0.95 \times 1,360 \text{ m}^3/\text{d} \times 4 \\ &= 5,168 \text{ m}^3/\text{d, say } \mathbf{5,200 \text{ m}^3/\text{d}} \end{aligned}$$

$$\begin{aligned} \text{BOD load} &= 13,200,000 \text{ g BOD/d} \\ \text{BOD volumetric load} &= 350 \text{ g/m}^3 \cdot \text{d} \\ V_{\text{an.p}} &= [13,200,000 \text{ g BOD/d}] / 350 \text{ g/m}^3 \cdot \text{d} \\ &= 37,714 \text{ m}^3 \end{aligned}$$

$$\begin{aligned} \text{Retention time} &= (37,714 \text{ m}^3) / (5,200 \text{ m}^3/\text{d}) \\ &= 7.2 \text{ d, } \mathbf{OK} \end{aligned}$$

$$\begin{aligned} \text{Assume anaerobic pond depth} &= 3 \text{ m} \\ \text{Anaerobic pond area} &= 37,714 \text{ m}^3 / 3 \text{ m} \\ &= 12,571 \text{ m}^2 \end{aligned}$$

Choosing a width to length ratio of 3:1, the pond will have the following dimensions:

$$\begin{aligned} \text{Length} &= 195 \text{ m} \\ \text{Width} &= 65 \text{ m} \end{aligned}$$

⁹ Table 5.1: COD/BOD = 3.7:1

¹⁰ Heiness *et al* (1998)

Assume 4 anaerobic ponds in parallel, then pond dimensions would be:

$$\begin{aligned} \text{Length} &= 99 \text{ m} \\ \text{Width} &= 33 \text{ m} \end{aligned}$$

$$\text{Total pond area} = 4 \times 33 \text{ m} \times 99 \text{ m} = 13,068 \text{ m}^2$$

$$\begin{aligned} \text{Assume BOD removal in anaerobic pond} &= 75\% \\ \text{BOD load in anaerobic pond effluent} &= [0.25 \times 13,200 \text{ kg BOD/d}] \\ &= 3,300 \text{ kg BOD/d} \\ \text{BOD concentration} &= [3,300 \text{ kg BOD/d}] / 5,200 \text{ m}^3/\text{d} = 635 \text{ mg/l} \end{aligned}$$

Facultative Ponds

Using Mara's (1987) tentative global equation:

$$\begin{aligned} \lambda_s &= 350 (1.107 - 0.002T)^{T-25} \\ \text{where } \lambda_s &= \text{BOD surface area loading (kg/ha.d)} \\ T &= \text{temperature (}^\circ\text{C)} \end{aligned}$$

$$\begin{aligned} \text{At } T = 25^\circ\text{C, } \lambda_s &= 350 \text{ kg/ha.d} \\ A_{\text{fac. pond}} &= [3,300 \text{ kg BOD/d}] / 350 \text{ kg/ha.d} \\ &= 9.428 \text{ ha} \\ &= 94,280 \text{ m}^2 \end{aligned}$$

Assume a width to length ratio of 1:6 and that 8 ponds are to be constructed, the pond dimensions would be:

$$\begin{aligned} \text{Length} &= 270 \text{ m} \\ \text{Width} &= 45 \text{ m} \end{aligned}$$

$$\text{Total pond area} = 8 \times 270 \text{ m} \times 45 \text{ m} = 97,200 \text{ m}^2$$

Using a depth of 1.5 m

$$\begin{aligned} \text{Volume of pond, } V_{\text{fac. pond}} &= 1.5 \text{ m} \times 97,200 \text{ m}^2 = 145,800 \text{ m}^3 \\ \text{Retention time} &= 145,800 \text{ m}^3 / 5,200 \text{ m}^3/\text{d} = 28 \text{ days,} \\ \text{Assume 80\% BOD removal in facultative pond} & \\ \text{Effluent BOD} &= 0.2 \times 635 \text{ mg/l} = 127 \text{ mg/l} \end{aligned}$$

$$\begin{aligned} \text{Total land area required} &= 4,800 \text{ m}^2 + 13,068 \text{ m}^2 + 97,200 \text{ m}^2 \\ &= 115,068 \text{ m}^2 \\ &\approx 12 \text{ ha} \end{aligned}$$

(Land area excludes area required for pond embankments, access roads and drying of sludge)

3. Design Calculations for UASB

The design of the UASB is based on organic loading rather than hydraulic loading because of the concentrated nature of the wastes. The necessary design equations used are:

$$l_o = \frac{L_o}{V_r} = \frac{Q_i S_{ti}}{V_r} = \frac{S_{ti}}{(HRT)}$$

where

$$\begin{aligned} l_o &= \text{applied specific COD load (kg COD m}^{-3} \text{ d}^{-1}) \\ L_o &= \text{organic (COD) load (kg COD d}^{-1}) \\ V_r &= \text{volume of the reactor (m}^3); \\ Q_i &= \text{average wastewater flow (m}^3/\text{d);} \\ S_{ti} &= \text{influent organic material (COD) concentration (kg/m}^3) \\ (HRT) &= \text{hydraulic retention time (d)} \end{aligned}$$

Volumetric Load

$$\begin{aligned}
 \text{Public toilet and bucket latrine sludge} &= \text{population} \times \text{per capita contribution} \\
 &= (387,600 + 153,000) \times 2 \text{ l/cap.d} \\
 &= 1,081,200 \text{ l/d} \\
 &= 1,081.2 \text{ m}^3/\text{d}, \text{ say } \mathbf{1,100 \text{ m}^3/\text{d}}
 \end{aligned}$$

$$\begin{aligned}
 \text{Septage} &= 255,000 \times 1 \text{ l/cap.d} \\
 &= 255,000 \text{ l/d} \\
 &= 255 \text{ m}^3/\text{d}, \text{ say } \mathbf{260 \text{ m}^3/\text{d}}
 \end{aligned}$$

$$\begin{aligned}
 \text{Total volume of faecal sludge} &= 1,100 \text{ m}^3/\text{d} + 260 \text{ m}^3/\text{d} \\
 &= 1,360 \text{ m}^3/\text{d}
 \end{aligned}$$

Assume dilution ratio of 1:8

$$\text{Volumetric load, } V_{\text{load}} = \mathbf{10,880 \text{ m}^3/\text{d}}$$

COD Load

$$\begin{aligned}
 \text{Public toilet and bucket latrine sludge} &= \text{COD concentration} \times \text{volumetric load} \\
 &= 86,700 \text{ mg/l} \times 1,100 \text{ m}^3/\text{d} \\
 &= 86.7 \text{ kg/m}^3 \times 1,100 \text{ m}^3/\text{d} \\
 &= 95,370 \text{ kg COD/d}
 \end{aligned}$$

$$\begin{aligned}
 \text{Septage} &= 8,500 \text{ mg/l} \times 260 \text{ m}^3/\text{d} \\
 &= 8.5 \text{ kg/m}^3 \times 260 \text{ m}^3/\text{d} \\
 &= 2,210 \text{ kg COD/d}
 \end{aligned}$$

$$\begin{aligned}
 \text{Total COD}_{\text{Load}} &= 95,370 \text{ kg COD/d} + 2,210 \text{ kg COD/d} \\
 &= 97,580 \text{ kg COD/d}
 \end{aligned}$$

$$\begin{aligned}
 \text{Influent COD concentration} &= [97,580 \text{ kg COD/d}] / 10,880 \text{ m}^3/\text{d} \\
 &\approx 9.0 \text{ kg/m}^3
 \end{aligned}$$

$$\begin{aligned}
 \text{Assume applied specific COD load } l_o &= 17 \text{ kg COD/m}^3 \cdot \text{d}^{11} \\
 \text{Volume of reactor, } V_r &= L_o / l_o \\
 &= [97,580 \text{ kg COD/d}] / 17 \text{ kg COD/m}^3 \cdot \text{d} \\
 &= 5,740 \text{ m}^3
 \end{aligned}$$

A number of reactors would have to be constructed to accommodate this volume. Rectangular section reactors would be used for reasons stated in section 5.3.2

Use a reactor of dimensions (length x width x height) 24m x 10m x 6m

$$\text{Volume of reactor} = 1,440 \text{ m}^3.$$

$$\text{Hence four (4) reactors would be used with total volume} = 5,760 \text{ m}^3$$

$$\begin{aligned}
 \text{Daily flow to each reactor} &= [10,880 \text{ m}^3/\text{d}] / 4 \\
 &= 2,720 \text{ m}^3/\text{d}
 \end{aligned}$$

$$\begin{aligned}
 \text{Organic load to each reactor} &= 9.0 \text{ kg/m}^3 \times 2,720 \text{ m}^3/\text{d} \\
 &= 24,480 \text{ kg COD/d}
 \end{aligned}$$

$$\begin{aligned}
 \text{Applied specific COD load } l_o &= [24,480 \text{ kg COD/d}] / 1,440 \text{ m}^3 \\
 &= 17 \text{ kg COD/m}^3 \cdot \text{d} (< 20 \text{ kg COD/m}^3 \cdot \text{d}) \quad \mathbf{OK.}
 \end{aligned}$$

¹¹ Average applied specific COD load in the Kumasi experiment.

$$\begin{aligned} \text{Total area cross-sectional area of 4 reactors} &= 4 \times 24\text{m} \times 10\text{m} \\ &= 960 \text{ m}^2 \end{aligned}$$

$$\begin{aligned} \text{Hydraulic retention time, } HRT, &= S_{ii} / l_o \\ &= [9.0 \text{ kg/m}^3] / [17 \text{ kg COD/m}^3 \cdot \text{d}] \\ &= 0.53 \text{ d} \\ &= 12.7 \text{ h} \end{aligned}$$

$$\begin{aligned} \text{Upflow velocity, } v_i \text{ (m/h)} &= H / (HRT) \\ &= 6\text{m} / 12.7\text{h} \\ &= 0.47 \text{ m/h } (< 1 \text{ m/h}) \quad \text{OK.} \end{aligned}$$

Storage/Flow Equalisation Tank

Due to the variability of the characteristics of faecal sludges and the intermittent manner of collection and transportation, an equalisation/storage tank is required to even out the variations in the pollutional strength of the faecal sludges and also ensure a continuous flow to the UASB reactor.

$$\begin{aligned} \text{Volumetric Load} &= 10,880 \text{ m}^3/\text{d} \text{ (delivered in 8 hours)} \\ \text{i.e. Influent flowrate into tank} &= 1360 \text{ m}^3/\text{h} \\ \text{Flowrate from storage tank} &= 454 \text{ m}^3/\text{h} \\ \text{Daily storage volume required} &= 10,880 \text{ m}^3 - [454 \text{ m}^3/\text{h} \times 8 \text{ h}] \\ &= 7,248 \text{ m}^3, \text{ say } 7,250 \text{ m}^3 \end{aligned}$$

$$\begin{aligned} \text{Assume depth of tank} &= 2.5 \text{ m} \\ \text{Area of tank} &= 2,900 \text{ m}^2 \end{aligned}$$

Using a width to length ratio of 1:4, the tank would have dimensions 27m x 108m.

Table: II Assumed Treatment Performance for UASB Reactor¹²

Parameter	Treatment Performance
COD removal	70%
TS removal	60%
TVS removal	75%
Organic nitrogen removal	35%
Volume of methane per g COD removal	5.5 ml
Volume of methane per g TVS removal	9.6 ml

Influent Characteristics after dilution

$$\begin{aligned} \text{COD} &= 9 \text{ kg/m}^3 \end{aligned}$$

Total Solids

$$\begin{aligned} \text{Public toilet and bucket latrine sludge} &= \text{TS concentration} \times \text{volumetric load} \\ &= 55,700 \text{ mg/l} \times 1,100 \text{ m}^3/\text{d} \\ &= 55.7 \text{ kg/m}^3 \times 1,100 \text{ m}^3/\text{d} \\ &= 61,270 \text{ kg TS/d} \end{aligned}$$

$$\begin{aligned} \text{Septage} &= 14,000 \text{ mg/l} \times 260 \text{ m}^3/\text{d} \\ &= 14 \text{ kg/m}^3 \times 260 \text{ m}^3/\text{d} \\ &= 3,640 \text{ kg TS/d} \end{aligned}$$

¹² Values from treatment performance of UASB reactor during the Kumasi experiments

$$\begin{aligned} \text{TS}_{\text{Load}} &= 61,270 \text{ kg TS/d} + 3,640 \text{ kg TS/d} \\ &= 64,910 \text{ kg TS/d} \\ \text{TS concentration} &= [64,910 \text{ kg TS/d}] / [10,880 \text{ m}^3/\text{d}] \\ &\approx 6.0 \text{ kg TS/m}^3, \text{ i.e. } \mathbf{6,000 \text{ g/m}^3 \text{ or mg/l}} \end{aligned}$$

Total Volatile Solids

$$\begin{aligned} \text{Public toilet and bucket latrine sludge} &= \text{TVS concentration} \times \text{volumetric load} \\ &= 39,700 \text{ mg/l} \times 1,100 \text{ m}^3/\text{d} \\ &= 39.7 \text{ kg/m}^3 \times 1,100 \text{ m}^3/\text{d} \\ &= 43,670 \text{ kg TVS/d} \\ \text{Septage} &= 8,400 \text{ mg/l} \times 260 \text{ m}^3/\text{d} \\ &= 8.4 \text{ kg/m}^3 \times 260 \text{ m}^3/\text{d} \\ &= 2,184 \text{ kg TVS/d} \\ \text{TVS}_{\text{Load}} &= 43,670 \text{ kg TVS/d} + 2,184 \text{ kg TVS/d} \\ &= 45,854 \text{ kg TVS/d} \\ \text{TVS concentration} &= [45,854 \text{ kg TVS/d}] / [10,880 \text{ m}^3/\text{d}] \\ &\approx 4.2 \text{ kg TVS/m}^3, \text{ i.e. } \mathbf{4,200 \text{ g/m}^3 \text{ or mg/l}} \end{aligned}$$

Organic nitrogen

$$\begin{aligned} \text{Ammonium nitrogen concentration before dilution}^{13} \\ \text{Septage} &= 200 \text{ mg/l} \\ \text{Public toilet and bucket latrine sludge} &= 2,500 \text{ mg/l} \end{aligned}$$

$$\begin{aligned} \text{Average influent concentration} &= \frac{\{260 \text{ m}^3/\text{d} \times 0.2 \text{ kg/m}^3 + 1,100 \text{ m}^3/\text{d} \times 2.5 \text{ kg/m}^3\}}{10,880 \text{ m}^3/\text{d}} \\ &= 0.26 \text{ kg/m}^3; \text{ i.e. } \mathbf{260 \text{ g/m}^3 \text{ or mg/l}} \end{aligned}$$

Using the above treatment performances (Table II), the effluent characteristics from the UASB reactor would be:

$$\begin{aligned} \text{Effluent COD} &= 0.3 \times 9,000 \text{ g/m}^3 \\ &= 2,700 \text{ g/m}^3 \\ \text{Effluent BOD}^{14} &= 730 \text{ g/m}^3 \\ \text{Effluent TS} &= 0.4 \times 6,000 \text{ g/m}^3 \\ &= 2,400 \text{ g/m}^3 \\ \text{Effluent TVS} &= 0.25 \times 4,200 \text{ g/m}^3 \\ &= 1,050 \text{ g/m}^3 \end{aligned}$$

Sizing of anaerobic pond

$$V_{\text{load}} = 10,880 \text{ m}^3/\text{d}$$

$$\begin{aligned} \text{BOD load} &= 730 \text{ g/m}^3 \times 10,880 \text{ m}^3/\text{d} \\ &= 7,942,400 \text{ g BOD/d} \\ \text{BOD volumetric load} &= 350 \text{ g/m}^3 \cdot \text{d} \\ V_{\text{an, p}} &= [7,942,400 \text{ g BOD/d}] / 350 \text{ g/m}^3 \cdot \text{d} \end{aligned}$$

¹³ Heiness *et al* (1998)

¹⁴ Table 5.1 – COD:BOD = 3.7:1

$$= 22,693 \text{ m}^3$$

$$\text{Retention time} = (22,693 \text{ m}^3) / (10,880 \text{ m}^3/\text{d})$$

$$= 2.0 \text{ d, OK}$$

$$\text{Assume anaerobic pond depth} = 3 \text{ m}$$

$$\text{Anaerobic pond area} = 22,693 \text{ m}^3 / 3 \text{ m}$$

$$= 7,565 \text{ m}^2$$

Choosing a width to length ratio of 3:1, and having 3 ponds in parallel will have the following dimensions:

$$\text{Length} = 87 \text{ m}$$

$$\text{Width} = 29 \text{ m}$$

$$\text{Total pond area} = 3 \times 29 \text{ m} \times 87 \text{ m} = 7,569 \text{ m}^2$$

$$\text{Assume BOD removal in anaerobic pond} = 75\%$$

$$\text{BOD load in anaerobic pond effluent} = [0.25 \times 7,942,400 \text{ g BOD/d}]$$

$$= 1,990 \text{ kg BOD/d}$$

$$\text{BOD concentration} = [1,990,000 \text{ g BOD/d}] / 10,880 \text{ m}^3/\text{d} = 183 \text{ g/m}^3$$

Facultative Ponds

$$\text{BOD load} = 1,990 \text{ kg BOD/d}$$

Using Mara's (1987) tentative global equation:

$$\lambda_s = 350 (1.107 - 0.002T)^{T-25}$$

where λ_s = BOD surface area loading (kg/ha.d)

T = temperature (°C)

At T = 25 °C, $\lambda_s = 350 \text{ kg/ha.d}$

$$A_{\text{fac. pond}} = [1,990 \text{ kg BOD/d}] / 350 \text{ kg/ha.d}$$

$$= 5.685 \text{ ha}$$

$$= 56,850 \text{ m}^2$$

Assume a width to length ratio of 1:5 and that 6 ponds are to be constructed, the pond dimensions would be:

$$\text{Length} = 220 \text{ m}$$

$$\text{Width} = 44 \text{ m}$$

$$\text{Total pond area} = 6 \times 220 \text{ m} \times 44 \text{ m} = 58,080 \text{ m}^2$$

Using a depth of 1.5 m

$$\text{Volume of pond, } V_{\text{fac. pond}} = 1.5 \text{ m} \times 58,080 \text{ m}^2 = 87,120 \text{ m}^3$$

$$\text{Retention time} = 87,120 \text{ m}^3 / 10,880 \text{ m}^3/\text{d} = 8 \text{ days,}$$

Assume 80% BOD removal in facultative pond

$$\text{Effluent BOD} = 0.2 \times 183 \text{ mg/l} = 37 \text{ mg/l}$$

$$\text{Total land area required} = 960 + 2,900 + 7,569 + 58,080$$

$$= 69,509 \text{ m}^2$$

$$\approx 7 \text{ ha.}$$

(Land area excludes area required for pond embankments, access roads and sludge drying beds)

Methane Production

$$\begin{aligned}
 \text{COD removed} &= 97,580 \text{ kg COD/d} \times 0.7 \\
 &= 68,306 \text{ kg COD/d} \\
 &= 68,306,000 \text{ g COD/d} \\
 \\
 \text{Volume of methane} &= 5.5 \text{ ml/g COD} \times 68,306,000 \text{ g COD/d} \\
 &= 375,683,000 \text{ ml/d} \\
 &= 375,683 \text{ l/d} \\
 &\approx \mathbf{376 \text{ m}^3/\text{d}}
 \end{aligned}$$

Using the total volatile solids, the volume of methane produced is:

$$\begin{aligned}
 \text{TVS removed} &= 45,854 \text{ kg TVS/d} \times 0.75 \\
 &= 34,390 \text{ kg TVS/d} \\
 &= 34,390,000 \text{ g TVS/d} \\
 \\
 \text{Volume of methane} &= 9.6 \text{ ml/g TVS} \times 34,390,000 \text{ g TVS/d} \\
 &= 330,114,000 \text{ ml/d} \\
 &= 330,114 \text{ l/d} \\
 &\approx \mathbf{330 \text{ m}^3/\text{d}}
 \end{aligned}$$